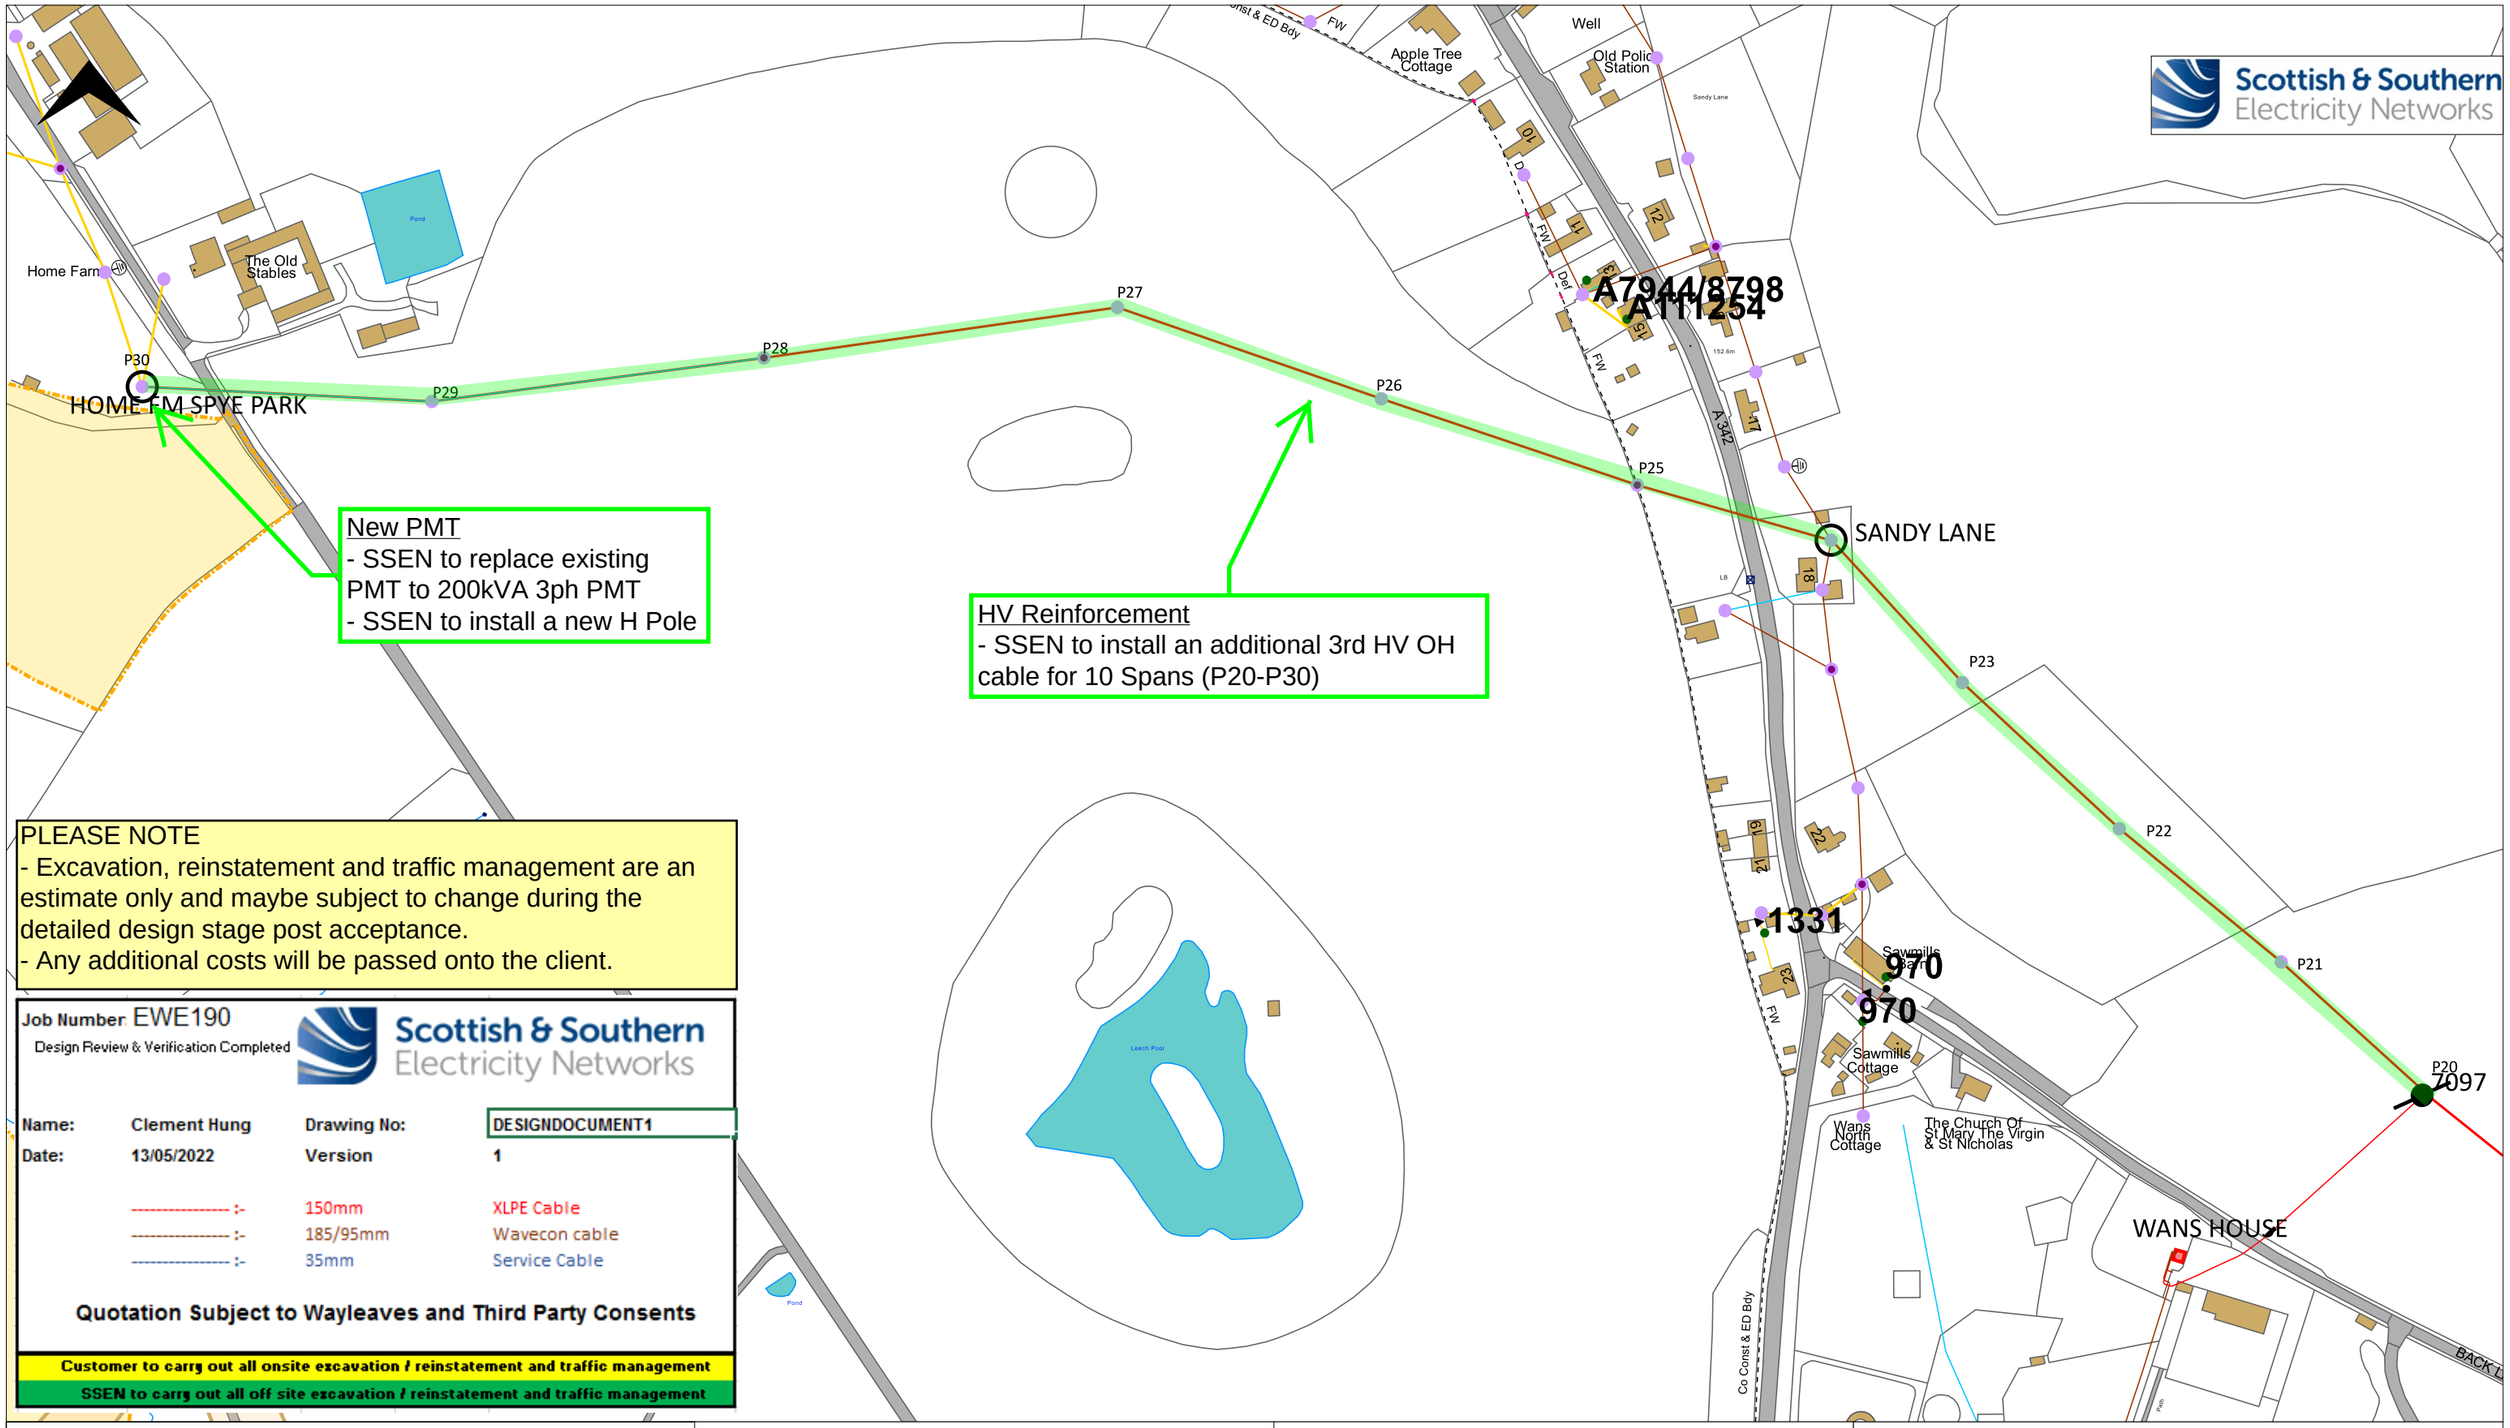

PLEASE NOTE
- Excavation, reinstatement and traffic management are an estimate only and maybe subject to change during the detailed design stage post acceptance.
- Any additional costs will be passed onto the client.

Job Number: EWE190
Design Review & Verification Completed

Scottish & Southern Electricity Networks

Name:	Clement Hung	Drawing No:	DESIGNDOCUMENT1
Date:	13/05/2022	Version	1
---------- :-		150mm	XLPE Cable
---------- :-		185/95mm	Wavecon cable
---------- :-		35mm	Service Cable

Quotation Subject to Wayleaves and Third Party Consents

Customer to carry out all onsite excavation / reinstatement and traffic management

SSEN to carry out all off site excavation / reinstatement and traffic management

WARNING

There may have been subsequent alterations to the surface levels. Trial holes must be taken to determine positions and depths of cables. HS (G) 47 Booklet from the Health and Safety Executive - Avoiding Danger from Buried Cables - should be consulted before commencing excavation work. WHEN WORKING IN THE VICINITY OF OVERHEAD LINES THE HEALTH AND SAFETY GUIDANCE NOTE GS6 SHOULD BE CONSULTED (AVAILABLE FROM THE HSE WEBSITE)

Map Centre: 396348, 167891		Grid Ref: ST96346789	
Scale: 1:2500	Page Size: A3	Plot Date: 04/05/2022	
Designer Name: Hung, Clement		Job Number:	

UNCONTROLLED COPY
Subject to revision
Master held by SSEN Asset Data Team - Asset.Data@sse.com

If you are unsure & need to seek advice before commencing excavations please contact;

General Enquiries	0800 048 3516

NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID

	Services	LV	HV	EHV
FOOTPATH/UNMADE	0.45m	0.45m	0.6m	0.8m
ROAD CROSSING	0.6m	0.6m	0.75m	0.9m
AGRICULTURAL	1m	1m	1m	1.1m

Legend