Key:

Existing Foul

Existing Surface

Existing Combined

Proposed Foul

Proposed Surface

Existing mains water supply

Proposed mains water supply

Proposed communications

Assumed existing electrical supply route maintained

Proposed gas supply route

Notes: Proposed drainage routes to be kept to existing footpaths to minimise disturbance to churchyard where possible.

Drainage route to existing manhole connections to foul and surface water drains (5514 and 5515) laid beneath south west and south footpath. Existing mains drainage connections are located in paved pedestrian area outside the south gates.

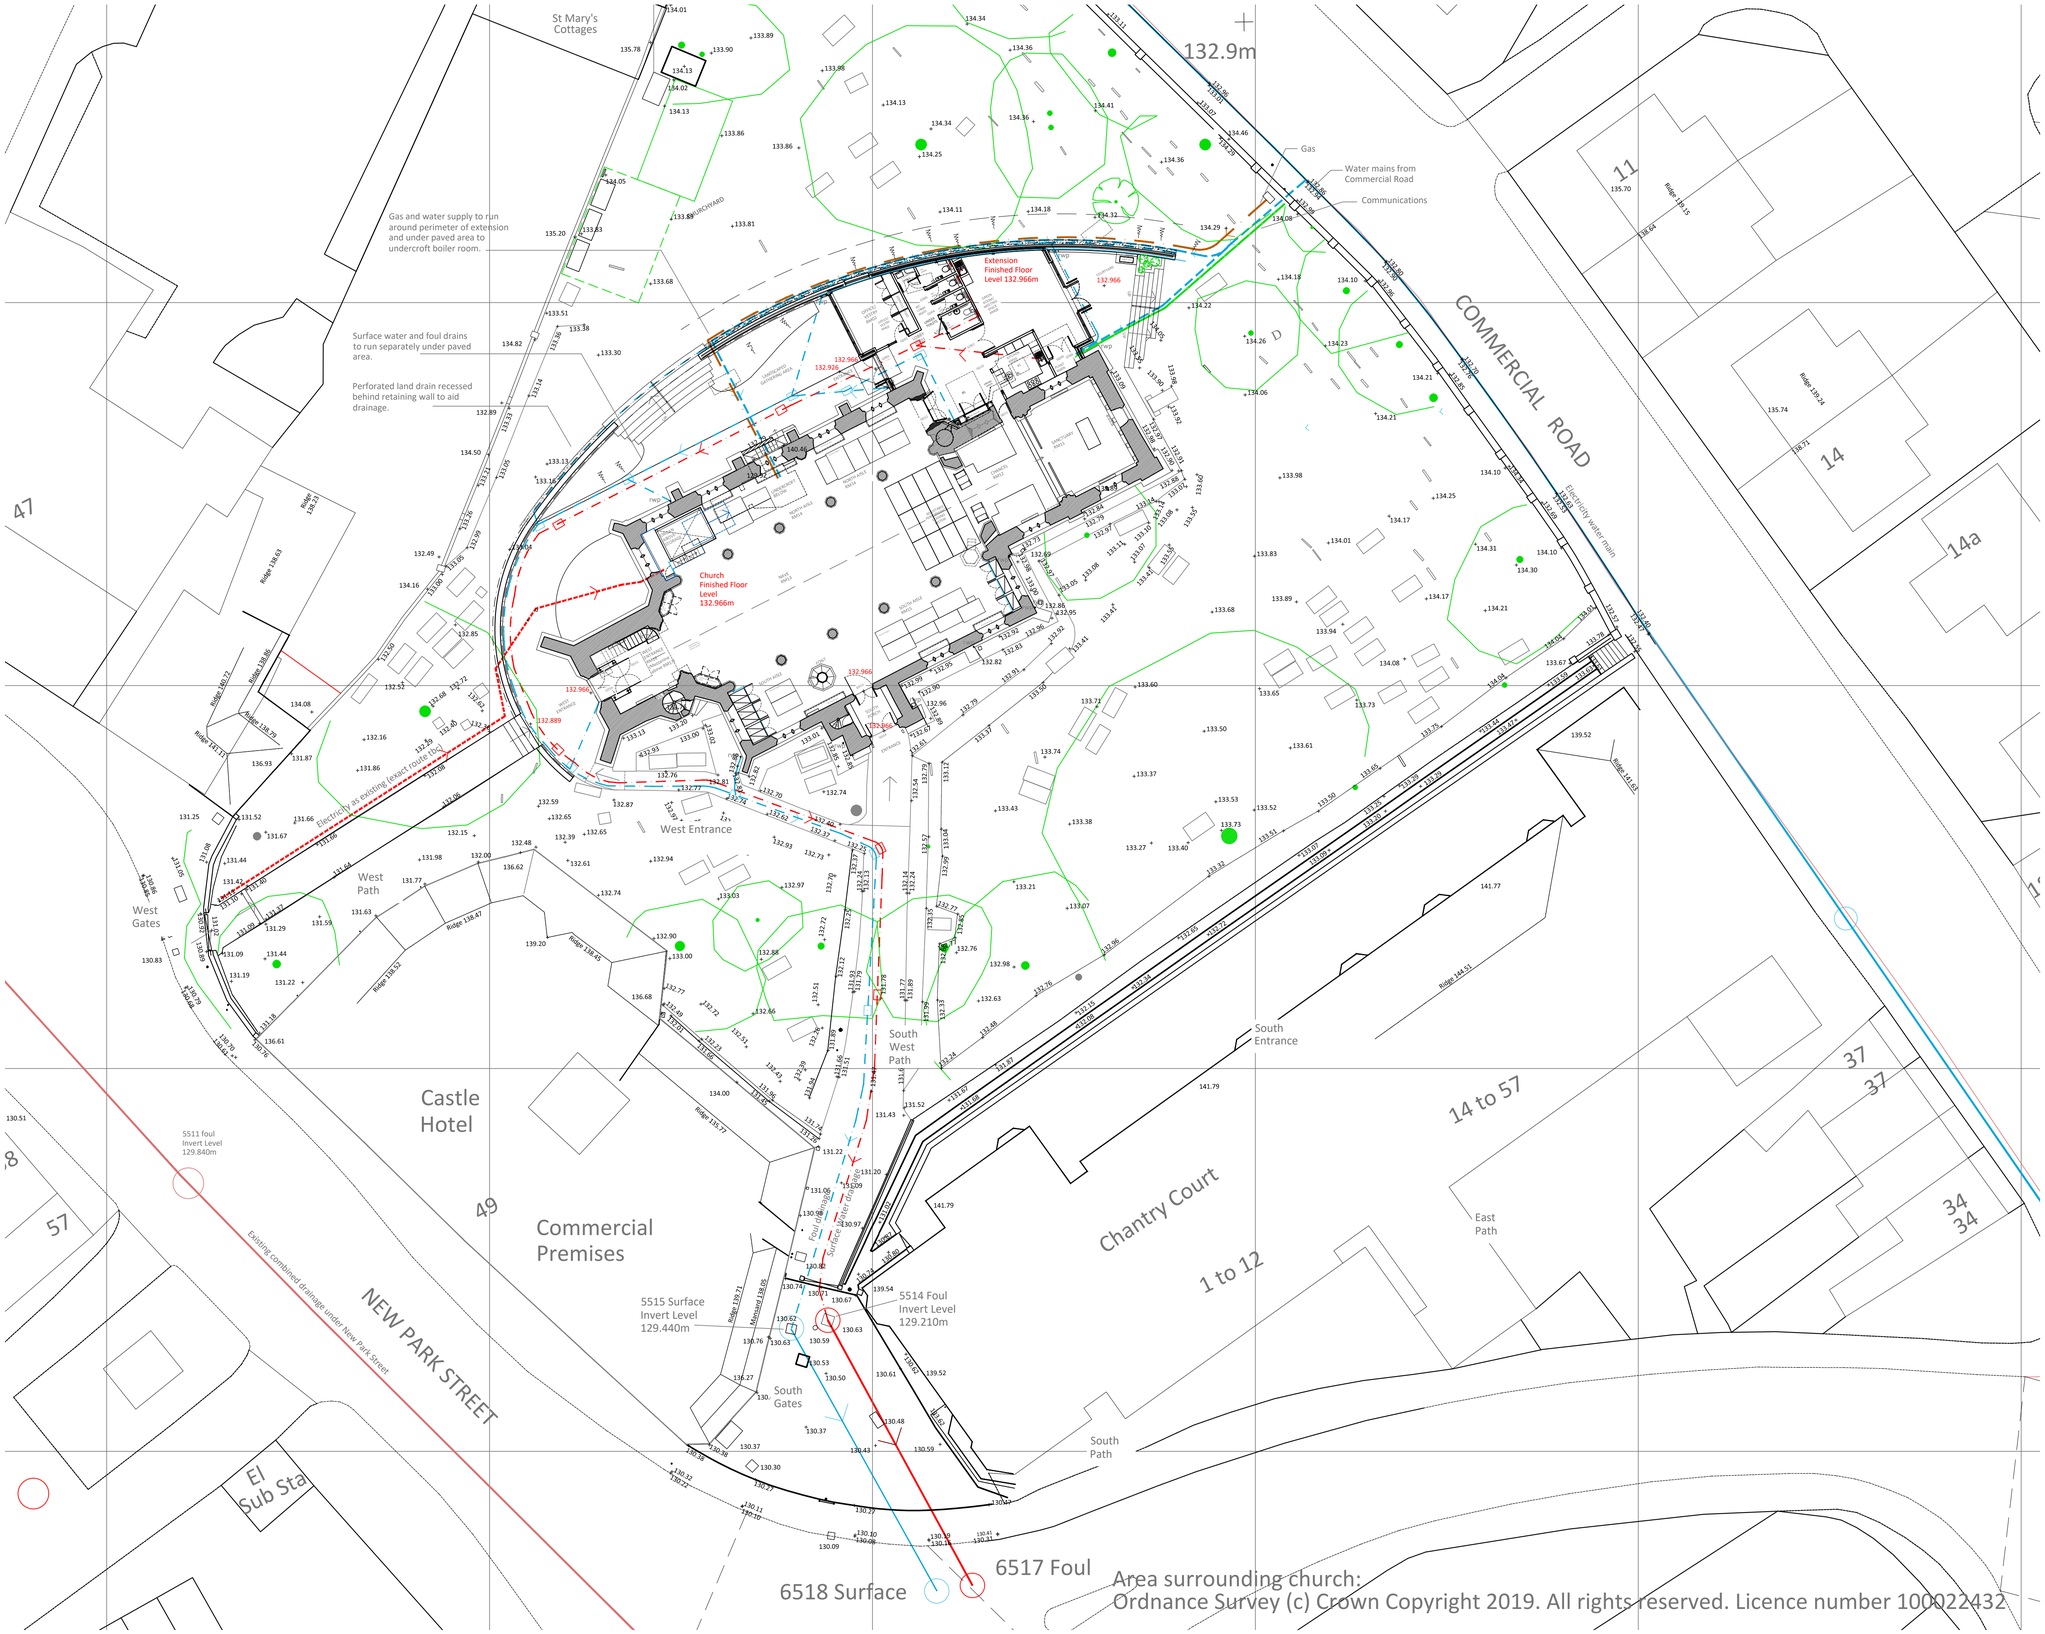

No responsibility is taken for measurements scaled off this drawing, unless otherwise stated. Use for reference purposes only.

Scale- 1:200

0m 20m

ST MARY'S CHURCH, DEVIZES - PROPOSED SERVICES

C	13th July '23 Service runs confirmed. Foul drainage to run around west of church and down under south path. Surface water drainage to connect to existing soakaways. Existing levels, proposed landscaping levels and proposed internal finished floor levels shown
B	10th Mar '22 Minor amendments and drawing revised for tender.
A	24th Aug '21 Gas supply added and other services revised.

CHEDBURN•CODD
CONSERVATION ARCHITECTS
Historic Building Consultants

Glove Factory Studios, 1 Brook Lane, Holt, Bradford-on-Avon, Wiltshire BA14 6RL

T: 01225 859999 www.chedburn.com e: chedburn@chedburn.com

Project	St Mary's Church Devizes
Drawing	Drainage and Services As Proposed
Stage	Planning Conditions
Drawing No.	1735/043/C
Scale	1:200 @ A1
Date	Aug 2021