

NOTES:-


1. DESIGN OF STABLES AND MATERIALS USED ARE TO MATCH STABLES ②
2. EXTERNAL WALLS TO BE TWO SKINS OF 100mm BLOCKWORK WITH 50mm CAVITY
3. PROVIDE STAINLESS STEEL WALL TIES AT 450mm CRS VERTICALLY AND 900mm CRS HORIZONTALLY.
4. TRUSSES TO BE TREATED ~ PROVIDE 100 x 25mm TIMBER WIND BRACING.
5. PROVIDE 900 x 100mm CATNIC RESTRAINT STRAPS AT 900mm CRS TO 100 x 50mm WALLPLATES + BUILT INTO GABLES AT 900mm CRS FIXED TO RAFTERS / CEILING JOISTS OF FIRST THREE TRUSSES.
6. SOAKAWAYS TO BE 2.0m DIA, 2.5m DEEP FILLED WITH 75mm CLEANSTONE AND COVERED WITH TERRAM. SOAKAWAYS TO BE MIN. 5.0m FROM BUILDINGS.

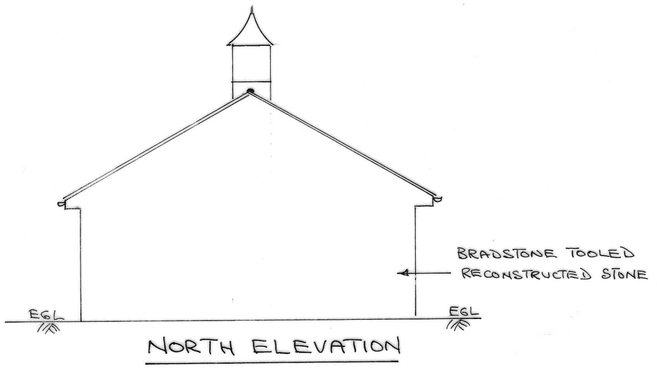

NORTH ELEVATION

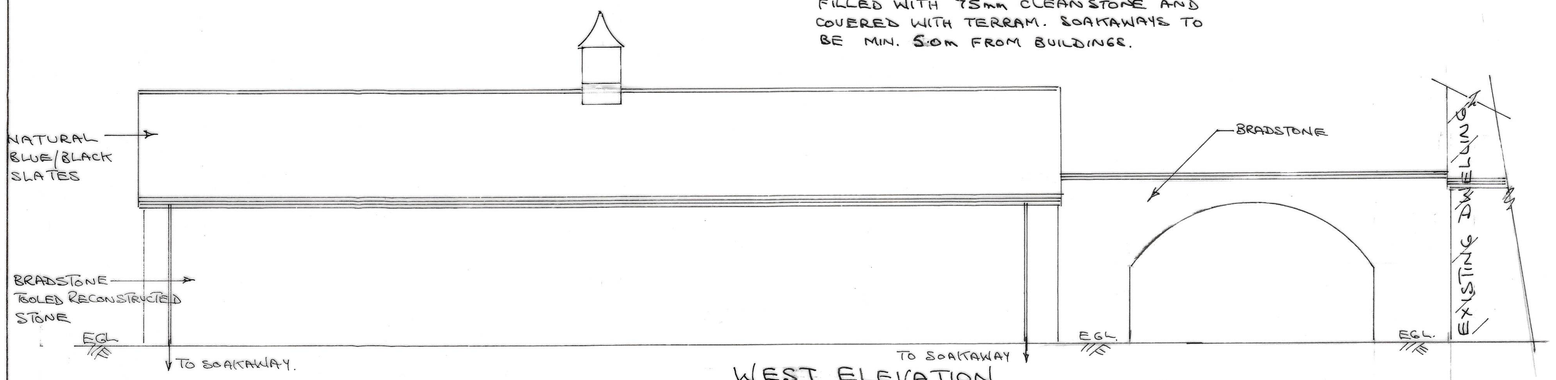



WEST ELEVATION

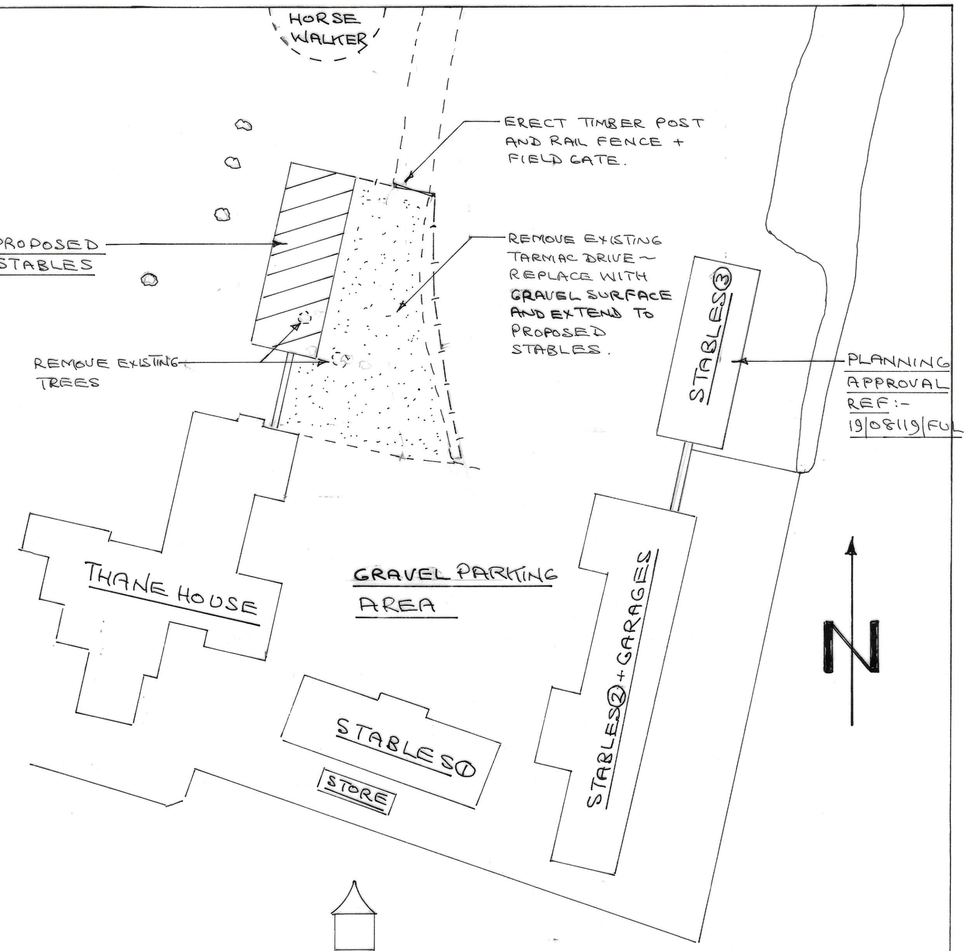


BLOCK PLAN

SCALE:- 1 TO 250

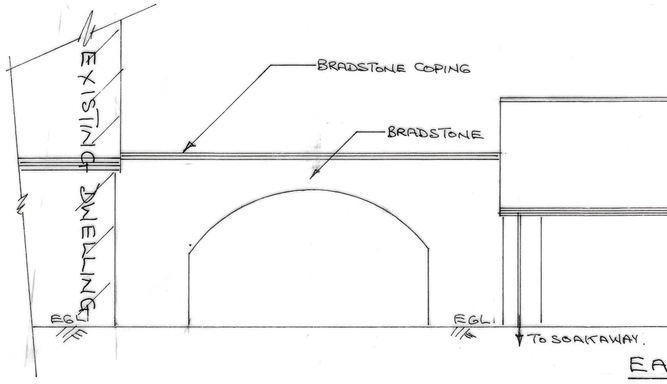


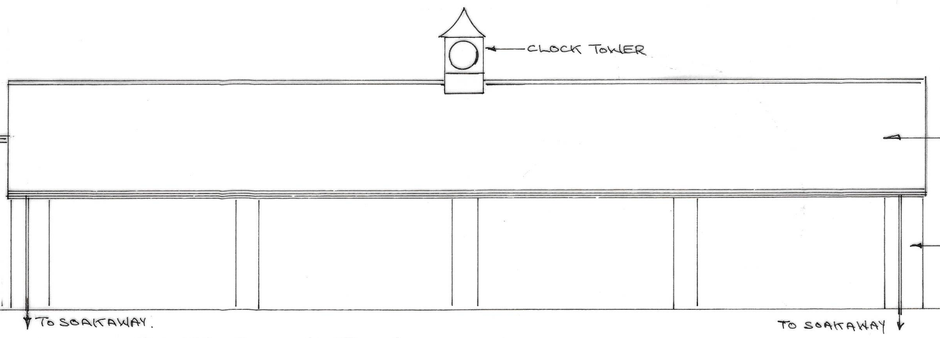

EAST ELEVATION

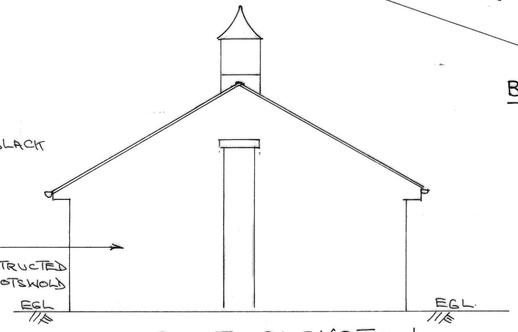


SOUTH ELEVATION

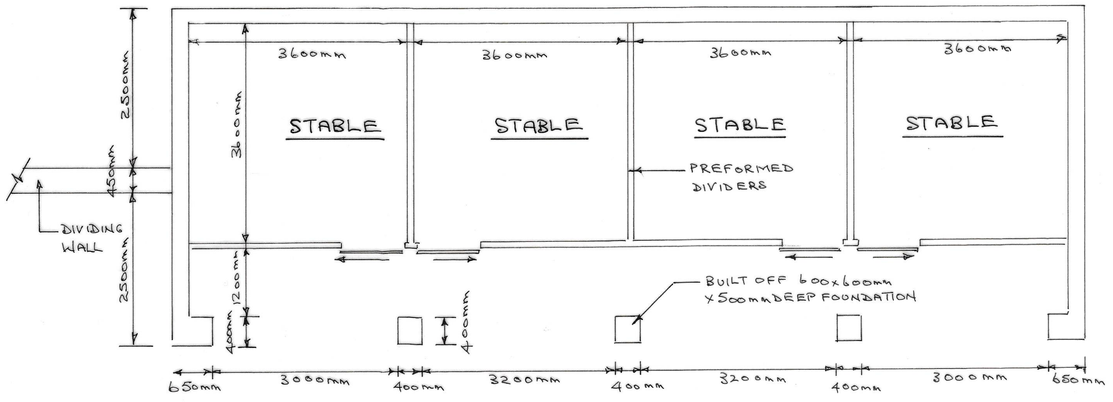

PLAN

SCALE:- 1 TO 50

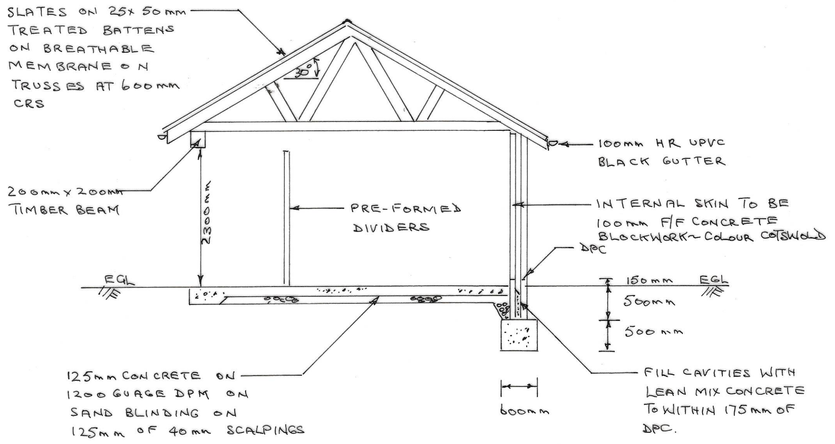

SECTION

SCALE:- 1 TO 50

CLIENT:-
MR. H. SIMS-HILDITCH

ADDRESS:-
THANE HOUSE
HILMARTON
CALNE
WILTS SN11 8SB

PROPOSED STABLE BLOCK

SCALE:- 1 TO 50
DATE:- AUG. 2023
DRAWING Nº 1