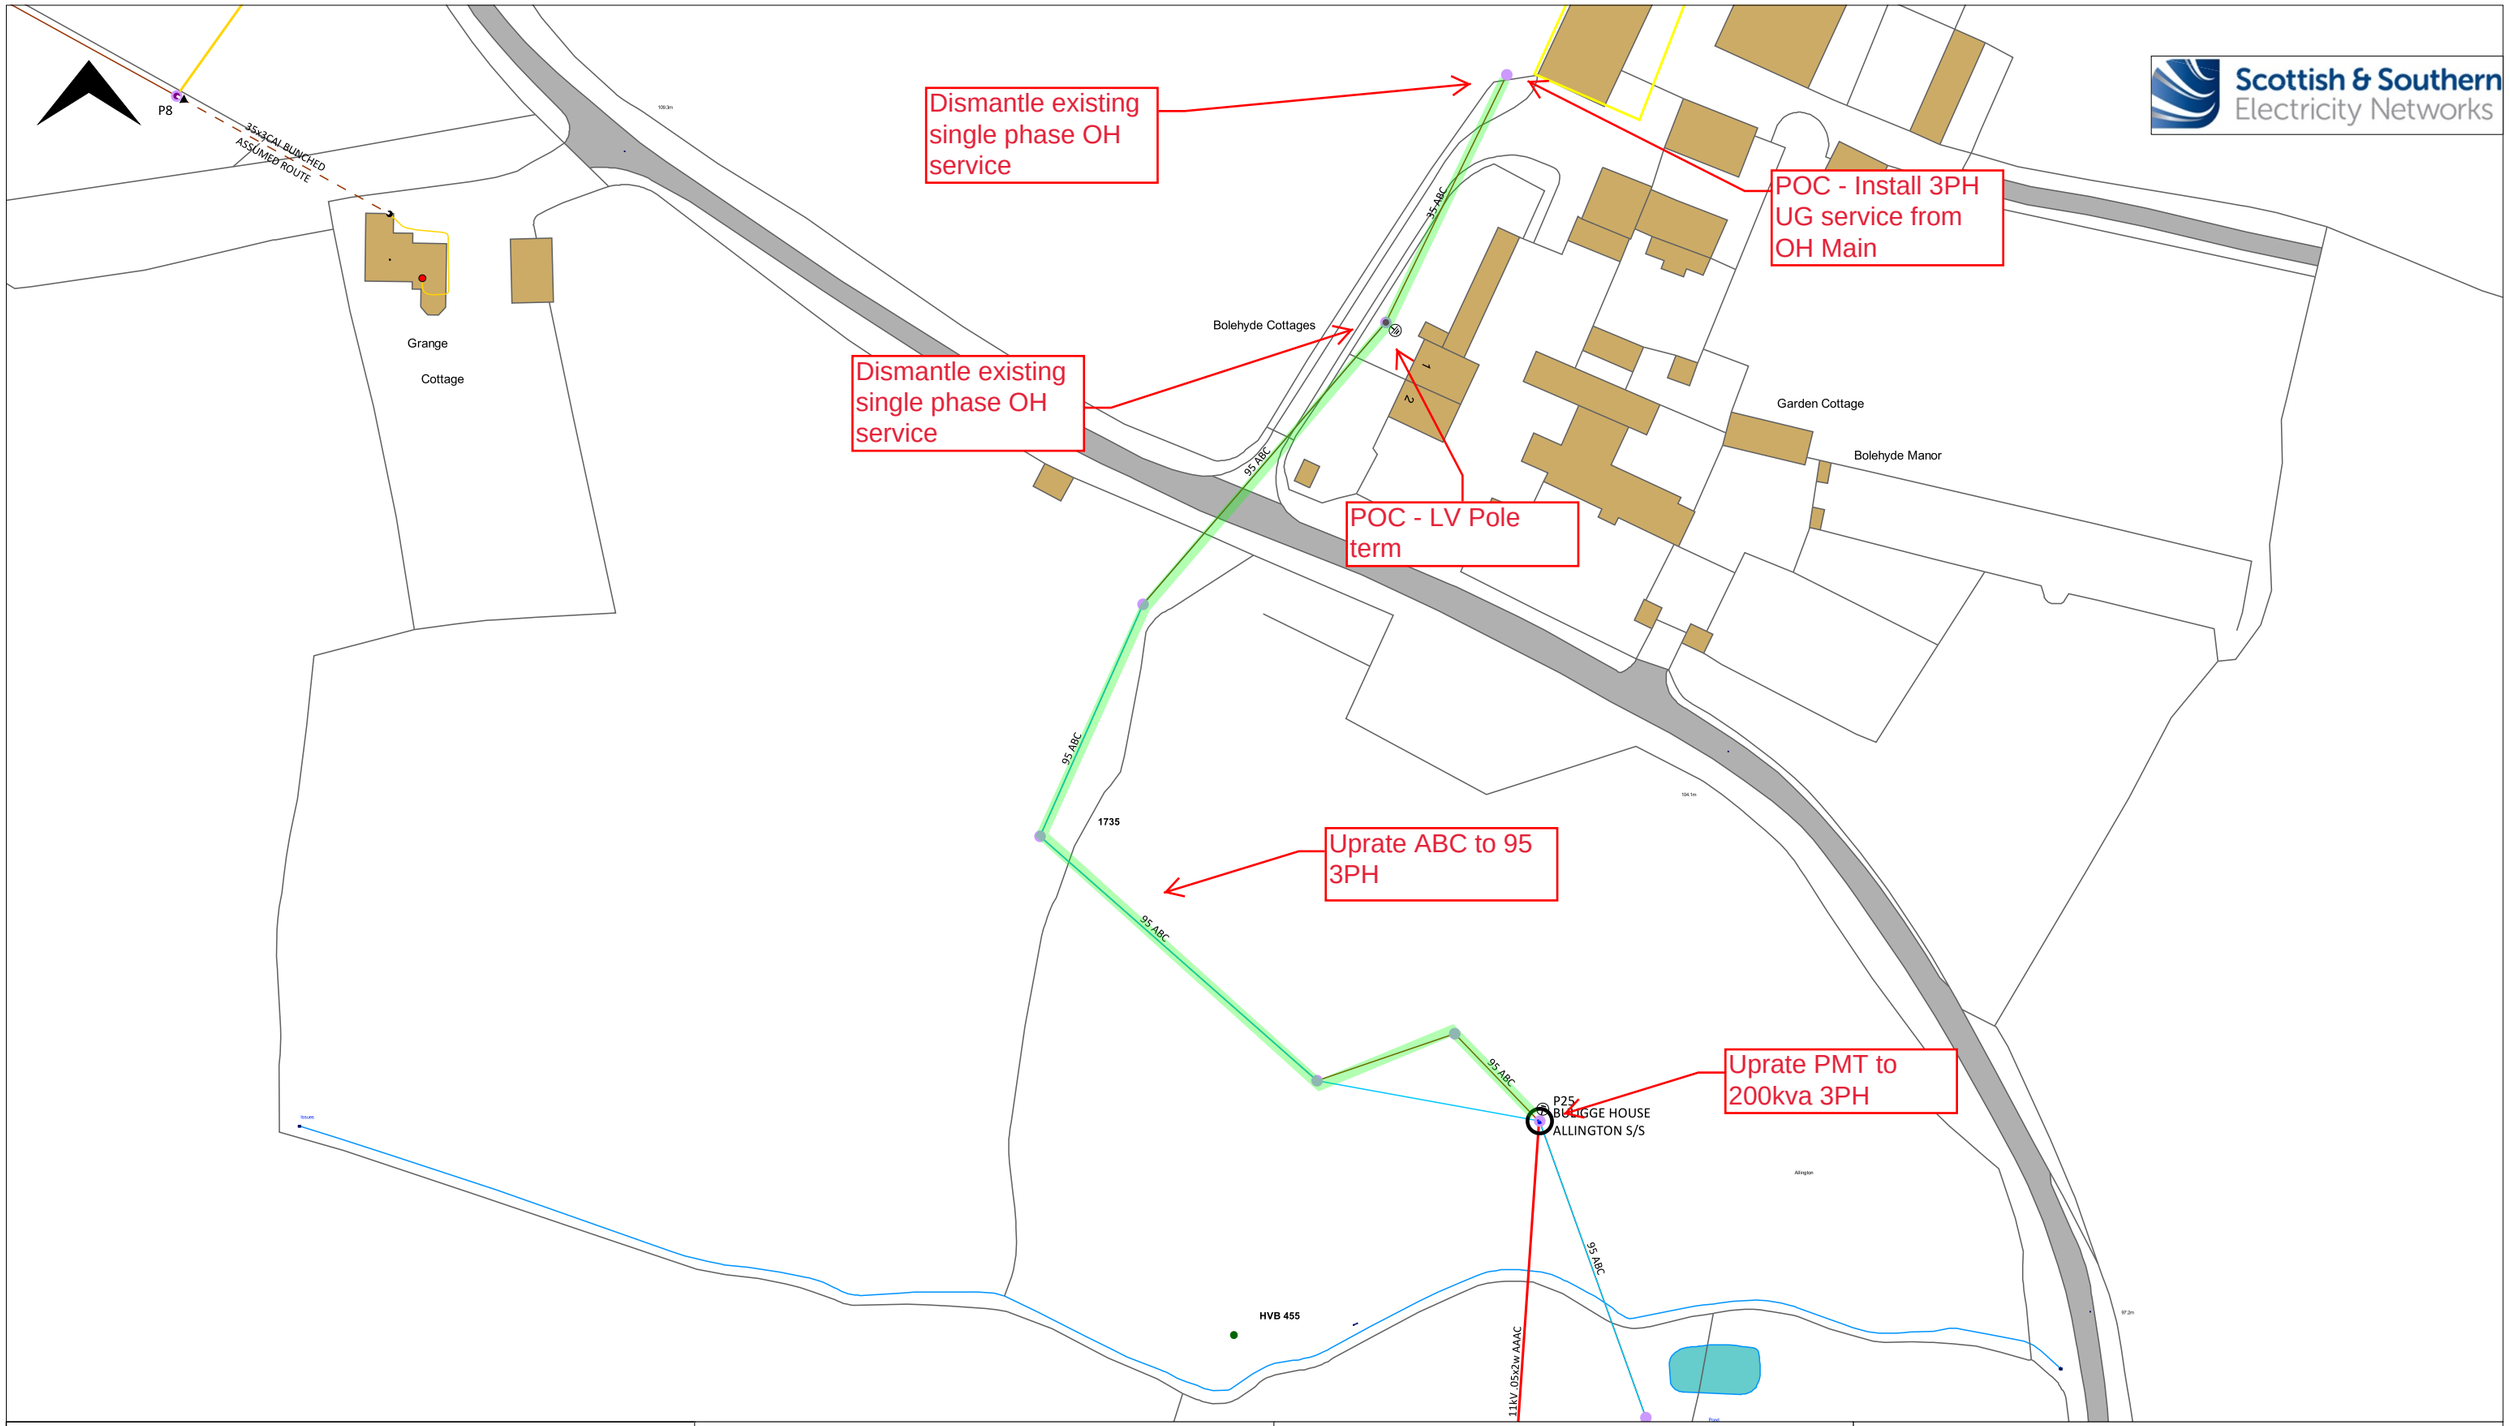

Scottish & Southern Electricity Networks

WARNING

There may have been subsequent alterations to the surface levels. Trial holes must be taken to determine positions and depths of cables. HS (G) 47 Booklet from the Health and Safety Executive - Avoiding Danger from Buried Cables - should be consulted before commencing excavation work. WHEN WORKING IN THE VICINITY OF OVERHEAD LINES THE HEALTH AND SAFETY GUIDANCE NOTE GS6 SHOULD BE CONSULTED (AVAILABLE FROM THE HSE WEBSITE)

Map Centre: 389203, 175584		Grid Ref: ST89207558
Scale: 1:1000	Page Size: A3	Plot Date: 19/05/2023
Designer Name: Bichard, Kyran		Job Number:

UNCONTROLLED COPY
Subject to revision
Master held by SSEN Asset Data Team - Asset.Data@sse.com

If you are unsure & need to seek advice before commencing excavations please contact;

General Enquiries	0800 048 3516

NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID

	Services	LV	HV	EHV
FOOTPATH/UNMADE	0.45m	0.45m	0.6m	0.8m
ROAD CROSSING	0.6m	0.6m	0.75m	0.9m
AGRICULTURAL	1m	1m	1m	1.1m

Legend

Segments [Electric]
- Cable Segment.LV Route - 230.0 V, Existing
- Cable Segment.LV Route - 400.0 V, Existing
- Joint Installation.LV Location - Service, Existing
- Joint Installation.LV Location - Pole Termination, Existing
- Joint Installation.LV Location - O/H Connector, Existing
- Line Segment.HV Route - 11.00 kV, Existing
- Line Segment.LV Route - 230.0 V, Existing
- Line Segment.LV Route - 400.0 V, Existing
- Line Segment.Other Route

Equipment [Electric]
- Isolating Equipment Installation.Other Symbol Location
- Supply Point.LV Location - Property, Existing

Distribution Structures [Electric]
- Pole.Existing Location - Single

Substation Site [Electric]
- Substation.Existing Location - Pole Mounted Distribution

Annotations [Electric]
- Abc Def Cable Annotation.LV Annotation 1:500 - Medium
- Cable Annotation.LV Leader Line 1:500 - Assumed Route
- Abc Def Line Annotation.HV Annotation 1:500 - Medium
- Abc Def Line Annotation.LV Annotation 1:500 - Medium
- Abc Def Pole Structure Anno.Existing Annotation 1:500 - Medium
- Abc Def Substation Anno.Existing Annotation 1:500 - Medium

Common [Electric]
- Asset Activity - Green Label.Location
- Abc Def Asset Activity - Green Label.Annotation
- Marker.Location - Pole Attachment - PME
- Schematic Connector.MV Pin1 - Blue Circle
- Schematic Connector.LV Pin1 - Blue Square
- Schematic Connector.LV Pin1 - Blue Diamond
- Promis Job Boundary (In Design)
- BPA - Pipeline.Location
- BPA - Pipeline.Buffer Zone
- Code-Point Gazetteer.Location
- OS MasterMap Area.AR10021-Building
- OS MasterMap Area.AR10053-General surface - Multi surface - Normal
- OS MasterMap Area.AR10056-General surface - Normal
- OS MasterMap Area.AR10069-Inland water
- OS MasterMap Area.AR10172-Road or track
- OS MasterMap Area.AR10183-Roadside - Normal
- OS MasterMap Line.LN10018-Building - Division
- OS MasterMap Line.LN10019-Building - Outline
- OS MasterMap Line.LN10046-General feature
- OS MasterMap Line.LN10087-Inland water
- OS MasterMap Line.LN10113-Closing geometry
- OS MasterMap Line.LN10114-Closing geometry
- OS MasterMap Line.LN10136-Polit. or Admin. - Parish
- OS MasterMap Line.LN10168-Road or track - Public
- OS MasterMap Point.PT10082-Inland water - Dir. of flow -Sym
- OS MasterMap Point.PT10085-Inland water - Culvert
- OS MasterMap Point.PT10088-Inland water
- OS MasterMap Point.PT10091-Inland water - Culvert - Sym
- OS MasterMap Point.PT10197-Terrain and height - Spot height
- Abc Def OS MasterMap Text.TX10026-Buildings or structure
- Abc Def OS MasterMap Text.TX10059-General surface
- Abc Def OS MasterMap Text.TX10090-Inland water
- Abc Def OS MasterMap Text.TX10198-Terrain and height