
SALISBURY BLOCK 36
51.85 kWp

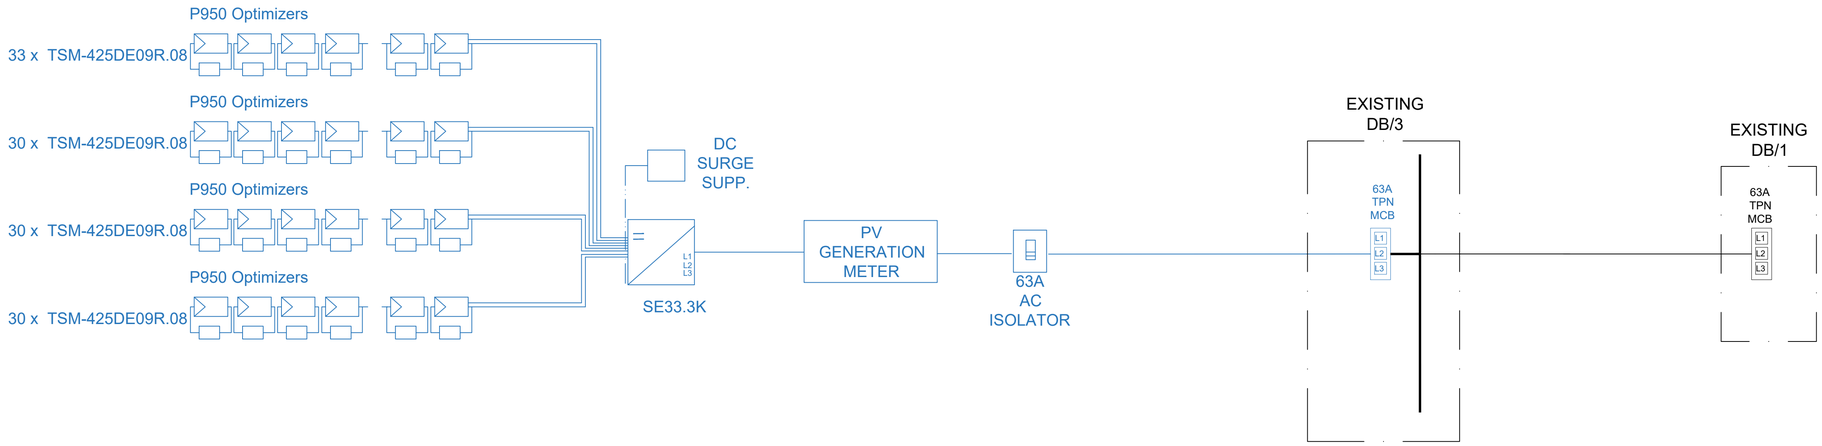

WARNING
Dual Supply

Do not work on this equipment until it is isolated from both mains and on-site generation supplies.

Isolate on-site generator at .....

Isolate mains supply at .....

Revisions:

Rev	Date	Comments	Drawn
00	07/23	FIRST ISSUE	CB

Client: SALISBURY HOSPITAL

Location: SALISBURY BLOCK 36
SALISBURY
SP2 8BJ

Title: PV SINGLE LINE DIAGRAM

Drawn: RES Checked: AM
Scale: NTS@A1 Date: 02/11/23
Drawing No: RES00293-1 Rev: 00

Unit L3 Deacon Trading Estate, Morley Road, Tonbridge, Kent, TN9 1RA

REVOLUTION ENERGY SERVICES

www.revolutionenergyservices.co.uk

Do not scale from this drawing. Site verify all dimensions prior to construction. Report all discrepancies to the drawing originator immediately. This drawing is to be read in conjunction with all relevant documents and drawings.