



REPORT REFERENCE:

IMP7402-3

ENVIRONMENTAL NOISE IMPACT ASSESSMENT

PProPG Planning and Noise

British Standard 8233: 2014

British Standard 4142: 2014 +A1:2019

CLIENT:

Spruce Town Planning

SITE:

Land to the Rear of The Porton Hotel, Station Approach, Porton, Salisbury, SP4 0LA

SURVEY DATES:

5th – 10th July 2023

Impact Acoustics Ltd

1 King John Avenue, Bournemouth, Dorset, BH11 9RS

Tel: 01202 581398

impactacoustics.co.uk

1	EXECUTIVE SUMMARY	6
1.1	INSTRUCTION	6
1.2	SCOPE OF REPORT.....	6
1.3	SUMMARY OF NOISE LEVELS	6
1.4	POTENTIAL FAÇADE NOISE LEVELS.....	7
1.4.1	Daytime (07:00-23:00).....	7
1.4.2	Night Time (23:00-07:00).....	7
1.5	RISK ASSESSMENT.....	7
1.5.1	Daytime (07:00-23:00) – Position 1	7
1.5.2	Night Time (23:00-07:00) – Position 1	7
1.6	GLAZING & VENTILATION ASSESSMENT	7
1.7	COMMERCIAL NOISE ASSESSMENT	8
1.7.1	Daytime (Rear).	8
1.8	PATRON NOISE ASSESSMENT 19:00 – 23:00	8
1.8.1	External Assessment	8
1.8.2	Internal Assessment.....	8
1.9	20 STAFF CARS + COLLECTIONS AND DELIVERIES 12:00 – 18:00	8
1.10	STAFF LEAVING 23:45 – 00:00	9
1.11	AMBIENT NOISE BS 8233: 2014	9
1.12	COMMERCIAL NOISE	9
1.13	PLANNING APPROVAL.....	9
2	INTRODUCTION.....	10
2.1	PLANNING PRACTICE GUIDANCE AND NOISE.....	10
2.1.1	Professional Practice Guidance on Planning & Noise.	11
2.2	BRITISH STANDARD 8233: 2014.....	12
2.3	NATIONAL PLANNING POLICY FRAMEWORK 2024 (NPPF) AND NOISE POLICY STATEMENT FOR ENGLAND 2010 (NPSE).	13
2.3.1	“Significant adverse” and “adverse”	13
2.3.2	NOEL – No Observed Effect Level.....	13
2.3.3	LOAEL – Lowest Observed Adverse Effect Level	13
2.3.4	SOAEL – Significant Observed Adverse Effect Level	13
3	EHO COMMENTS.....	14
4	SITE LOCATION.....	15
4.1	POSITION OF SITE IN WIDER AREA.....	15
4.2	PROPOSED DEVELOPMENT.....	16
5	PROCEDURE	20
6	APPARATUS	21
6.1	NORSONIC NOISE METER S/N 1402941 ENVIRONMENTAL TESTING – POSITION 1	21
6.2	NORSONIC NOISE METER S/N 1403140 ENVIRONMENTAL TESTING – POSITION 2	21

7	RESULTS	22
7.1	POSITION 1	22
7.1.1	07:00 – 07:00 5 th – 6 th July 2023	22
7.1.2	07:00 – 07:00 6 th – 7 th July 2023	22
7.1.3	07:00 – 07:00 7 th – 8 th July 2023	22
7.1.4	07:00 – 07:00 8 th – 9 th July 2023	22
7.1.5	07:00 – 07:00 9 th – 10 th July 2023	22
7.2	POSITION 2	23
7.2.1	07:00 – 07:00 5 th – 6 th July 2023	23
7.2.2	07:00 – 07:00 6 th – 7 th July 2023	23
7.2.3	07:00 – 07:00 7 th – 8 th July 2023	23
7.2.4	07:00 – 07:00 8 th – 9 th July 2023	23
7.2.5	07:00 – 07:00 9 th – 10 th July 2023	23
7.3	SUMMARY OF RESULTS	24
8	PROPG PLANNING & NOISE STAGE 1	25
8.1	STAGE 1: INITIAL SITE NOISE RISK ASSESSMENT	25
8.2	POTENTIAL FAÇADE NOISE LEVELS	26
8.2.1	Daytime (07:00-23:00)	26
8.2.2	Night Time (23:00-07:00)	26
8.3	RISK ASSESSMENT	26
8.3.1	Daytime (07:00-23:00) – Position 1	26
8.3.2	Night Time (23:00-07:00) – Position 1	26
9	PROPG PLANNING & NOISE STAGE 2 - ELEMENT 1 – GOOD ACOUSTIC DESIGN	27
10	ELEMENT 2 – INTERNAL NOISE LEVEL GUIDELINES	28
10.1	DISCUSSION OF RESULTS	28
10.2	EXISTING NOISE LEVELS – DAYTIME (07:00 – 23:00)	28
10.3	EXISTING NOISE LEVELS – NIGHT TIME (23:00 – 07:00)	28
10.4	PROPOSED NOISE LEVELS – DAYTIME (07:00 – 23:00)	29
10.5	PROPOSED NOISE LEVELS – NIGHT TIME (23:00 – 07:00)	29
10.6	RECOMMENDATIONS	30
10.7	CALCULATION PROCEDURE TO BS 8233: 2014	30
10.8	GROUND FLOOR LOUNGE	31
10.9	TOP FLOOR BEDROOM	31
10.10	GLAZING (R_{wi})	32
10.11	WALLS (R_{ew})	32
10.12	ROOF (R_{rr})	32
10.13	GLAZING & VENTILATION ASSESSMENT	32
11	OVERHEATING	33
12	LAMAX DB NOISE LEVEL ASSESSMENT	36
12.1	CRITERIA	36

12.1.1	Night Noise Guidelines Europe 2009.....	36
12.1.2	Professional Practice Guidance on Planning & Noise.	36
12.1.3	World Health Organisations 'Guidelines for Community Noise'.	37
12.1.4	LAFmax dB Noise Levels – Night Time 23:00 – 07:00 (1 Minute Data)	37
13	ELEMENT 3 – EXTERNAL AMENITY AREA NOISE ASSESSMENT	38
13.1	OUTDOOR LIVING AREAS.....	38
14	CALCULATIONS	41
14.1	KITCHEN EXTRACT	41
14.2	EXISTING NOISE LEVELS.....	41
14.3	INPUTTED NOISE LEVELS.....	41
14.4	CALCULATED FAÇADE LEVELS	41
15	BS4142: 2014 +A1: 2019 NOISE ASSESSMENT.....	42
15.1	SCOPE OF BRITISH STANDARD 4142: 2014 +A1: 2019	42
15.2	TERMS AND DEFINITIONS	42
15.3	ASSESSMENT POSITION	42
15.4	CALCULATIONS	42
15.5	EQUIVALENT POSITION.....	42
15.6	RATING LEVELS (CHARACTER CORRECTION)	43
15.7	SUBJECTIVE METHOD	43
15.8	ASSESSMENT CRITERION.....	44
15.9	NOISE METER FLOOR	44
15.10	BS 4142: 2014 +A1:2019 PENALTIES.....	44
15.11	ASSESSMENTS	45
15.11.1	Daytime (07:00 – 23:00)	45
15.12	TONAL PENALTY	45
15.13	IMPULSIVE PENALTY	45
15.14	ASSESSMENT CONCLUSION	45
16	NOISE FROM PATRONS	46
16.1	CALCULATION OF INTERNAL LEVEL	46
16.2	INPUTTED NOISE LEVELS.....	47
16.3	CALCULATED FAÇADE LEVELS	47
16.4	PATRON NOISE ASSESSMENTS 19:00 – 23:00.....	48
17	STAFF MOVEMENTS + COLLECTIONS & DELIVERIES	49
18	STAFF LEAVING AT 00:00 HRS	50
19	ELEMENT 4 – ASSESSMENT OF OTHER RELEVANT ISSUES	51
20	ACOUSTIC DESIGN STATEMENT.....	52
21	RECOMMENDATION TO DECISION MAKER.....	53
22	CONCLUSION	54
22.1	SUMMARY OF RESULTS	54

22.2	POTENTIAL FAÇADE NOISE LEVELS.....	54
22.2.1	Daytime (07:00-23:00).....	54
22.2.2	Night Time (23:00-07:00).....	54
22.3	RISK ASSESSMENT.....	54
22.3.1	Daytime (07:00-23:00) – Position 1.....	54
22.3.2	Night Time (23:00-07:00) – Position 1.....	54
22.4	GLAZING & VENTILATION ASSESSMENT.....	55
22.5	COMMERCIAL NOISE ASSESSMENT.....	55
22.5.1	Daytime (Rear).....	55
22.6	PATRON NOISE ASSESSMENT 19:00 – 23:00.....	55
22.6.1	External Assessment.....	55
22.6.2	Internal Assessment.....	55
22.7	20 STAFF CARS + COLLECTIONS AND DELIVERIES 12:00 – 18:00.....	56
22.8	STAFF LEAVING 23:45 – 00:00.....	56
22.9	AMBIENT NOISE BS 8233: 2014.....	56
22.10	COMMERCIAL NOISE.....	56
22.11	PLANNING APPROVAL.....	56
23	APPENDIX A - RESULTS.....	57
23.1	5 TH – 6 TH JULY 2023 – POSITION 1.....	57
23.2	6 TH – 7 TH JULY 2023 – POSITION 1.....	58
23.3	7 TH – 8 TH JULY 2023 – POSITION 1.....	59
23.4	8 TH – 9 TH JULY 2023 – POSITION 1.....	60
23.5	9 TH – 10 TH JULY 2023 – POSITION 1.....	61
23.6	5 TH – 6 TH JULY 2023 – POSITION 2.....	62
23.7	6 TH – 7 TH JULY 2023 – POSITION 2.....	63
23.8	7 TH – 8 TH JULY 2023 – POSITION 2.....	64
23.9	8 TH – 9 TH JULY 2023 – POSITION 2.....	65
23.10	9 TH – 10 TH JULY 2023 – POSITION 2.....	66
24	APPENDIX B - ENVIRONMENTAL CONDITIONS.....	67
25	APPENDIX C - UNCERTAINTY.....	68
25.1	UNCERTAINTY BUDGET.....	68

1 EXECUTIVE SUMMARY

1.1 Instruction

Impact Acoustics Ltd have been instructed by Spruce Town Planning to undertake a background noise survey to British Standard 8233: 2014 and BS 4142: 2014+A1: 2019 to determine the impact of existing noise sources on the proposed accommodation scheme at Land to the Rear of The Porton Hotel, Station Approach, Porton, Salisbury, SP4 0LA.

1.2 Scope of Report

The measurements will be undertaken in accordance with ISO 1996 – Part 2: 2017 to determine the existing background noise levels and British Standard 8233: 2014 will be used to determine the impact of existing traffic on the internal noise environment within the proposed residential dwellings. This report aims to establish the following:

- Existing background noise levels within the area;
- Assess the potential internal noise levels on the proposed rooms;
- Provide specifications for the ventilation and window glazing with the proposed rooms.
- Assess any commercial noise from the nearby commercial premises.

1.3 Summary of Noise Levels

A background noise survey was undertaken from 5th – 10th July 2023 at two positions to establish the underlying background noise levels. The recorded levels are as follows:-

Assessment Position	Date Start	Date Finish	Daytime LAeq (07:00-23:00)	Night Time LAeq (23:00-07:00)
Position 1	05.07.2023	10.07.2023	63.8	54.3
Position 2	05.07.2023	10.07.2023	55.3	47.5

Assessment Position	Date Start	Date Finish	Activity & Time Period	Background Noise Level LA90
Position 2	05.07.2023	10.07.2023	Daytime (07:00 – 23:00)	LA90 1 HOUR 47 dB
			External Patron (19:00 – 23:00)	LA90 1 HOUR 44 dB
			Lorry Movements (12:00 – 18:00)	LA90 1 HOUR 47dB
			Staff Leaving (23:45 – 00:00)	LA90 15 MINUTE 36 - 43 dB

1.4 Potential Façade Noise Levels

1.4.1 Daytime (07:00-23:00)

Time Period	Highest Potential Façade Noise Level	Noise Risk Category 2 - Medium
Average Daytime (07:00-23:00)	$L_{Aeq, 16 \text{ HOUR}}$ 65 dB	64 - 70 dB

1.4.2 Night Time (23:00-07:00)

Time Period	Highest Potential Façade Noise Level	Noise Risk Category 1 - Low
Average Night Time (23:00-07:00)	$L_{Aeq, 16 \text{ HOUR}}$ 54 dB	40 - 55 dB
	Maximum (10 Times) – L_{Amax} 77.7 dB	>80 dB (10 Times in 8 Hours)

1.5 Risk Assessment

1.5.1 Daytime (07:00-23:00) – Position 1

Risk Assessment Category	Risk Assessment
2 - Medium	As noise levels increase, the site is likely to be less suitable from a noise perspective and any subsequent application may be refused unless a good acoustic design process is followed and is demonstrated in an ADS which confirms how the adverse impacts of noise will be mitigated and minimised, and which clearly demonstrate that a significant adverse noise impact will be avoided in the finished development.

1.5.2 Night Time (23:00-07:00) – Position 1

Risk Assessment Category	Risk Assessment
1 – Low	At low noise levels, the site is likely to be acceptable from a noise perspective provided that a good acoustic design process is followed and is demonstrated in an ADS which confirms how the adverse impacts of noise will be mitigated and minimised in the finished development.

The above table demonstrates this site is located within Noise Risk Category 2 for daytime and Category 1 for night time, which suggests further mitigation levels will be required at Stage 2 provided a good acoustic design process is followed.

1.6 Glazing & Ventilation Assessment

The development should be designed with a 6mm glass / 16mm Air Gap / 4mm glass and MVHR System to all room to ensure the internal noise levels are acceptable in terms of the assessment to British Standard 8233: 2014.

1.7 Commercial Noise Assessment

1.7.1 Daytime (Rear).

Rating Level	35 dB	9.1	The acoustic feature correction is added to the specific noise level
Background Noise Level $L_{A90,1 \text{ hour}}$	47 dB	8.1	Modal Background Noise Level (07:00 – 23:00)
Assessment Level	-12 dB	11	The background level is subtracted from the rating level.
Conclusion BS 4142:2014 _[1]	+10 dB Significant Adverse Effects, +5 dB Adverse Effects, +0 dB Low Impact		
Assessment	-12 dB		
Conclusion	The assessment level is 'Low Impact'		

1.8 Patron Noise Assessment 19:00 – 23:00

1.8.1 External Assessment

External Residential Assessment	20 Adults outside all at once with 10 Talking
Calculated Level at Residential	43 dB
Background Noise Level	47 dB
Excess Over Background	-4 dB
Assessment Conclusion	Low Impact

1.8.2 Internal Assessment

Internal Residential Assessment	20 Adults outside all at once with 10 Talking
Calculated Level at Residential	43 dB
Partially Open Window	-12 dB
Calculated Level Inside Residential	31 dB
BS 8233: 2014 Criteria	35 dB
Excess Over Target Level	-1 dB
Assessment Conclusion	Low Impact

1.9 20 Staff Cars + Collections and Deliveries 12:00 – 18:00

External Residential Assessment	20 Cars & 5 Lorries
Calculated Level at Residential	29 dB
Background Noise Level	47 dB
Excess Over Background	-18 dB
Assessment Conclusion	Low Impact

1.10 Staff Leaving 23:45 – 00:00

External Residential Assessment	20 Cars
Calculated Level at Residential	25 dB
Background Noise Level	36 dB
Excess Over Background	-11 dB
Assessment Conclusion	Low Impact

1.11 Ambient Noise BS 8233: 2014

The dominant noise source on the overall site is road traffic. Levels have been recorded and assessments made in accordance with the relevant standards. Internal criteria's have been set and calculations made in order to determine the minimum construction details required in order to meet the desired level within the proposed residential dwellings and satisfy the local council's requirements.

1.12 Commercial Noise

The operation of the existing commercial noise source has been assessed to establish if these will have a demonstrable adverse effect in terms of noise that outweigh the benefits of the development. Measurements have been undertaken in accordance with British Standard 4142: 2014+A1:2019 and ISO 1996 – Part 2: 2017. This report has established the existing background noise levels at the closest proposed residential façade to the existing noise sources. The resulting emissions from the site running on a worst case scenario show no conflict with 'low impact' criteria and give a strong indication that complaint and impact on the local amenity is unlikely.

1.13 Planning Approval

National Planning Policy Framework 2024 suggests that planning permission should be granted unless any adverse impacts of doing so would significantly and demonstrably outweigh the benefits, when assessed against the policies in the framework taken as a whole, or specific policies in the framework indicate the application should be restricted.

Based on the calculations and assessments made within this report it is the professional opinion of Impact Acoustics Ltd that the proposed development can demonstrate compliance with the National Planning Policy Framework 2024, NPPF & NPSE and that, with regards to sound, planning permission can be granted.

2 INTRODUCTION

Impact Acoustics Ltd have been instructed by Spruce Town Planning to undertake a background noise survey to British Standard 8233: 2014 and BS 4142: 2014+A1: 2019 to determine the impact of existing noise sources on the proposed accommodation scheme at Land to the Rear of The Porton Hotel, Station Approach, Porton, Salisbury, SP4 0LA.

Ambient noise levels were measured between 5th – 10th July 2023. This report by Impact Acoustics Ltd gives the results of these measurements and an assessment in accordance with government planning guidelines and relevant standards together with mitigation measures as required.

With regards to external ambient noise, environmental noise levels are to be monitored at the site in accordance with British Standard 7445: 2003 'Description and measurement of environmental noise assessments and assessments made in-line with PROPG: Planning and Noise.

2.1 Planning Practice Guidance and Noise

March 2014 saw the publication of the Planning Practice Guidance for Noise (PPG-Noise) and this was subsequently updated in December 2014. The Planning Practice Guidance and Noise sets out details of how potential noise impacts should be evaluated.

'Local planning authorities' plan-making and decision taking should take account of the acoustic environment and in doing so consider:

- *whether or not a significant adverse effect is occurring or likely to occur;*
- *whether or not an adverse effect is occurring or likely to occur; and*
- *whether or not a good standard of amenity can be achieved.*

In line with the Explanatory Note of the Noise Policy Statement for England, this would include identifying whether the overall effect of the noise exposure (including the impact during the construction phase wherever applicable) is, or would be, above or below the significant observed adverse effect level and the lowest observed adverse effect level for the given situation. As noise is a complex technical issue, it may be appropriate to seek experienced specialist assistance when applying this policy.'


In accordance with Stage 2: Full Assessment, Other Noise Sources, detailed calculations and assessments should be carried out pertaining to these as PPG Noise does not provide advice and guidance when taking these elements into consideration.

2.1.1 Professional Practice Guidance on Planning & Noise.

The Professional Practice Guidance (PRoPG) on Planning and Noise for New Residential Development was published in May 2017 by the Association of Noise Consultants (ANC), Institute of Acoustics (IOA) and Chartered Institute of Environmental Health (CIEH). This document was developed in order to offer professional guidance on recommended strategies to the management of noise for use in the associated planning applications for specific sites. This furthermore, provides a numerical acoustic standard in accordance with the Government's planning and noise policies.

This document has been developed to ensure the developers adopts a good acoustic design process to ensure protection for future residents from the potential harmful effects from noise. The PRoPG denotes that it *'does not constitute an official government code of practice and neither replaces nor provides an authoritative interpretation of the law or government policy on which users should take their own advice as appropriate'*.

The PRoPG adopts a twin-stage approach, firstly providing an 'Initial Noise Risk Assessment' of the proposed development site before undertaking a detailed approach of a noise impact assessment. The results from the initial noise risk assessment are an indication of the general acoustic environment of the proposed development and demonstrate how detailed the noise impact assessment will need to be in order to mitigate any acoustic issues.

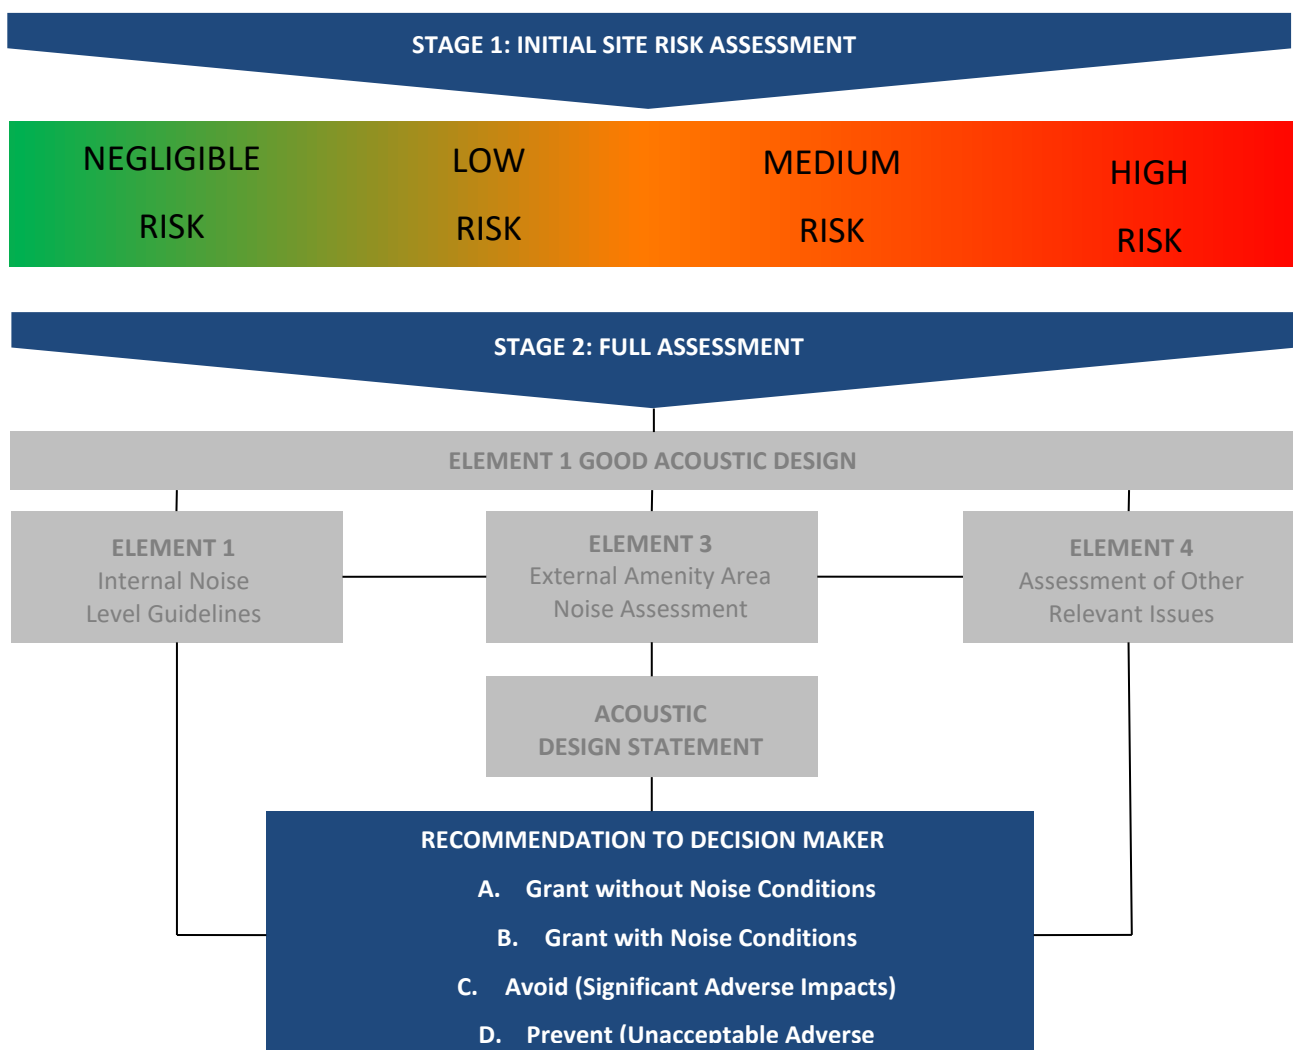

2.2 British Standard 8233: 2014

Calculations are to be made in accordance with BS 8233: 2014 Sound Insulation and Noise Reduction for Buildings Code of Practice.

BS 8233: 2014 set the following parameters as target levels that should be designed to within rooms such as Living Rooms and Bedrooms.

Indoor ambient noise levels in spaces when they are unoccupied and privacy is also important		
Objective	Typical situations	Design Range $L_{Aeq,t}$ dB
Typical noise levels for acoustic privacy in shared spaces	Living room	35 – 40
NOTE: See Noise control in building services [28] and BS EN ISO 3382.		

Indoor ambient noise levels for dwellings			
Activity	Location	07:00 – 23:00	23:00 – 07:00
Resting	Living Room	35 dB L_{Aeq} 16 HOUR	--
Dining	Dining Room / Area	40 dB L_{Aeq} 16 HOUR	--
Sleeping (daytime resting)	Bedroom	35 dB L_{Aeq} 16 HOUR	30 dB L_{Aeq} 8 HOUR

Calculations and assessments are therefore to be carried out in order to satisfy the above requirements of BS8233: 2014.

2.3 National Planning Policy Framework 2024 (NPPF) and Noise Policy Statement for England 2010 (NPSE).

References and evaluations are to be made to the National Planning Policy Framework 2024 (NPPF) and the Noise Policy Statement for England 2010 (NPSE). The purpose of this document is to include all aspects of environmental noise within assessments i.e. environmental noise, neighbour noise and neighbourhood noise. Noise is to be considered alongside other relevant issues relating to the site and should not be considered in isolation, according to the NPSE. There are several key phrases within the NPSE aims and these are discussed below.

2.3.1 “Significant adverse” and “adverse”

There are two established concepts from toxicology that are currently being applied to noise impacts, for example, by the World Health Organisation. They are:

2.3.2 NOEL – No Observed Effect Level

This is the level below which no effect can be detected. In simple terms, below this level, there is no detectable effect on health and quality of life due to the noise.

2.3.3 LOAEL – Lowest Observed Adverse Effect Level

This is the level above which adverse effects on health and quality of life can be detected.

Extending these concepts for the purpose of this NPSE leads to the concept of a significant observed adverse effect level.

2.3.4 SOAEL – Significant Observed Adverse Effect Level

This is the level above which significant adverse effects on health and quality of life occur.

It is not possible to have a single objective noise-based measure that defines SOAEL that is applicable to all sources of noise in all situations. Consequently, the SOAEL is likely to be different for different noise sources, for different receptors and at different times. It is acknowledged that further research is required to increase our understanding of what may constitute a significant adverse impact on health and quality of life from noise. However, not having specific SOAEL values in the NPSE provides the necessary policy flexibility until further evidence and suitable guidance is available.

Finally, assessments and references are to be made to the World Health Organisation Night Time Noise Guidance 2009.

3 EHO Comments

Wiltshire Council's Environmental Health Department have made the following comments that have been addressed within this report.

Noise

I am writing following review of the amended plans that have been submitted regarding PL/2024/03203. The amended plans constitute an extra section (17) in the Noise Impact Assessment. This section predicts a sound level for 20 staff movements and 5 delivery lorries over 'a day'. However, the assessment is challenging to understand. In acoustics the 24 hour day is usually split between a 16hr daytime 07:00 – 23:00 and 8hr night time 23:00 - 07:00 period. Section 17 states keg delivery and bin collections are likely to occur between 12:00 and 18:00 but staff movements between 10:00 and 00:00. It is not clear over what time period the 29dB at the façade of the proposed residential properties is calculated over. Is it an LAeq over a 24 hour day? Or are the lorry deliveries over 6 hours and the car journeys over 14 hours?

The longer duration you average these sound levels over the more the peak of the actual event will be evened out. The parameters of the modelled sound levels need to be provided. I also need to know what the actual sound levels at the bedroom window when staff leave at midnight? Using the equivalent continuous sound level sound over a time period is one of the ways of assessing the impact at noise but the actual sound level also needs to be considered, particularly if an infrequent sound level is spread over a long period of time.



During nighttime hours, sudden impulsive noises such as car doors slamming and engines revving can cause awakenings. Noise of this nature may also cause future residents to complain about noise and if they complain to the Council this department would have a duty to investigate.

As explained in my previous memo the reliance on closed windows to mitigate transport noise is not recommended and we have to leave it to the planning department to decide if the desirability of residential development on this plot outweighs the adverse impact of having to keep windows closed most of the time to mitigate noise. Noise from the hotel is no anonymous transport noise and it must be ensured that the noise impact is properly assessed and evidence provided so informed recommendation can be made to the planning department.

4 SITE LOCATION

4.1 Position of Site in Wider Area

The site is located in March. The dominant noise source is road traffic noise.

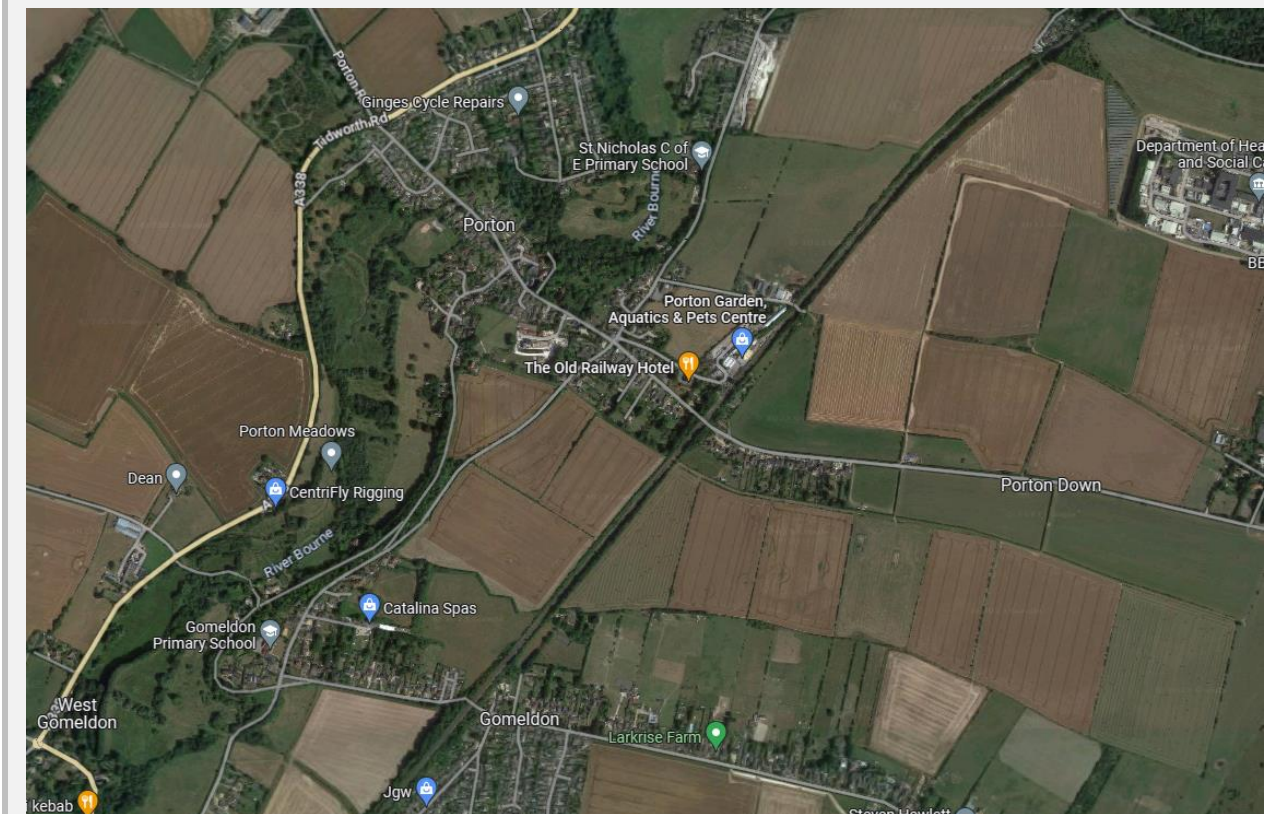
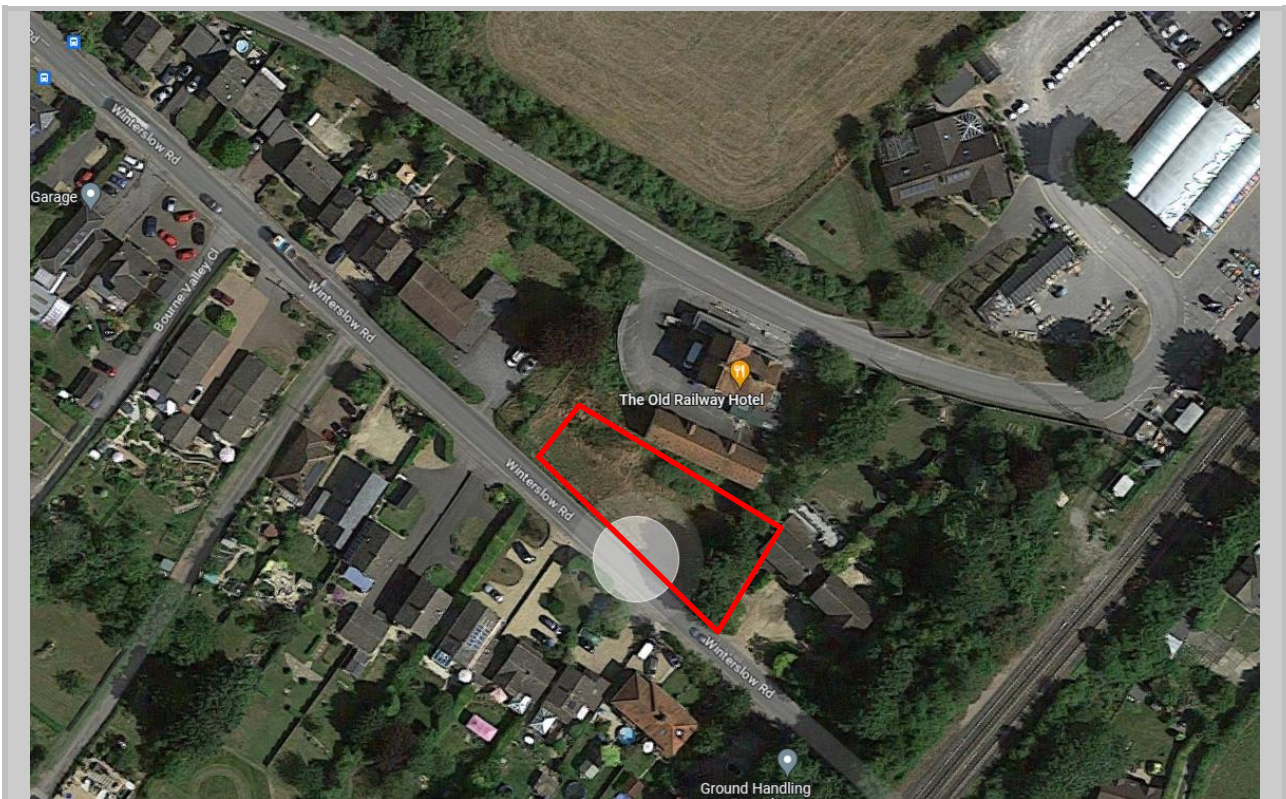


4.2 Proposed Development

The proposed development is shown below.



NOTES:
THIS DRAWING IS COPYRIGHT OF THE ARCHITECTS AND
MUST NOT BE USED WITHOUT THEIR PERMISSION. ALL
DIMENSIONS TO BE CHECKED ON SITE. DISCREPANCIES AND
OMISSIONS TO BE REPORTED IMMEDIATELY TO THE
ARCHITECT.

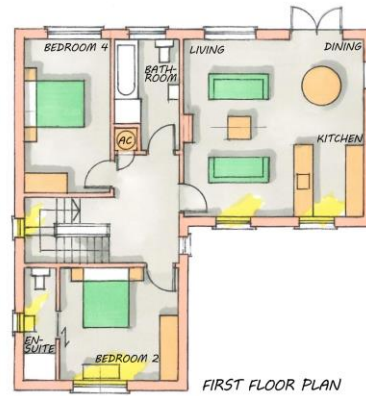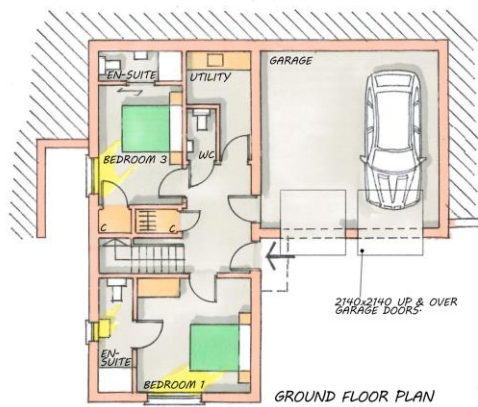


Scale 1:50 @ A1 - 1:100 @ A3

PLOT 1

REV A - DRAWINGS AMENDED TO COMMENTS - 03/10/23
DWG. NO. 20/3332/201 A

PROPOSAL FOR 3 NEW HOUSES TO REAR OF PORTON HOTEL, PORTON
PROPOSED PLOT 1 PLANS, SCALE 1:100 @ A3, © R.R.P.L, JULY 2023.

NOTES:
THIS DRAWING IS COPYRIGHT OF THE ARCHITECTS AND
MUST NOT BE USED WITHOUT THEIR PERMISSION. ALL
DIMENSIONS TO BE CHECKED ON SITE. DISCREPANCIES AND
OMISSIONS TO BE REPORTED IMMEDIATELY TO THE
ARCHITECT.

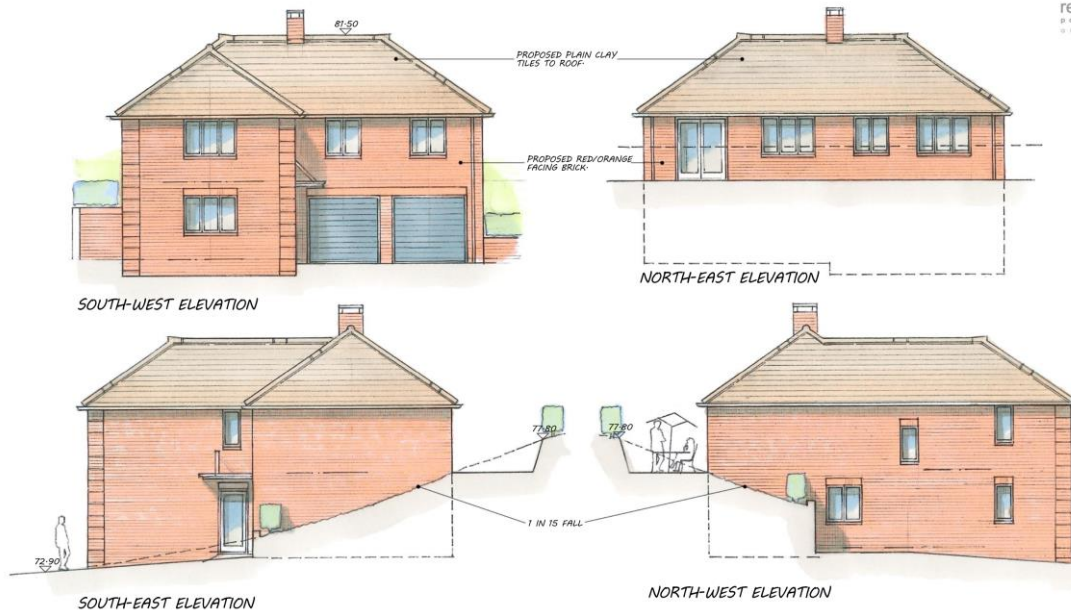



Scale 1:50 @ A1 - 1:100 @ A3

PLOT 1

DWG. NO. 20/3332/202

PROPOSAL FOR 3 NEW HOUSES TO REAR OF PORTON HOTEL, PORTON
PROPOSED PLOT 1 ELEVATIONS, SCALE 1:100 @ A3, © R.R.P.L, JULY 2023.

NOTES:
THIS DRAWING IS COPYRIGHT OF THE ARCHITECTS AND
MUST NOT BE USED WITHOUT THEIR PERMISSION. ALL
DIMENSIONS TO BE CHECKED ON SITE. DISCREPANCIES AND
OMISSIONS TO BE REPORTED IMMEDIATELY TO THE
ARCHITECT.

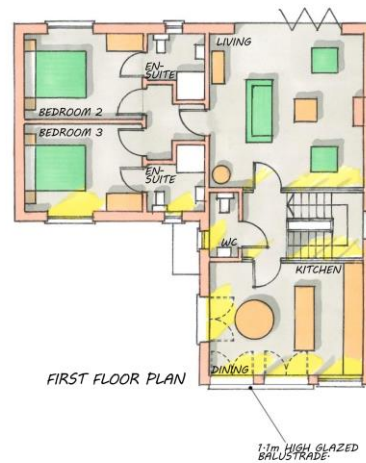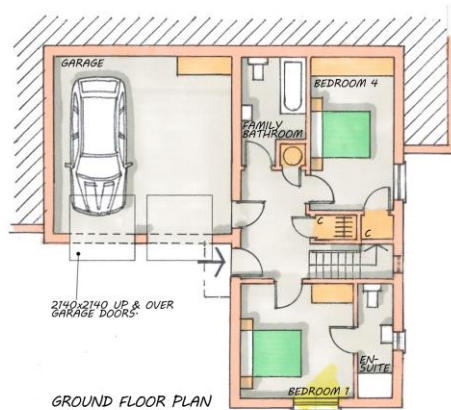


Scale 1:50 @ A1 - 1:100 @ A3

PLOT 2

REV A - DRAWINGS AMENDED TO COMMENTS - 03/10/23
DWG. NO. 20/3332/203 A

PROPOSAL FOR 3 NEW HOUSES TO REAR OF PORTON HOTEL, PORTON
PROPOSED PLOT 2 PLANS, SCALE 1:100 @ A3, © R.R.P.L, JULY 2023.

NOTES:
THIS DRAWING IS COPYRIGHT OF THE ARCHITECTS AND
MUST NOT BE USED WITHOUT THEIR PERMISSION. ALL
DIMENSIONS TO BE CHECKED ON SITE. DISCREPANCIES AND
OMISSIONS TO BE REPORTED IMMEDIATELY TO THE
ARCHITECT.

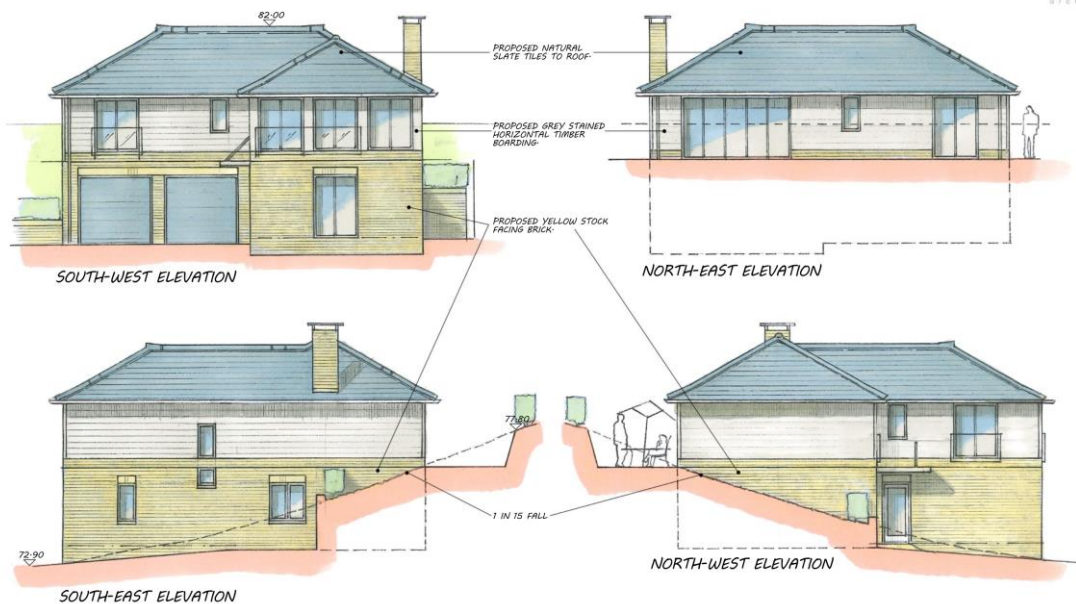



Scale 1:50 @ A1 - 1:100 @ A3

PLOT 2

DWG. NO. 20/3332/204

PROPOSAL FOR 3 NEW HOUSES TO REAR OF PORTON HOTEL, PORTON
PROPOSED PLOT 2 ELEVATIONS, SCALE 1:100 @ A3, © R.R.P.L, JULY 2023.

NOTES:
THIS DRAWING IS COPYRIGHT OF THE ARCHITECTS AND
MUST NOT BE USED WITHOUT THEIR PERMISSION. ALL
DIMENSIONS TO BE CHECKED ON SITE. DISCREPANCIES AND
OMISSIONS TO BE REPORTED IMMEDIATELY TO THE
ARCHITECT.

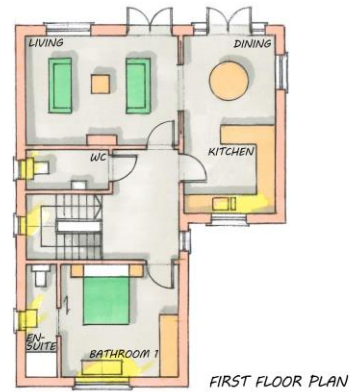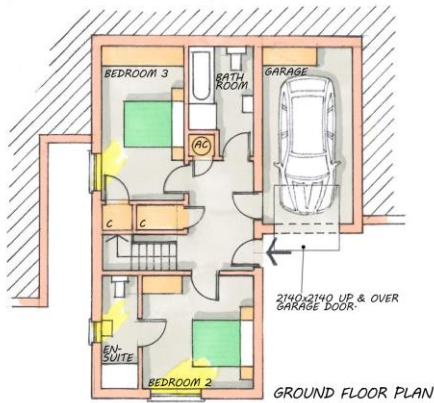


Scale 1:50 @ A1 - 1:100 @ A3

PLOT 3

REV A - DRAWING AMENDED TO COMMENTS - 03/10/23
DWG. NO. 20/3332/205 A

PROPOSAL FOR 3 NEW HOUSES TO REAR OF PORTON HOTEL, PORTON
PROPOSED PLOT 3 PLANS, SCALE 1:100 @ A3, © R.R.P.L, JULY 2023.

NOTES:
THIS DRAWING IS COPYRIGHT OF THE ARCHITECTS AND
MUST NOT BE USED WITHOUT THEIR PERMISSION. ALL
DIMENSIONS TO BE CHECKED ON SITE. DISCREPANCIES AND
OMISSIONS TO BE REPORTED IMMEDIATELY TO THE
ARCHITECT.

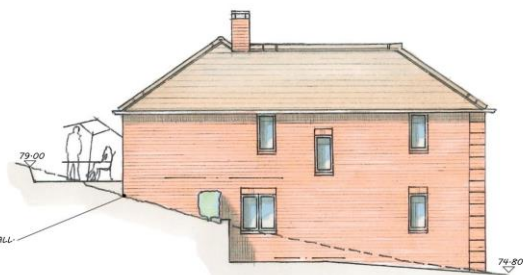

Scale 1:50 @ A1 - 1:100 @ A3

PLOT 3

DWG. NO. 20/3332/206

PROPOSAL FOR 3 NEW HOUSES TO REAR OF PORTON HOTEL, PORTON
PROPOSED PLOT 3 PLANS, SCALE 1:100 @ A3, © R.R.P.L, JULY 2023.

5 PROCEDURE

External noise levels were recorded over a typical period and analysis date extrapolated between 5th – 10th July 2023 at 2 positions as detailed within this report.

Position 1 was located at the front facade on the site in order to capture the noise levels associated with the local roads. Position 2 was located at the rear of the site in order to capture the background noise levels. Sample measurements were recorded over continuous 15 minute samples and from this data the hourly LAeq daytime values have been evaluated. Sound Pressure Levels were recorded on the following setting along with a full octave band frequency analysis measured simultaneously and between 31.5 Hz and 16.0 kHz.

<u>Daytime 07:00 – 23:00</u>		<u>Night Time 23:00 – 07:00</u>	
LAeq 1 HOUR dB	LA10 1 HOUR dB	LAeq 15 MINUTES dB	LA10 15 MINUTES dB
LAMAX 1 HOUR dB	LA50 1 HOUR dB	LAMAX 15 MINUTES dB	LA50 15 MINUTES dB
LAMIN 1 HOUR dB	LA90 1 HOUR dB	LAMIN 15 MINUTES dB	LA90 15 MINUTES dB

Calculations have been made in accordance with BS 8233: 2014 'Sound Insulation and Reduction of Buildings - Code of Practice'. Recommendations were made for any additional acoustics measures to conform to these standards.

From the downloaded recorded results, the daytime and night time periods were assessed and used within the above calculations as LAeq 16 HOUR dB levels for daytime and LAeq 8 HOUR dB levels for night time. These are detailed within this report. All data averaged throughout the day has been done so on a logarithmic basis to give accurate LAeq 16 Hour dB daytime and LAeq 8 Hour dB night time noise levels.

Finally, it should be noted that calculations are carried out with façade levels corrected from the recorded noise levels to the calculated façade levels.

6 APPARATUS

The equipment was calibrated using a sound pressure level of 114.0 dB at an octave band centre frequency of 1000Hz with reference to $2 \times 10^{-5} \text{ Nm}^{-2}$ before and after the tests and the equipment set to have no inaccuracy greater than 0.2dB.

All the following equipment was calibrated in accordance with the laboratory accreditation requirements of the United Kingdom Accreditation Service (UKAS) on the following dates.

6.1 Norsonic noise meter s/n 1402941 environmental testing – Position 1

Description	Make	Type	Serial No.	Calibration Intervals	Last Calibrated	Next Due Calibration
Integrated Sound Level Meter	Norsonic	140	1402941	2 YEARS	25.07.2022	25.07.2024
12.5mm Microphone (with windshield)	Norsonic	GRAS 40AF	179711	2 YEARS	25.07.2022	25.07.2024
Microphone Pre – Amplifier	Norsonic	1209	30479	2 YEARS	25.07.2022	25.07.2024

6.2 Norsonic noise meter s/n 1403140 environmental testing – Position 2

Description	Make	Type	Serial No.	Calibration Intervals	Last Calibrated	Next Due Calibration
Integrated Sound Level Meter	Norsonic	140	1403140	2 YEARS	06.04.2023	06.04.2025
12.5mm Microphone (with windshield)	Norsonic	1225	413206	2 YEARS	17.11.2023	17.11.2025
Microphone Pre – Amplifier	Norsonic	1209	12245	2 YEARS	06.04.2023	06.04.2025

Full calibration certificates are available upon request.

7 RESULTS

7.1 Position 1

7.1.1 07:00 – 07:00 5th – 6th July 2023

NOISE LEVEL SUMMARY ASSESSMENT				Octave Band Centre Frequency (Hz)								
Date / Time	LAeq	LAmaz	LA90	63	125	250	500	1.0k	2.0k	4.0k	8.0k	16.0k
DAYTIME 07:00 - 23:00 LA90 1 HOUR & Corresponding LAeq 1 HOUR	63.8	90.4	51.0	67.8	63.6	60.7	58.2	61.3	54.8	47.6	41.7	32.5
NIGHT TIME 23:00 - 07:00 LA90 15 MIN & Corresponding LAeq 15 MIN	54.0	87.7	21.0	57.6	53.1	49.8	47.8	51.3	45.3	38.2	38.5	25.9

7.1.2 07:00 – 07:00 6th – 7th July 2023

NOISE LEVEL SUMMARY ASSESSMENT				Octave Band Centre Frequency (Hz)								
Date / Time	LAeq	LAmaz	LA90	63	125	250	500	1.0k	2.0k	4.0k	8.0k	16.0k
DAYTIME 07:00 - 23:00 LA90 1 HOUR & Corresponding LAeq 1 HOUR	63.4	91.1	54.0	69.1	65.3	60.9	58.3	60.7	54.3	47.1	40.2	31.2
NIGHT TIME 23:00 - 07:00 LA90 15 MIN & Corresponding LAeq 15 MIN	54.1	90.6	21.0	56.9	53.1	53.8	48.3	50.5	46.2	42.1	33.6	24.5

7.1.3 07:00 – 07:00 7th – 8th July 2023

NOISE LEVEL SUMMARY ASSESSMENT				Octave Band Centre Frequency (Hz)								
Date / Time	LAeq	LAmaz	LA90	63	125	250	500	1.0k	2.0k	4.0k	8.0k	16.0k
DAYTIME 07:00 - 23:00 LA90 1 HOUR & Corresponding LAeq 1 HOUR	62.5	92.9	47.0	67.0	64.0	60.3	57.6	59.8	53.1	46.4	40.9	31.7
NIGHT TIME 23:00 - 07:00 LA90 15 MIN & Corresponding LAeq 15 MIN	54.3	96.0	28.0	53.8	51.8	52.2	53.4	50.0	45.1	39.6	33.1	18.6

7.1.4 07:00 – 07:00 8th – 9th July 2023

NOISE LEVEL SUMMARY ASSESSMENT				Octave Band Centre Frequency (Hz)								
Date / Time	LAeq	LAmaz	LA90	63	125	250	500	1.0k	2.0k	4.0k	8.0k	16.0k
DAYTIME 07:00 - 23:00 LA90 1 HOUR & Corresponding LAeq 1 HOUR	59.8	89.9	40.0	62.1	58.2	55.4	53.7	57.2	51.3	44.9	39.4	29.6
NIGHT TIME 23:00 - 07:00 LA90 15 MIN & Corresponding LAeq 15 MIN	51.7	87.4	24.0	51.3	48.2	46.6	45.0	49.2	44.0	35.8	29.6	16.4

7.1.5 07:00 – 07:00 9th – 10th July 2023

NOISE LEVEL SUMMARY ASSESSMENT				Octave Band Centre Frequency (Hz)								
Date / Time	LAeq	LAmaz	LA90	63	125	250	500	1.0k	2.0k	4.0k	8.0k	16.0k
DAYTIME 07:00 - 23:00 LA90 1 HOUR & Corresponding LAeq 1 HOUR	59.3	94.5	43.0	63.0	61.2	57.9	54.3	56.7	49.5	41.7	36.3	28.6
NIGHT TIME 23:00 - 07:00 LA90 15 MIN & Corresponding LAeq 15 MIN	53.8	92.3	22.0	56.2	53.1	52.1	48.2	50.5	46.0	39.0	33.3	17.2

7.2 Position 2

7.2.1 07:00 – 07:00 5th – 6th July 2023

NOISE LEVEL SUMMARY ASSESSMENT				Octave Band Centre Frequency (Hz)								
Date / Time	LAeq	LAmaz	LA90	63	125	250	500	1.0k	2.0k	4.0k	8.0k	16.0k
DAYTIME 07:00 - 23:00 LA90 1 HOUR & Corresponding LAeq 1 HOUR	55.3	89.4	48.0	60.9	54.2	51.1	50.1	52.0	47.2	43.4	38.8	25.5
NIGHT TIME 23:00 - 07:00 LA90 15 MIN & Corresponding LAeq 15 MIN	46.3	73.1	37.0	50.4	43.3	44.1	41.9	42.7	38.0	35.4	29.5	11.6

7.2.2 07:00 – 07:00 6th – 7th July 2023

NOISE LEVEL SUMMARY ASSESSMENT				Octave Band Centre Frequency (Hz)								
Date / Time	LAeq	LAmaz	LA90	63	125	250	500	1.0k	2.0k	4.0k	8.0k	16.0k
DAYTIME 07:00 - 23:00 LA90 1 HOUR & Corresponding LAeq 1 HOUR	54.6	89.6	47.0	60.9	54.5	50.3	49.7	51.5	46.4	42.0	37.3	24.1
NIGHT TIME 23:00 - 07:00 LA90 15 MIN & Corresponding LAeq 15 MIN	46.0	76.9	37.0	50.1	43.9	42.7	41.6	41.9	38.4	36.1	30.7	12.7

7.2.3 07:00 – 07:00 7th – 8th July 2023

NOISE LEVEL SUMMARY ASSESSMENT				Octave Band Centre Frequency (Hz)								
Date / Time	LAeq	LAmaz	LA90	63	125	250	500	1.0k	2.0k	4.0k	8.0k	16.0k
DAYTIME 07:00 - 23:00 LA90 1 HOUR & Corresponding LAeq 1 HOUR	54.0	81.2	47.0	60.0	54.0	50.0	49.2	50.6	45.5	43.2	36.7	31.4
NIGHT TIME 23:00 - 07:00 LA90 15 MIN & Corresponding LAeq 15 MIN	47.5	79.0	40.0	49.4	45.5	44.9	45.6	42.3	38.7	37.6	31.9	16.7

7.2.4 07:00 – 07:00 8th – 9th July 2023

NOISE LEVEL SUMMARY ASSESSMENT				Octave Band Centre Frequency (Hz)								
Date / Time	LAeq	LAmaz	LA90	63	125	250	500	1.0k	2.0k	4.0k	8.0k	16.0k
DAYTIME 07:00 - 23:00 LA90 1 HOUR & Corresponding LAeq 1 HOUR	52.9	88.6	45.0	58.2	51.9	48.4	47.9	48.9	45.3	43.1	38.8	26.2
NIGHT TIME 23:00 - 07:00 LA90 15 MIN & Corresponding LAeq 15 MIN	44.9	68.6	36.0	47.6	43.6	42.9	41.2	40.8	36.3	34.7	29.0	14.5

7.2.5 07:00 – 07:00 9th – 10th July 2023

NOISE LEVEL SUMMARY ASSESSMENT				Octave Band Centre Frequency (Hz)								
Date / Time	LAeq	LAmaz	LA90	63	125	250	500	1.0k	2.0k	4.0k	8.0k	16.0k
DAYTIME 07:00 - 23:00 LA90 1 HOUR & Corresponding LAeq 1 HOUR	52.1	78.4	47.0	58.3	53.5	49.1	47.2	48.4	43.8	41.2	36.0	24.4
NIGHT TIME 23:00 - 07:00 LA90 15 MIN & Corresponding LAeq 15 MIN	46.4	70.6	38.0	49.6	45.2	45.9	42.7	42.3	38.0	34.9	30.2	11.6

The following noise levels at position 1 have been corrected for the highest recorded façade levels and used within the BS8233: 2014 calculations.

NOISE LEVEL SUMMARY ASSESSMENT				Octave Band Centre Frequency (Hz)								
Date / Time	LAeq	LAmaz	LA90	63	125	250	500	1.0k	2.0k	4.0k	8.0k	16.0k
DAYTIME 07:00 - 23:00 LA90 1 HOUR & Corresponding LAeq 1 HOUR	63.8	90.4	51.0	67.8	63.6	60.7	58.2	61.3	54.8	47.6	41.7	32.5
NIGHT TIME 23:00 - 07:00 LA90 15 MIN & Corresponding LAeq 15 MIN	54.3	96.0	28.0	53.8	51.8	52.2	53.4	50.0	45.1	39.6	33.1	18.6

7.3 Summary of Results

A background noise survey was undertaken from 5th – 10th July 2023 at two positions to establish the underlying background noise levels. The recorded levels are as follows:-

Assessment Position	Date Start	Date Finish	Daytime LAeq (07:00-23:00)	Night Time LAeq (23:00-07:00)
Position 1	05.07.2023	10.07.2023	63.8	54.3
Position 2	05.07.2023	10.07.2023	55.3	47.5


Assessment Position	Date Start	Date Finish	Activity & Time Period	Background Noise Level LA90
Position 2	05.07.2023	10.07.2023	Daytime (07:00 – 23:00)	LA90 1 HOUR 47 dB
			External Patron (19:00 – 23:00)	LA90 1 HOUR 44 dB
			Lorry Movements (12:00 – 18:00)	LA90 1 HOUR 47dB
			Staff Leaving (23:45 – 00:00)	LA90 15 MINUTE 36 - 43 dB

8 PROPG PLANNING & NOISE STAGE 1

8.1 Stage 1: Initial Site Noise Risk Assessment

The Stage 1, Initial Noise Risk Assessment, compares the recorded ambient noise levels obtained from the acoustic survey and correlates these against the risk scale within the Pro PG Document in order to evaluate any potential adverse effects the site is currently exposed to with regards to noise.

The outcome of the Stage 1 assessment will determine the level of detail required within Stage 2 in order to demonstrate suitable mitigations can be introduced to ensure continuing compliance with the relevant standards, local planning policies and Pro PG. The following table demonstrates the Initial Risk Assessment Noise Levels as detailed within PROPG Figure.1:-

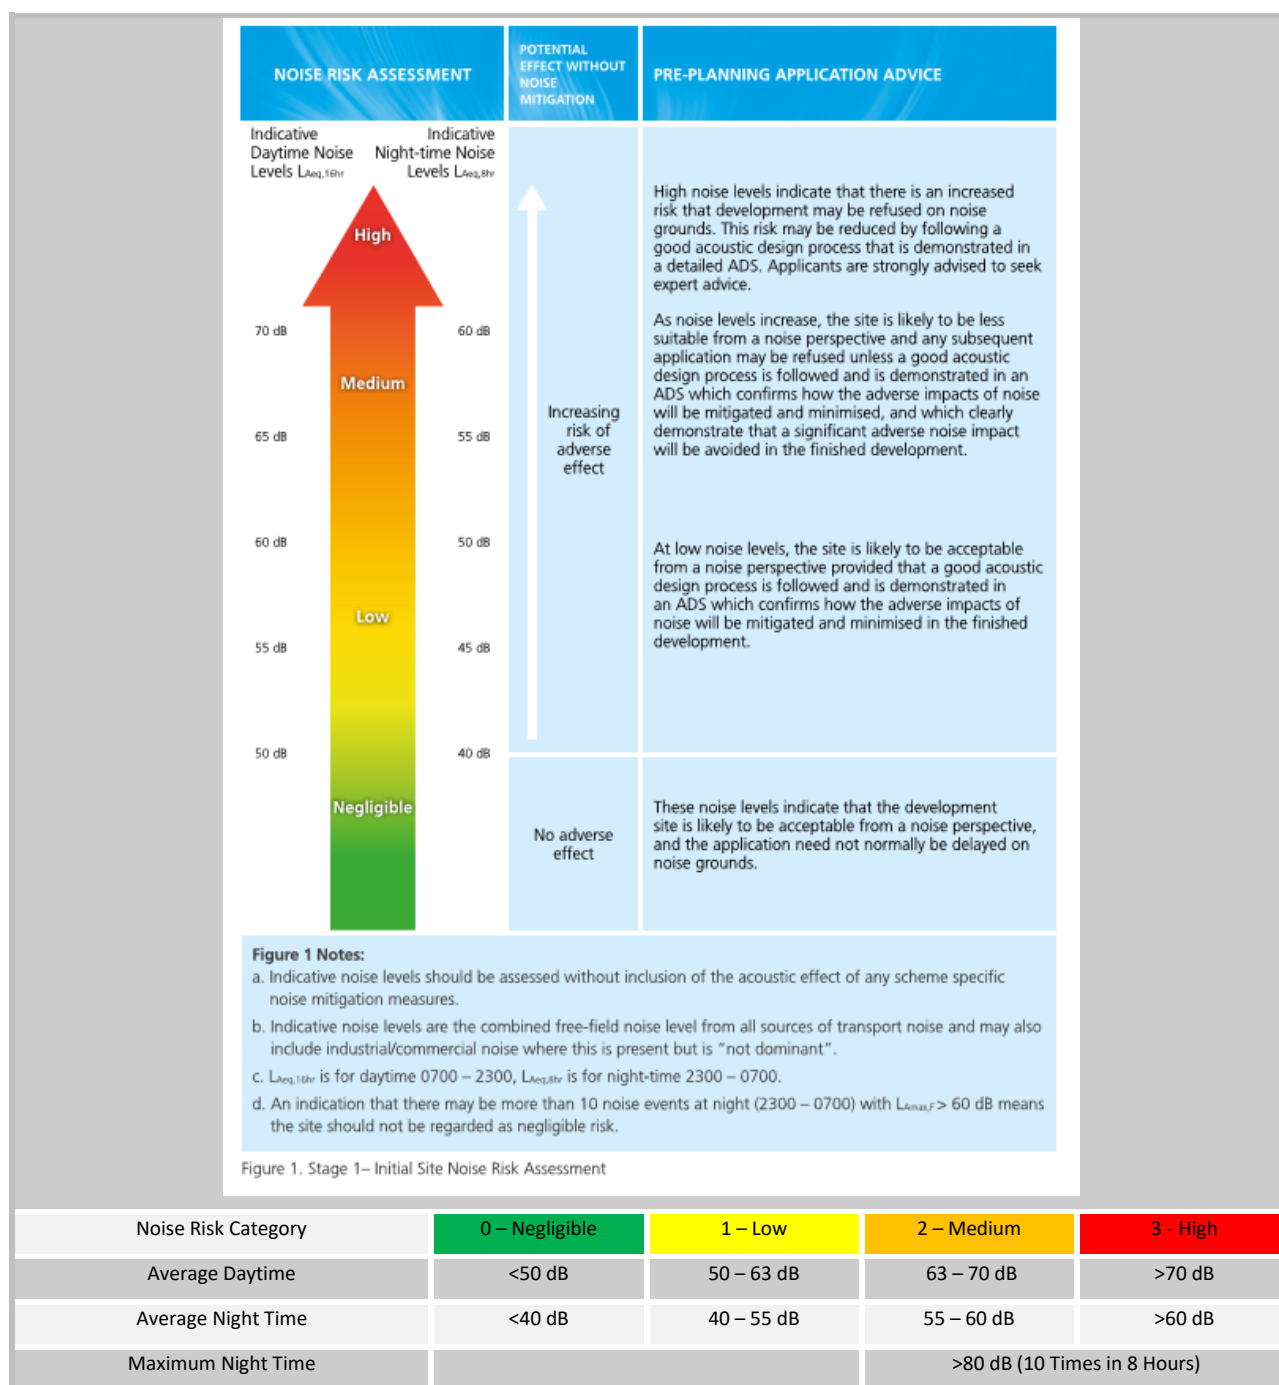

Based on the data collected from the aforementioned noise survey, the following PROPG Stage 1 assessments can be made:-

8.2 Potential Façade Noise Levels

8.2.1 Daytime (07:00-23:00)

Time Period	Highest Potential Façade Noise Level	Noise Risk Category 2 - Medium
Average Daytime (07:00-23:00)	$L_{Aeq, 16 \text{ HOUR}}$ 65 dB	64 - 70 dB

8.2.2 Night Time (23:00-07:00)

Time Period	Highest Potential Façade Noise Level	Noise Risk Category 1 - Low
Average Night Time (23:00-07:00)	$L_{Aeq, 16 \text{ HOUR}}$ 54 dB	40 - 55 dB
	Maximum (10 Times) – L_{Amax} 77.7 dB	>80 dB (10 Times in 8 Hours)

8.3 Risk Assessment

8.3.1 Daytime (07:00-23:00) – Position 1

Risk Assessment Category	Risk Assessment
2 - Medium	As noise levels increase, the site is likely to be less suitable from a noise perspective and any subsequent application may be refused unless a good acoustic design process is followed and is demonstrated in an ADS which confirms how the adverse impacts of noise will be mitigated and minimised, and which clearly demonstrate that a significant adverse noise impact will be avoided in the finished development.

8.3.2 Night Time (23:00-07:00) – Position 1

Risk Assessment Category	Risk Assessment
1 – Low	At low noise levels, the site is likely to be acceptable from a noise perspective provided that a good acoustic design process is followed and is demonstrated in an ADS which confirms how the adverse impacts of noise will be mitigated and minimised in the finished development.

The above table demonstrates this site is located within Noise Risk Category 2 for daytime and Category 1 for night time, which suggests further mitigation levels will be required at Stage 2 provided a good acoustic design process is followed.

9 PROPG PLANNING & NOISE STAGE 2 - ELEMENT 1 – GOOD ACOUSTIC DESIGN


Given the size and orientation of the proposed site, it is recommended that the developer adopt, where practically possible, a good acoustic design which should include careful consideration of the positioning of the proposed properties together with thoughts being taken as to internal layouts to minimise noise sensitive rooms facing onto dominant noise sources within the local areas.

10 ELEMENT 2 – INTERNAL NOISE LEVEL GUIDELINES


10.1 Discussion of Results

It can be seen from the attached graph and downloaded results that the external noise levels have followed the expected path and remained fairly constant throughout the day. The levels then gradually dropped off as the evening progressed and began to rise when morning traffic levels increased.


10.2 Existing Noise Levels – Daytime (07:00 – 23:00)

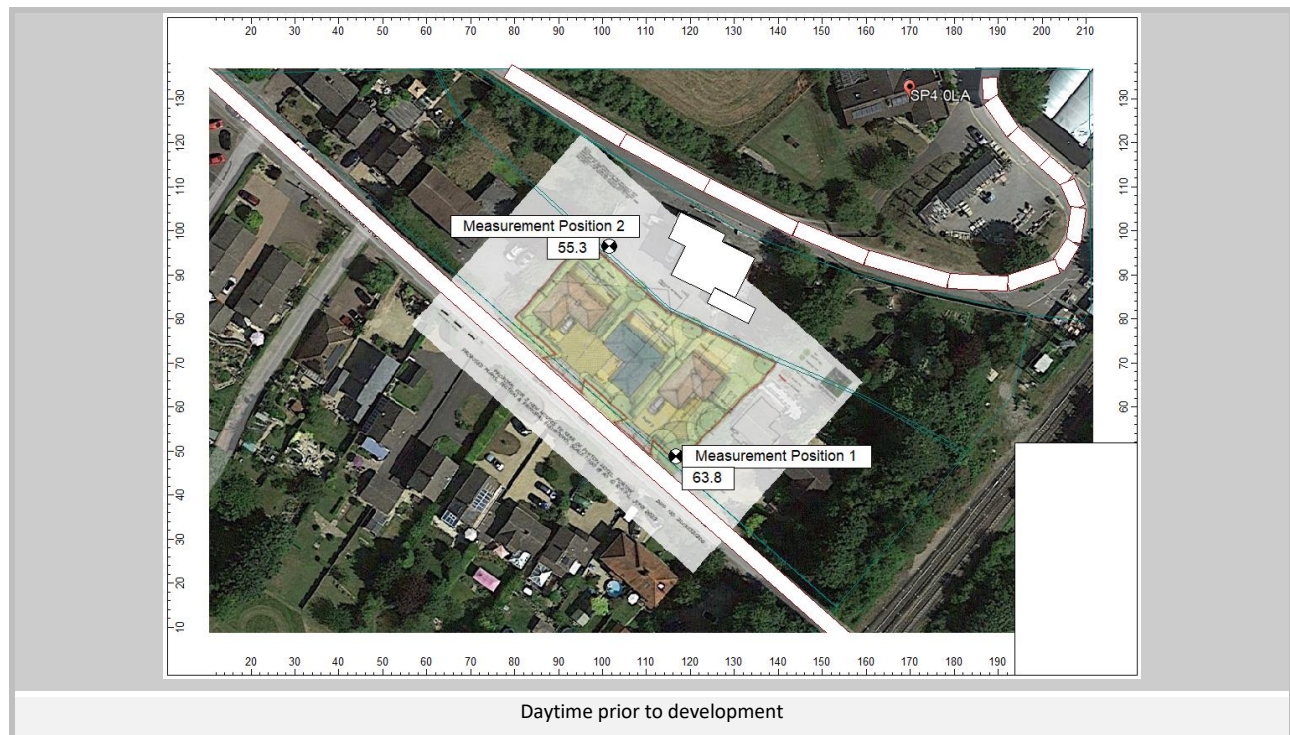

10.3 Existing Noise Levels – Night Time (23:00 – 07:00)

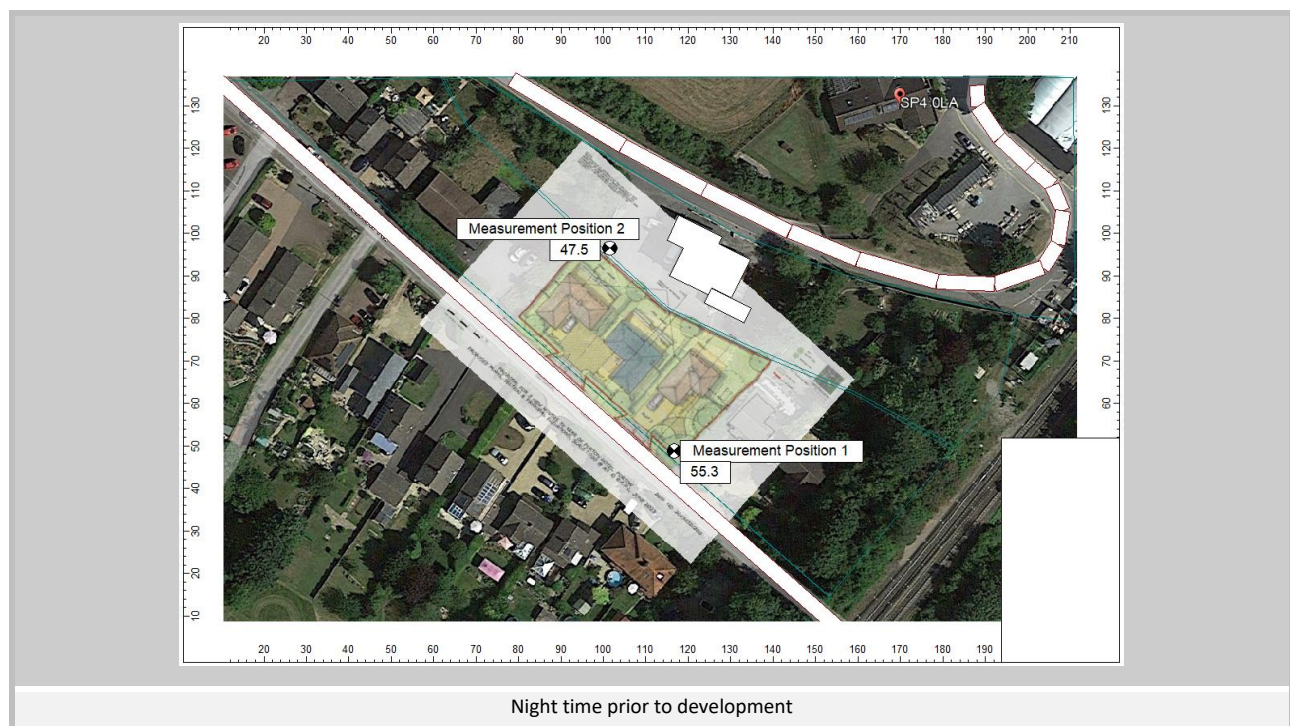

10.4 Proposed Noise levels – Daytime (07:00 – 23:00)

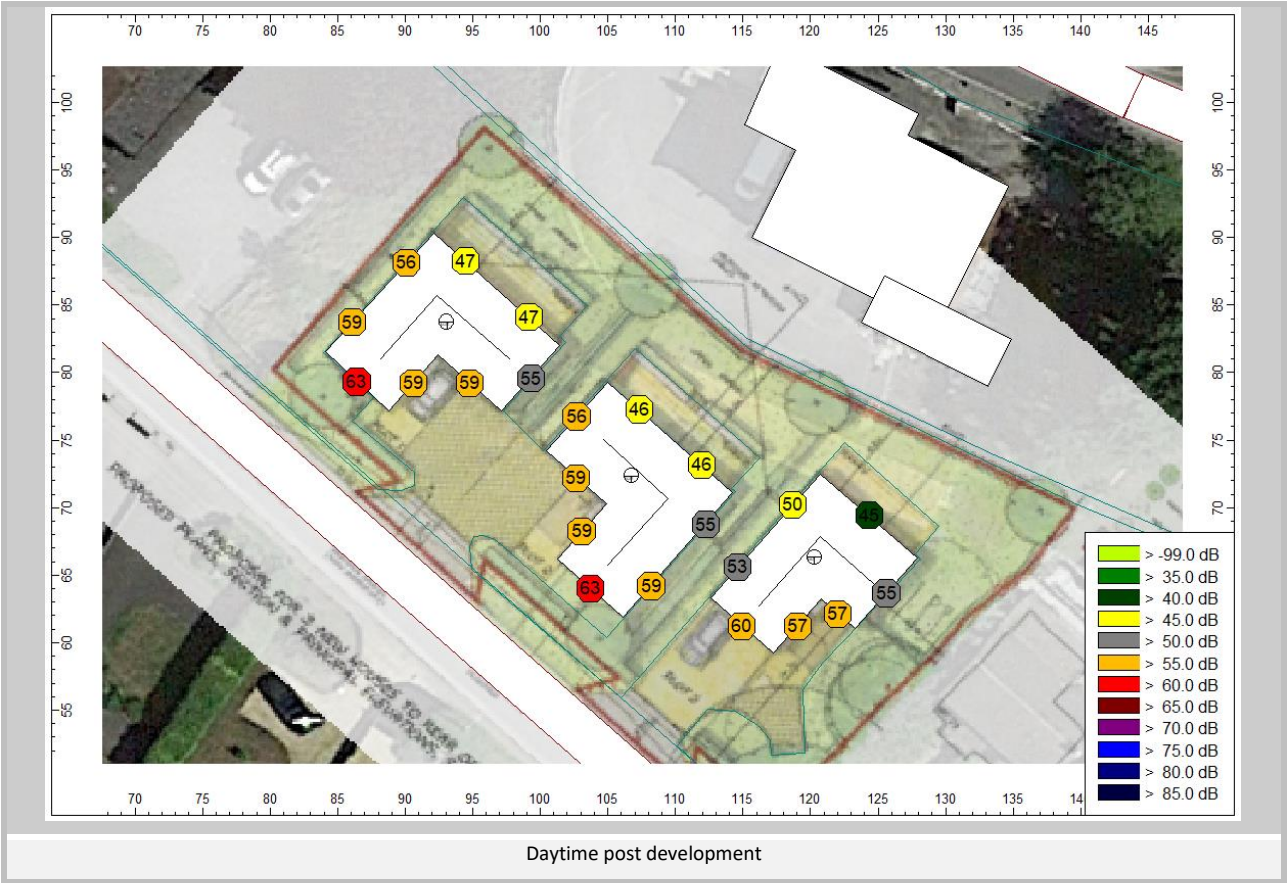

10.5 Proposed Noise levels – Night Time (23:00 – 07:00)



10.6 Recommendations

For the purpose of this assessment, the corresponding façade levels will be used within the BS 8233: 2014 calculations in order to evaluate the worst case scenario and select the correct window specification.

Therefore, in order to achieve the required noise levels of $L_{Aeq\ 16\ HOUR}$ 35 dB for habitable rooms daytime and $L_{Aeq\ 8\ HOUR}$ 30 dB for Bedroom at night within the proposed, the following additional acoustic measures have been calculated.

It should be noted that the calculations have been made with the proposed windows closed. Additional calculations were made for the top floor due to the influence of sound transmission into the various rooms via the roof / ceiling i.e. an increased impeding façade. Inputted levels into the calculation sheets have been corrected for distance attenuation and free field in accordance with the aforementioned British Standard.

10.7 Calculation Procedure to BS 8233: 2014

The following calculations have been carried out in order to determine the required window and ventilation specification in order to meet the requirements of BS 8233: 2014.

10.8 Ground Floor Lounge

Recorded Site Data (Corrected for Free Field)	Octave Band Centre Frequency (Hz)					
	125	250	500	1000	2000	4000
Daytime Leqff	63.6	60.7	58.2	61.3	54.8	47.6
Night time Leqff	51.8	52.2	53.4	50.0	45.1	39.6
Room Data	Sf	Sr	Swi	Sew	Srr	Volume
Area m²	9	0	2.4	6.6	0	35
Specification Summary	Site Specific Specification			Attenuation Required		
Glazing Specification	6mm / (6-16mm) / 4mm			Rw(C; Ctr)	32(-2,-4) dB	
Ventilation Strategy	MVHR			Dne'w	54 dB	
Wall Specification	Brick & Block Cavity Wall			Rw	54 dB	
Roof Specification	Standard Pitched Roof			Rw	57 dB	
Calculation Results						
Daytime Hours (07:00-23:00)			L _{Aeq} 16 HOUR	30.5	dB(A)	
Night Time Hours (23:00-07:00)			L _{Aeq} 8 HOUR	22.7	dB(A)	
Formula	$Leq2=Leqff+10\log[A0/S*10^{(-Dne/10)}+Swi/S*10^{(-Rwi/10)}+Sew/10*10^{(-Rew/10)}+Srr/S*10^{(-Rrr/10)}]+10\log(S/A)+3$					
Note	The expected precision of this calculation is ±2 dB.					

10.9 Top Floor Bedroom

Recorded Site Data (Corrected for Free Field)	Octave Band Centre Frequency (Hz)					
	125	250	500	1000	2000	4000
Daytime Leqff	63.6	60.7	58.2	61.3	54.8	47.6
Night time Leqff	51.8	52.2	53.4	50.0	45.1	39.6
Room Data	Sf	Sr	Swi	Sew	Srr	Volume
Area m²	7	12	1.2	5.8	12	25
Specification Summary	Site Specific Specification			Attenuation Required		
Glazing Specification	6mm / (6-16mm) / 4mm			Rw(C; Ctr)		32(-2,-4) dB
Ventilation Strategy	MVHR			Dne'w		54 dB
Wall Specification	Brick & Block Cavity Wall			Rw		54 dB
Roof Specification	Standard Pitched Roof			Rw		57 dB
Calculation Results						
Daytime Hours (07:00-23:00)			L _{Aeq} 16 HOUR	28.0		dB(A)
Night Time Hours (23:00-07:00)			L _{Aeq} 8 HOUR	20.1		dB(A)
Formula	$Leq2=Leqff+10\log[A0/S*10^{(-Dne/10)}+Swi/S*10^{(-Rwi/10)}+Sew/10*10^{(-Rew/10)}+Srr/S*10^{(-Rrr/10)}]+10\log(S/A)+3$					
Note	The expected precision of this calculation is ±2 dB.					

10.10 Glazing (R_{wi})

Octave Band Frequency	125	250	500	1000	2000	4000	Rw dB
6mm glass / 16mm air gap / 4mm glass	21.0	20.0	26.0	38.0	37.0	39.0	32 (-2,-4)

10.11 Walls (R_{ew})

Octave Band Frequency	125	250	500	1000	2000	4000	Rw dB
Brick and Concrete Block	40.0	44.0	45.0	51.0	56.0	56.0	50.0

10.12 Roof (R_{rr})

Octave Band Frequency	125	250	500	1000	2000	4000	Rw dB
Standard Roof	39.0	48.0	55.0	60.0	59.0	61.0	57.0

The above are minimum construction attenuation values and should alternative methods be selected; these should be equal to or greater than the above corresponding values. Calculations carried out have indicated the following specifications should be installed for this site.

10.13 Glazing & Ventilation Assessment

The development should be designed with a 6mm glass / 16mm Air Gap / 4mm glass and MVHR System to all room to ensure the internal noise levels are acceptable in terms of the assessment to British Standard 8233: 2014.

11 OVERHEATING

With regards to potential overheating at the proposed development and any TM59 assessment that may be required for this site, we would like to confirm that having opening windows to dissipate excessive summer heat vs the internal acoustics is always a fine balancing act. With regards to the internal acoustic criteria of Daytime LAeq 16 HOUR 35 dB and Night Time LAeq 8 HOUR 30 dB, this is a planning requirement under BS 8233: 2014 to which this report and calculations have been carried out to and is based on. This assessment has detailed the glazing and ventilation requirements required in order to achieve these criteria based on the assumption that the windows are closed.

References and assessments are to be made to the Association of Noise Consultants 'Acoustic Ventilation & Overheating – Residential Design Guide' 2020. The calculations carried out within this report have identified an acoustic requirement for System 1 & 2 and therefore guidelines values from Table 4 of BS 8233: 2014 are to be adopted.

This document takes a Level 1 and Level 2 approach to an acoustic overheating assessment and depending on the outcome of Level 1, further determines the need or necessity for a Level 2 assessment.

Table 3.1 'Indoor Ambient Noise Levels resulting from transport noise sources – ADF ventilation condition'

Ventilation condition	Operational condition of System	Desirable internal ambient noise level from transport noise sources
Part F - Whole dwelling ventilation	Systems 1 & 2: Background ('trickle') ventilators open to provide whole dwelling ventilation in the winter period. Additional ventilation required at other times of the year – windows are assumed to be ajar for assessment ^[Note 2] .	Guideline values from Table 4 of BS 8233:2014.
	System 3: Continuous mechanical extract with background ('trickle') ventilators open ^[Note 2] .	
	System 4: Continuous mechanical supply and extract with heat recovery (MVHR) – no trickle vents required.	
Part F – Purge Ventilation ^[Note 1]	Option 1: Opening external window(s) meeting requirements described in Appendix B of Part F.	No specific acoustic criterion needs to be met in a room using purge ventilation for the purpose of rapidly diluting indoor pollutants.
	Option 2: Manually controlled fan extracting 4 air changes per hour.	

Figure 3.2, detailed below has identified a 'Medium Risk' based on the calculated façade levels of the proposed development.

Figure 3.2 Guidance for Level 1 site risk assessment of noise from transport noise sources relating to overheating condition


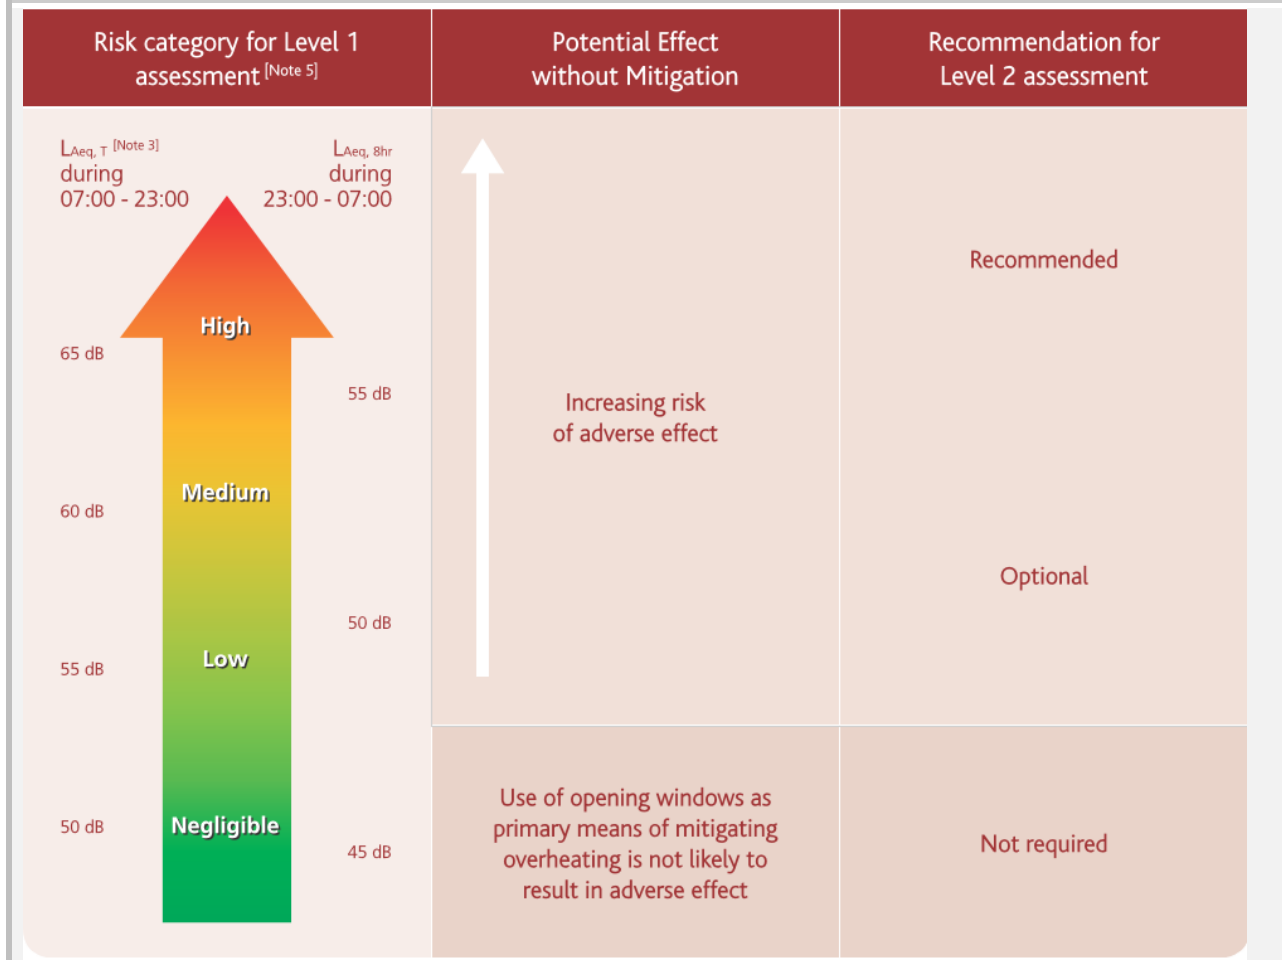


Figure 3.1, detailed below suggests a Level 2 Assessment to be optional and given that this is a small single dwelling development, an assessment of 'Negligible Risk 'Level 2 not required' has been concluded and should be adopted.

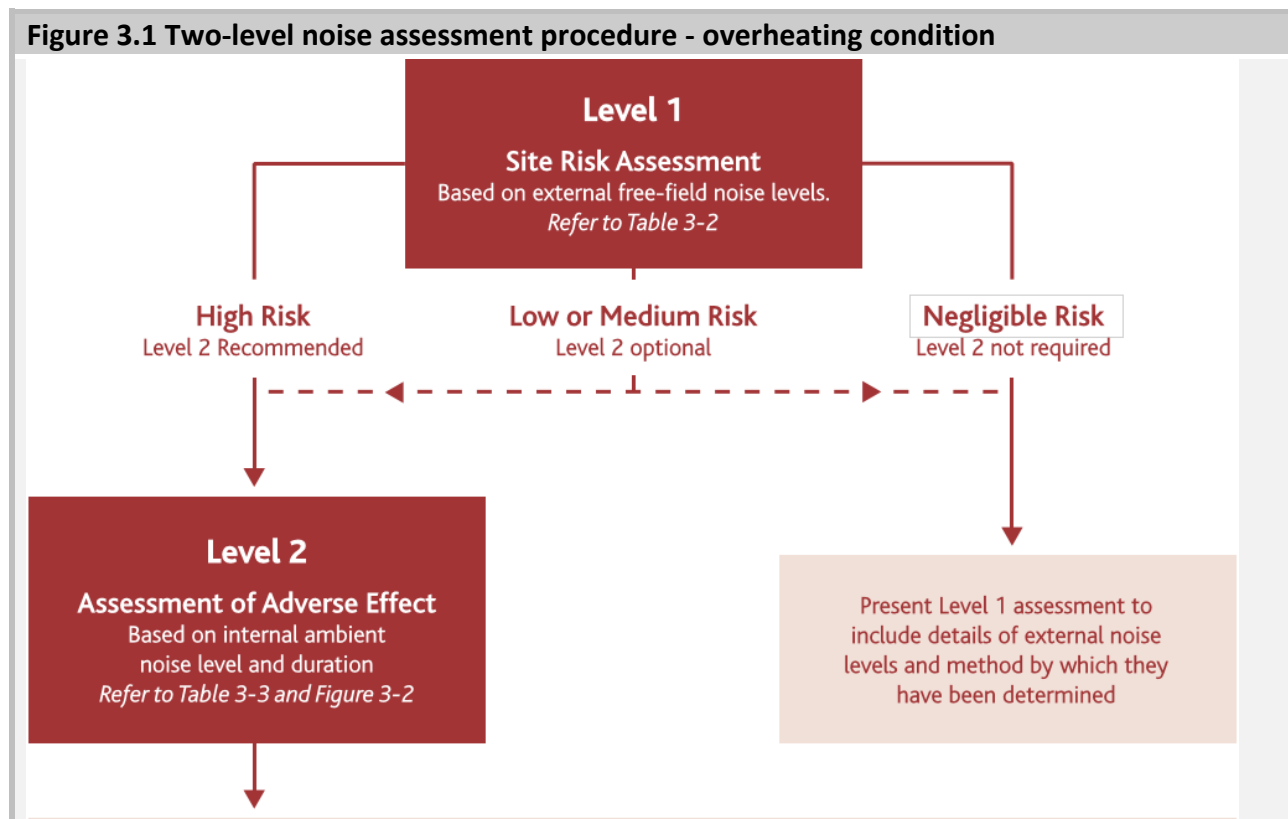

Based on the above assessments, it is the concluded that a detailed TM59 assessment is not required for this site.

12 LA_{max} dB NOISE LEVEL ASSESSMENT

12.1 Criteria

12.1.1 Night Noise Guidelines Europe 2009

The Night Noise Guidelines 2009 make direct reference to the World Health Organisations Guidelines for Community Noise 1999 with recommended guideline criteria of L_{Aeq} 30 dB indoors for continuous noise. The document goes on to explain that sleep disturbance correlates best with L_{Amax} and effects have been observed at 45 dB or less. This is particularly true if the background noise level is low. Noise events exceeding 45 dB(A) should therefore be limited.

12.1.2 Professional Practice Guidance on Planning & Noise.

PRoPG: Planning and Noise Appendix A 'Dealing with Noise Events' A.17 states that:-

Various studies have linked the L_{Amax} from individual noise events to behavioural awakenings. For example one study found that the "Probability of sleep stage changes to wake/S1 from railway noise increased significantly from 6.5% at 35 dB(A) to 20.5% at 80 dB(A) $L_{Amax,F}$ whilst another study concluded that "noise disturbance of sleep may be expected to become significant once the outdoor L_{Aeq} exceeds 55 dB provided peak noise levels do not exceed 75 to 80 dB. Higher L_{Aeq} values up to 60 dB may be allowed providing the peak levels do not exceed 85 dB, and the number of such events is less than about 20 per night". Based on these studies it can be concluded that at night (2300 - 0700 hrs) a significant effect on sleep disturbance e.g. behavioural awakening, is likely to occur where the maximum sound level at the façade of a building with partially open windows is above:

85 dB $L_{Amax,F}$ (where the number of events exceeding this value is ≤ 20); or

80 dB $L_{Amax,F}$ (where the number of events exceeding this value is > 20).

Pro PG: Planning and Noise Appendix A 'Dealing with Noise Events' A.18 goes on to explain that the main body of sleep research is consistent with a careful interpretation of the viewpoint set out in the World Health Organisation Guidelines which for the ordinary population is that:

- *Impacts on sleep can be detected from relatively low level maximum noise events, however the degree of resulting harm may not be significant.*
- *'Effects' on sleep (such as EEG awakenings and sleep stage changes) occur spontaneously in the general population many times per night regardless of any impacts due to noise.*
- *The smaller the number of noise events, the louder the maximum noise level that can be tolerated without adverse effects upon sleep; subject to an upper limit.*
- *At relatively low levels e.g. around 45 dB $L_{Amax,F}$ when sufficient number of such events take place during the night the adverse effects of individual noise events are likely to be limited to sleep disturbance in the form of changes in sleep state or perhaps some EEG awakenings.*
- *It normally requires noise levels higher than 45 dB $L_{Amax,F}$ before significant adverse effects such as behavioural awakenings, difficulty getting to sleep, premature awakening or difficulty getting back to sleep generally occur and the latest field research on and aircraft noise suggest that it requires internal L_{Amax} noise levels of around 65 dB before noise induced awakenings become distinguishable from spontaneous awakenings).*

12.1.3 World Health Organisations 'Guidelines for Community Noise'.

The WHO Guideline for Community Noise suggests that levels of L_{AFmax} 45 dB should not exceed more than 10 events within any one night time period 23:00 – 07:00. Therefore, calculations and assessments are to be made against these criteria to ascertain if the proposed glazing and ventilation specification will be suitable to achieve that of the assessed 11th highest recorded L_{AFmax} dB level.

LAFmax dB Noise Levels >80 dB						LAFmax dB Noise Levels >85 dB					
LAFmax dB	87.7	90.6	96.0	87.4	92.3	LAFmax dB	87.7	90.6	96.0	87.4	92.3
Time	Fig 1	Fig 2	Fig 3	Fig 4	Fig 5	Time	Fig 1	Fig 2	Fig 3	Fig 4	Fig 5
	5	9	7	5	6		2	3	2	1	3

12.1.4 LAFmax dB Noise Levels – Night Time 23:00 – 07:00 (1 Minute Data)

1 Minute Event No.	Recorded L_{AFmax} dB Noise Levels	Façade Corrected L_{AFmax} dB Noise Levels
1	96.0	96.0
2	86.1	86.1
3	84.9	84.9
4	84.6	84.6
5	81.7	81.7
6	80.6	80.6
7	80.2	80.2
8	78.5	78.5
9	77.8	77.8
10	77.7	77.7
11	77.7	77.7

The following table demonstrate the results and the evaluated 11th highest L_{Amax} dB level. With the proposed glazing and ventilation strategies implemented on this site, the following calculated internal levels have been evaluated accordingly:-

Item		Night Time (23:00-07:00)	Description
1	Recorded External Noise Level	54.3	Recorded Noise Level at the Monitoring Position
2	Calculated Highest Façade Level	54.3	Highest recorded façade level of the proposed development closest to the above associated monitoring position.
3	Façade Correction	0.0	Difference between Recorded and Calculated (Item 1 and 2)
4	Calculated Façade Attenuation	-34.2	Calculated façade attenuation taken from the highest recorded LAeq 8 HOUR dB night time noise level, minus the highest calculated internal noise level taken from the BS 8233 calculations.
5	L_{Amax} 45 dB Criteria	45.0	L_{Amax} 45 dB Criteria taken from WHO Guidelines. BS 8233 does not reference L_{Amax} dB noise level criteria.
6	Calculated Façade Level Outside	79.2	Addition of Items 4 and 5 to give a resultant target level for the 11th Recorded L_{Amax}
7	11 th Recorded L_{Amax}	77.7	11th Recorded L_{Amax}
8	L_{Amax} Criteria Achieved	YES	If Item 7 is less than 6, then the site is likely to be compliant. If not, further calculations are required

The above table demonstrates that the upgraded glazing and ventilation will result in the internal L_{Amax} 45 dB criteria being achieved.

13 ELEMENT 3 – EXTERNAL AMENITY AREA NOISE ASSESSMENT

13.1 Outdoor Living Areas


The World Health Organisation ‘Guidelines for Community Noise gives guidance as to desirable noise levels that should be achieved within outdoor living areas such as gardens, patios and verandas etc.

Table 1: Guideline values for community noise in specific environments, details the desirable target noise levels within various areas.

Outdoor Living Area	
Serious Annoyance, daytime and evening	L _{Aeq} 16 HOUR 55 dB
Moderate Annoyance, daytime and evening	L _{Aeq} 16 HOUR 50 dB

In order to evaluate the external noise levels within the proposed development, and to correctly and accurately select the precise required minimum screen heights, the 3D modelling software CADNA A is to be used. Initially, the site plan is to be overlaid onto Google Earth and then imported directly into CADNA A using the geometric co-ordinates.

From this, the monitoring positions and noise sources such as roads are added. The output noise levels from the roads are then increased until the monitored noise levels are achieved at the monitoring position. This model is then saved and used as a working 3D acoustic model of the site. The proposed buildings are then constructed on a 3D bases and receptors placed within the terrace garden areas. The calculation software is then run to evaluate the garden levels within sample plots across the development. The following CADNA A screen shots demonstrate the existing sites working 3D model. The levels at the measurement position correlate with the measured daytime average levels detailed within this report.

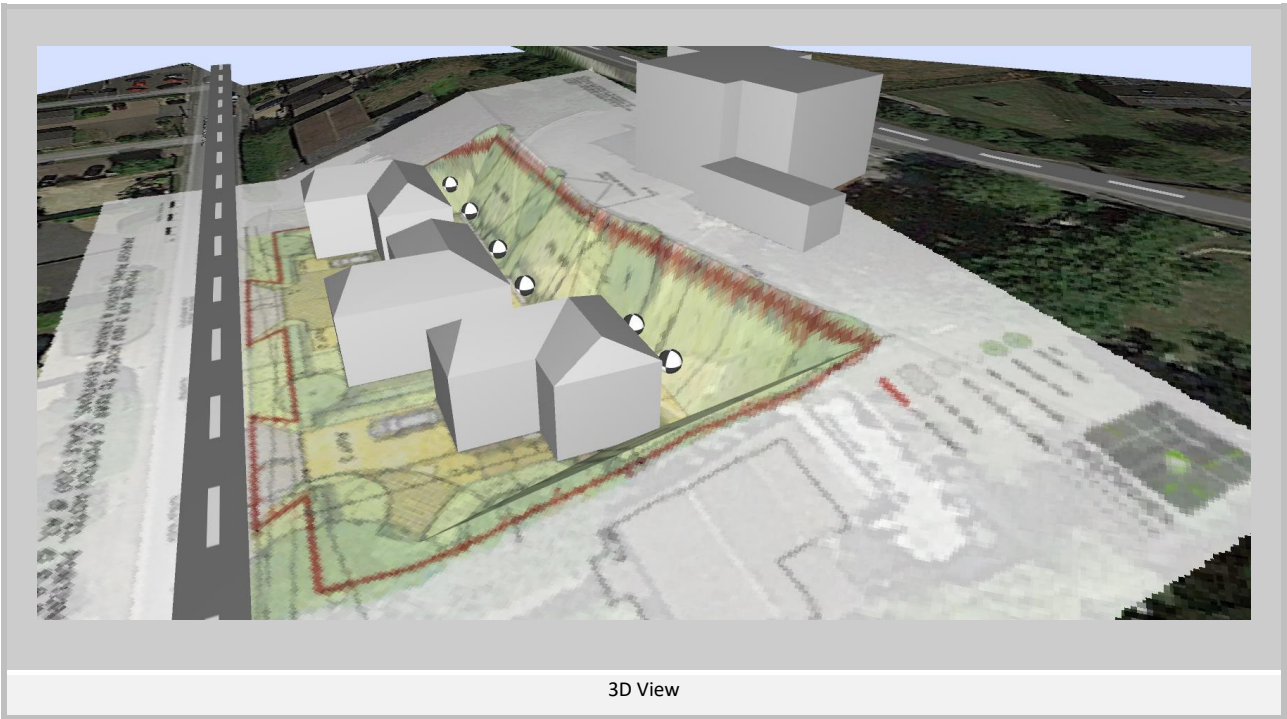

The development has external living areas on the development and therefore this criteria / guideline would be appropriately considered within the proposed rear residential garden areas.



The guideline has been considered acceptable criteria for this assessment given the sites geographical location and proximity to a major trunk road and railway line. The layout has been in order to allow for acoustics and minimise the noise levels within these outdoor living spaces. The calculation demonstrates the external living spaces are likely to see noise levels below the lower guideline of 50 dB.

BS8233: 2014 states the following:

'For traditional external areas that are used for amenity space, such as gardens and patios, it is desirable that the external noise level does not exceed 50 dB LAeq,T, with an upper guideline value of 55 dB LAeq,T which would be acceptable in noisier environments. However, it is also recognized that these guideline values are not achievable in all circumstances where development might be desirable. In higher noise areas, such as city centres or urban areas adjoining the strategic transport network, a compromise between elevated noise levels and other factors, such as the convenience of living in these locations or making efficient use of land resources to ensure development needs can be met, might be warranted. In such a situation, development should be designed to achieve the lowest practicable levels in these external amenity spaces, but should not be prohibited'

PRoPG: Planning and Noise goes on to state the following with regards to external amenity space:-

Paragraph 2.47

PPG- Noise states: *“If amenity spaces are an intrinsic part of the overall design, the acoustic environment of these spaces should be considered so that they can be enjoyed as intended”.*

Paragraph 2.48

It is noted that both documents require a decision to be made regarding whether or not an external amenity area (or amenity space) is intrinsic to the required design for acoustic, or for other reasons. However, the advice in BS 8233: 2014 states that the resulting noise levels outside are never a reason for refusal as long as levels are designed to be as low as practicable. Whereas, to comply with policy guidance any amenity space must have an acoustic environment so that it can be enjoyed as intended.

Element 3 – External Amenity Space

Paragraph 3 (iii)

These guideline values may not be achievable in all circumstance where development might be desirable. In such situations, development should be designed to achieve the lowest practicable noise levels in these external amenity spaces.

The Noise Policy Statement for England (NPSE) also states that:-

Paragraph 2.3

Furthermore, the broad aim of noise management has been to separate noise sources from sensitive noise receptors and to minimise noise. Of course, taken in isolation and to a literal extreme, noise minimisation would mean no noise at all. In reality, although it has not always been stated, the aim has tended to be to minimise noise ‘as far as reasonably practical’. The concept can be found in the Environmental Protection Act 1990, where, in some circumstances, there is a defence of ‘best practicable means’ in summary statutory nuisance proceedings.

Paragraph 2.7

In addition, the application of the NPSE should enable noise to be considered alongside other relevant issues and not to be considered in isolation. In the past, the wider benefits of a practical policy, development or other activity may not have been given adequate weight when assessing the noise implications.

Paragraph 2.22

It is not possible to have a single objective noise-based measure that defines SOAEL that is applicable to all sources of noise in all situations. Consequently, the SOAEL is likely to be different for different noise sources, for different receptors and at different times. It is acknowledged that further research is required to increase our understanding of what may constitute a significant adverse impact on health and quality of life from noise. However, not having a specific SOAEL value in the NPSE provides the necessary policy flexibility until further evidence and suitable guidance is available.

In summary, the external living spaces have been reduced by the location of the proposed bund with screen on top to as low as is reasonably practicable and therefore in accordance with the guidance set out above, planning permission should not be refused and external noise should not be considered in isolation.

14 CALCULATIONS

14.1 Kitchen Extract

The kitchen extract is located at the rear of the premises as is shielded by existing structures at the public house. The kitchen extract only operates during daytime hours.


14.2 Existing Noise Levels

The following noise levels have been recorded 1.0m from the unit.

NOISE LEVEL SUMMARY ASSESSMENT		Octave Band Centre Frequency (Hz)							
Measurement	L _{Aeq}	63	125	250	500	1.0k	2.0k	4.0k	8.0k
Sound Pressure Level @ 1m	71.0	75.1	72.6	66.5	64.9	65.8	65.4	60.4	53.9
Sound Power Level	82.0	86.1	83.6	77.5	75.9	76.8	76.4	71.4	64.9

14.3 Inputted Noise Levels

The above sound power levels have been inputted into the CADNA A software

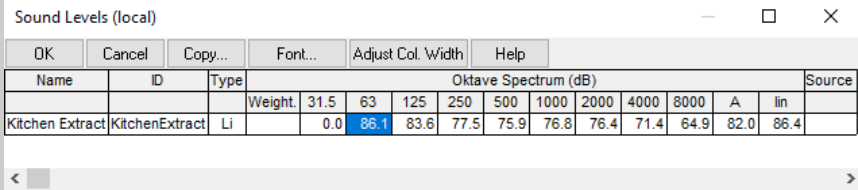


Name	ID	Type	Weight	31.5	63	125	250	500	1000	2000	4000	8000	A	lin	Source
Kitchen Extract	KitchenExtract	LI	0.0	86.1	83.6	77.5	75.9	76.8	76.4	71.4	64.9	82.0	86.4		

INPUTTED NOISE LEVELS

14.4 Calculated Façade Levels

Based on the above inputted noise levels, the following calculated façade levels have been evaluated.

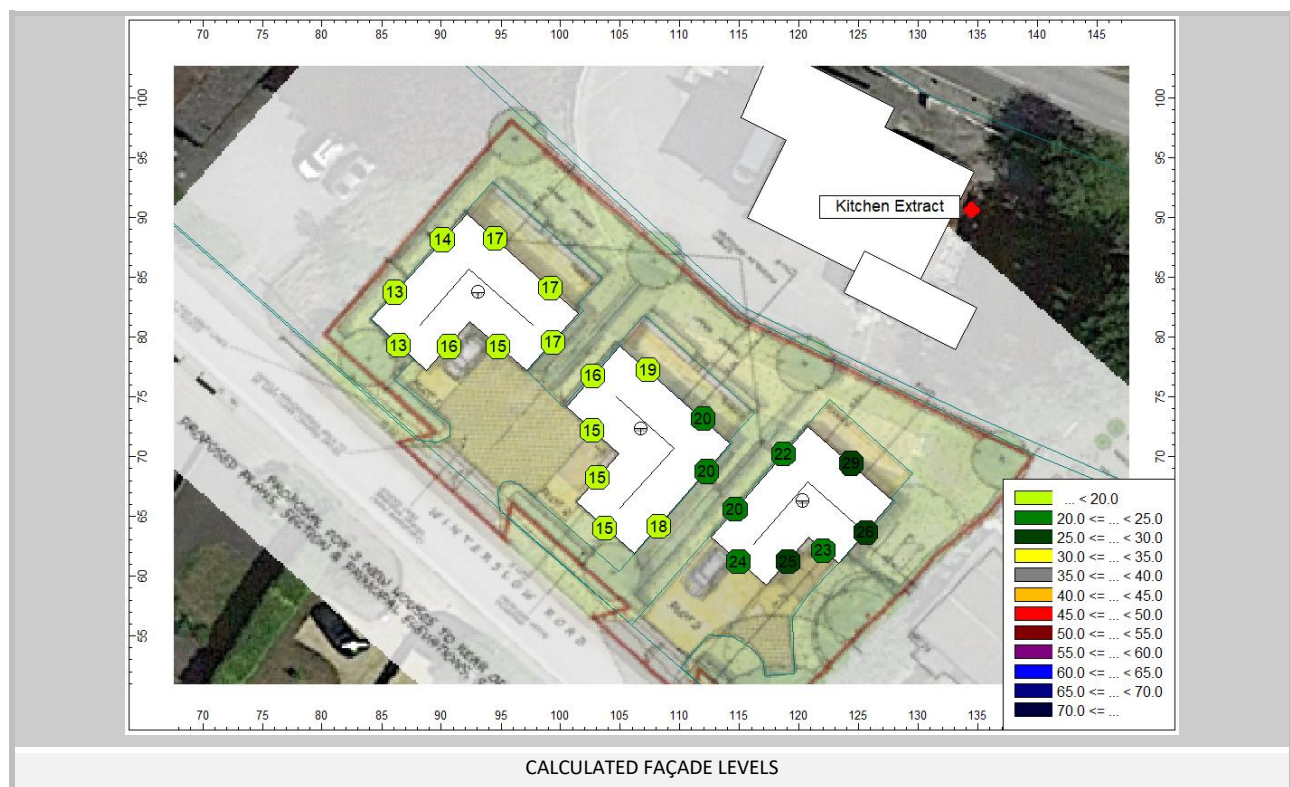

15 BS4142: 2014 +A1: 2019 NOISE ASSESSMENT

15.1 Scope of British Standard 4142: 2014 +A1: 2019

In the assessment of the existing surrounding commercial premises, consideration has been given to the scope of British Standard 4142: 2014 +A1: 2019, which in section 1, details applicability of this standard to rating assessing sound of an industrial and/or commercial nature. It is considered appropriate that both the background noise levels and the rating noise levels obtained fall within the scope of British Standard 4142: 2014 +A1: 2019 by using outdoor sound levels to assess the effect of sound on local residents.

15.2 Terms and Definitions

Symbol	Term	Definition
AP	Assessment Position	Position externally at the façade property under investigation at which the assessment is undertaken which is usually 1m from the 1 st floor bedroom window.
EP	Equivalent Position	Position at which the background noise levels are measured if there is no access to the assessment position or if source under investigation is audible.
$L_s = L_{Aeq, T}$	Specific Level	The average continuous equivalent sound pressure level of the source at the assessment position.
$L_{Ar, Tr}$	Rating Level	The average continuous equivalent sound pressure level of the source at the assessment position with a correction to account for the characteristic features.
$L_r = L_{Aeq, T}$	Residual Level	The average continuous equivalent sound pressure level at the assessment position without the source operating.
$L_{A90, T}$	Background Level	The sound pressure level that is not exceeded 90% of the time at the assessment position.
$L_a = L_{Aeq, T}$	Ambient Level	The totally encompassing sound at the assessment position including the residual and specific noise.

15.3 Assessment Position

The assessment positions were established as the proposed residential at the rear of the premises.

15.4 Calculations

The specific noise levels are calculated at the assessment position located at the residential property adjacent to the Grill Box using the calculations detailed within ISO 9613 Part 1 and 2: 1996. These calculations take the manufacturers sound power levels into account for a variety of factors including source directivity, distance, atmospheric absorption, ground absorption and the effects of any barriers and determine the resultant noise levels at the assessment position.

15.5 Equivalent Position

The background noise levels were measured at the equivalent position, chosen as it most represented the closest noise sensitive façade, located on the rear facade between 5th – 10th July 2023.

15.6 Rating Levels (Character Correction)

It is appropriate to add a character correction where there is a new source that cannot be measured in line with BS4142: 2014 +A1: 2019. There are 3 methods for approaching this.

- a) Subjective method
- b) Objective method (for tonality)
- c) Reference method

15.7 Subjective Method

The subjective method establishes a rating penalty that is added to the specific noise level if any of the following is present at the assessment position. If a tone is expected to be present a character correction of 0 dB to 6 dB is added depending on how perceptible it is at noise sensitive locations.

BS4142: 2014 +A1: 2019 – Section 9.2 Subjective Method	Perceptibility to noise sensitive facades	Correction
Tonality Ranging from not tonal to prominently tonal	Not tonal	+0
	Just perceptible	+2
	Clearly perceptible	+4
	Highly perceptible	+6

If the source is expected to be impulsive a character correction of 0 dB to 9 dB is added depending on how perceptible it is at noise sensitive locations.

BS4142: 2014 +A1: 2019 – Section 9.2 Subjective Method	Perceptibility to noise sensitive facades	Correction
Impulsivity Considering both the rapidity and any overall change in sound levels	Not impulsive	+0
	Just perceptible	+3
	Clearly perceptible	+6
	Highly perceptible	+9

When the sound features are neither tonal nor impulsive, a character correction of +3 is added for the readily distinctive quality against the acoustic environment or for the intermittency of the source.

BS4142: 2014 +A1: 2019 – Section 9.2 Subjective Method	Perceptibility to noise sensitive facades	Correction
Readily Distinctive	Is not present	+0
	Is present	+3
Intermittency	Is not present	+0
	Is present	+3

15.8 Assessment Criterion

The significance of the resulting noise on the residential property depends on the margin by which it exceeds the background noise levels. British Standard 4142: 2014 +A1: 2019 provides the following guidance within section 11.

Difference	Assessment of Impact
+10 dB	Indication of a significant adverse impact
+5 dB	Indication of an adverse impact
+0 dB	Indication of low impact

15.9 Noise Meter Floor

BS 4142: 2014 +A1:2019 suggests that Care is necessary in circumstances where background sound levels are low to ensure that self-generated and electrical noise within the measurement system does not unduly influence reported values, which might be the case if the measured background sound levels are less than 10 dB above the noise floor of the measuring system. The floor of a typical class 1 noise meter is in the region of 14 dB(A) and therefore measurements of less than 24 dB(A) should be assessed with care.

15.10 BS 4142: 2014 +A1:2019 Penalties

Whilst BS 4142: 2014+A1:2019 allows receptor assessments to be made to achieve levels equal to prevailing background noise levels, it also ensures that appropriate and more stringent penalties are applied to the specific noise level to ensure the correct level of protection for the local residents.

15.11 Assessments

15.11.1 Daytime (07:00 – 23:00)

Rating Industrial Noise affecting Mixed Industrial and Residential Areas			British Standard 4142: 2014+A1: 2019 Daytime (07:00 to 23:00)
Assessment Position			Student Accommodation Directly Above
Background Position			At the assessment position
Item	Calculation	Clause	Commentary
Specific Noise Level $L_{Aeq,1\text{ hour}}$	29 dB	7	Calculated using ISO 9613:1996 ^[3] .
Tonality	+2 dB	8.1	Tonality Characteristic
Impulsivity	+3 dB	8.1	Impulsive Characteristic
Rating Level	34 dB	9.1	The acoustic feature correction is added to the specific noise level
Background Noise Level $L_{A90,1\text{ hour}}$	47 dB	8.1	Modal Background Noise Level (07:00 – 23:00)
Assessment Level	-12 dB	11	The background level is subtracted from the rating level.
Conclusion BS 4142:2014 ^[1]	+10 dB Significant Adverse Effects, +5 dB Adverse Effects, +0 dB Low Impact		
Assessment	-12 dB		
Conclusion	The assessment level is 'Low Impact'		

15.12 Tonal Penalty

A +2 dB penalty has been applied to the specific noise level to allow for any minor tonal elements that may be present from the Iceland deliveries.

15.13 Impulsive Penalty

A +3 dB penalty has been applied to the specific noise level to allow for any impulsive elements that may be present from the existing extract.

15.14 Assessment Conclusion

It can be seen from the above assessments that the surround commercial noise sources will not have a detrimental effect on the proposed development.

16 NOISE FROM PATRONS

16.1 Calculation of Internal level

The resulting internal noise source is calculated in accordance with ISO9613-2:1996. The sound data has been taken on the basis of a distributed noise level of 60dBA (LAeq,T) from 20 conversations with normal voices (ref. 57dBA @ 1m BS8233) distributed internally. Noise levels are calculated based on capacity to show worst case scenario.

A noise level spectrum obtained from real speech recordings of 50% male 50% female voices over 20 languages listed in ITU-T P50 (BS7827:1996) and corrected to 60dBA:

Vocal noise spectrum used for noise breakout calculations (BS7827:1996)	Octave band (Hz) sound pressure level (dB)								
	63	125	250	500	1000	2000	4000	8000	Total
Occupational noise (worst case)	28	45	55	57	52	44	37	31	60

This is further reinforced when assessing the noise impact from raised voices; Impact Acoustics have used the values indicated in (Handbook of Acoustical Measurements and Noise Control, Harris, Cyril.):

Type of Communication	Noise Levels LAeq, T at 1m (dBA)	
	Male	Female
Casual	53	50
Normal	58	55
Raised	65	62
Loud	75	71
Shout	88	82

16.2 Inputted Noise Levels

The existing rear garden to the public house can house no more than 20 people. Therefore with 10 people all speaking at the same time, which is unlikely. It is understood the land owner, who also owns the public house, has submitted a premises licence application to vary the licence so that the use of the outdoor space will cease altogether by 11pm. Therefore, the following assessments have been made:-

A total worst case scenario has been assessed with all 20 adults will be speaking at a level of 60 dB(A) each (Lw 71 dB(A)).

Point Source

Close

Edit...

Sync. Graphic

Copy...

Print...

Font...


Help

Name	M.	ID	Result. PWL			Lw / Li		Correction			Sound Reduction		Attenuation	Operating Time			K0	Freq.	Direct.	Height	Coordinates				
			Day	Evening	Night	Type	Value	norm.	Day	Evening	Night	R	Area		Day	Special	Night				X	Y	Z		
			(dBA)	(dBA)	(dBA)		(dB(A))		(dB(A))	(dB(A))	(dB(A))		(m²)		(min)	(min)	(min)	(dB)	(Hz)		(m)	(m)	(m)		
			71.0	71.0	71.0	Lw	71		0.0	0.0	0.0							0.0	1000	(none)	1.50	r	133.34	75.68	9.63
			71.0	71.0	71.0	Lw	71		0.0	0.0	0.0							0.0	1000	(none)	1.50	r	133.42	77.19	9.76
			71.0	71.0	71.0	Lw	71		0.0	0.0	0.0							0.0	1000	(none)	1.50	r	135.02	74.92	9.66
			71.0	71.0	71.0	Lw	71		0.0	0.0	0.0							0.0	1000	(none)	1.50	r	137.46	74.04	9.67
			71.0	71.0	71.0	Lw	71		0.0	0.0	0.0							0.0	1000	(none)	1.50	r	137.80	75.89	9.86
			71.0	71.0	71.0	Lw	71		0.0	0.0	0.0							0.0	1000	(none)	1.50	r	134.98	77.57	9.87
			71.0	71.0	71.0	Lw	71		0.0	0.0	0.0							0.0	1000	(none)	1.50	r	136.87	78.96	10.08
			71.0	71.0	71.0	Lw	71		0.0	0.0	0.0							0.0	1000	(none)	1.50	r	138.56	77.74	10.06
			71.0	71.0	71.0	Lw	71		0.0	0.0	0.0							0.0	1000	(none)	1.50	r	140.11	75.13	9.89
			71.0	71.0	71.0	Lw	71		0.0	0.0	0.0							0.0	1000	(none)	1.50	r	139.56	73.19	9.68

INPUTED NOISE LEVELS

16.3 Calculated Façade Levels

Based on the above inputted noise levels, the following calculated façade levels have been evaluated.

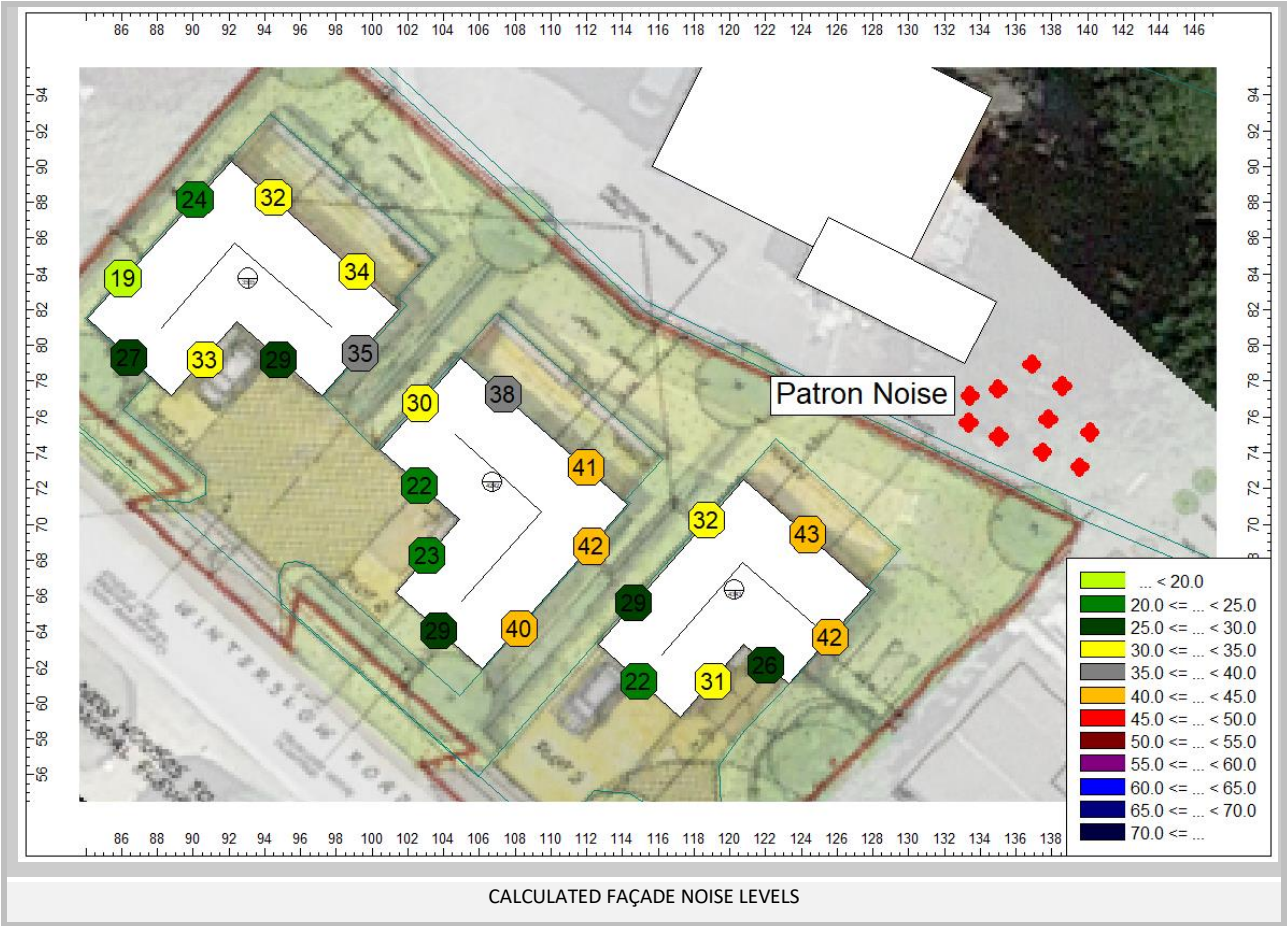

The above calculated 3D Model generated a resultant noise level at the nearest affected residential property of 46 dB(A)
Based on this, the following assessments have been made:-

16.4 Patron Noise Assessments 19:00 – 23:00

External Residential Assessment	20 Adults outside all at once with 10 Talking
Calculated Level at Residential	43 dB
Background Noise Level	47 dB
Excess Over Background	-4 dB
Assessment Conclusion	Low Impact

BS 8233: 2014 set the following parameters as target levels that should be designed to within rooms such as Living Rooms and Bedrooms.

Indoor ambient noise levels in spaces when they are unoccupied and privacy is also important		
Objective	Typical situations	Design Range $L_{Aeq,t}$ dB
Typical noise levels for acoustic privacy in shared spaces	Living room	35 – 40
NOTE: See Noise control in building services [28] and BS EN ISO 3382.		

Indoor ambient noise levels for dwellings			
Activity	Location	07:00 – 23:00	23:00 – 07:00
Resting	Living Room	35 dB L_{Aeq} 16 HOUR	--
Dining	Dining Room / Area	40 dB L_{Aeq} 16 HOUR	--
Sleeping (daytime resting)	Bedroom	35 dB L_{Aeq} 16 HOUR	30 dB L_{Aeq} 8 HOUR

According to BS 8233: 2014, a partially open window gives an acoustic attenuation of -15 dB(A) and therefore the following calculations are evaluated:-


Internal Residential Assessment	20 Adults outside all at once with 10 Talking
Calculated Level at Residential	43 dB
Partially Open Window	-12 dB
Calculated Level Inside Residential	31 dB
BS 8233: 2014 Criteria	35 dB
Excess Over Target Level	-4 dB
Assessment Conclusion	Low Impact

17 STAFF MOVEMENTS + COLLECTIONS & DELIVERIES

The following calculations demonstrate the effects on the proposed residential to the south east based on 20 staff car movements a day along with 5 delivery lorries. Speaking with the venue, they have informed us of the following delivery / collection rota.

Activity	Hours Likely to Occur
Keg Delivery / Collection	12:00 – 18:00
Bin Collection	12:00 – 18:00
Staff Movements 20/day	12:00 – 18:00

These all occur during normal daytime hours, and whilst the peaks maybe audible, the background noise levels are at the highest during these times and therefore minimises any disturbance to the proposed residential.

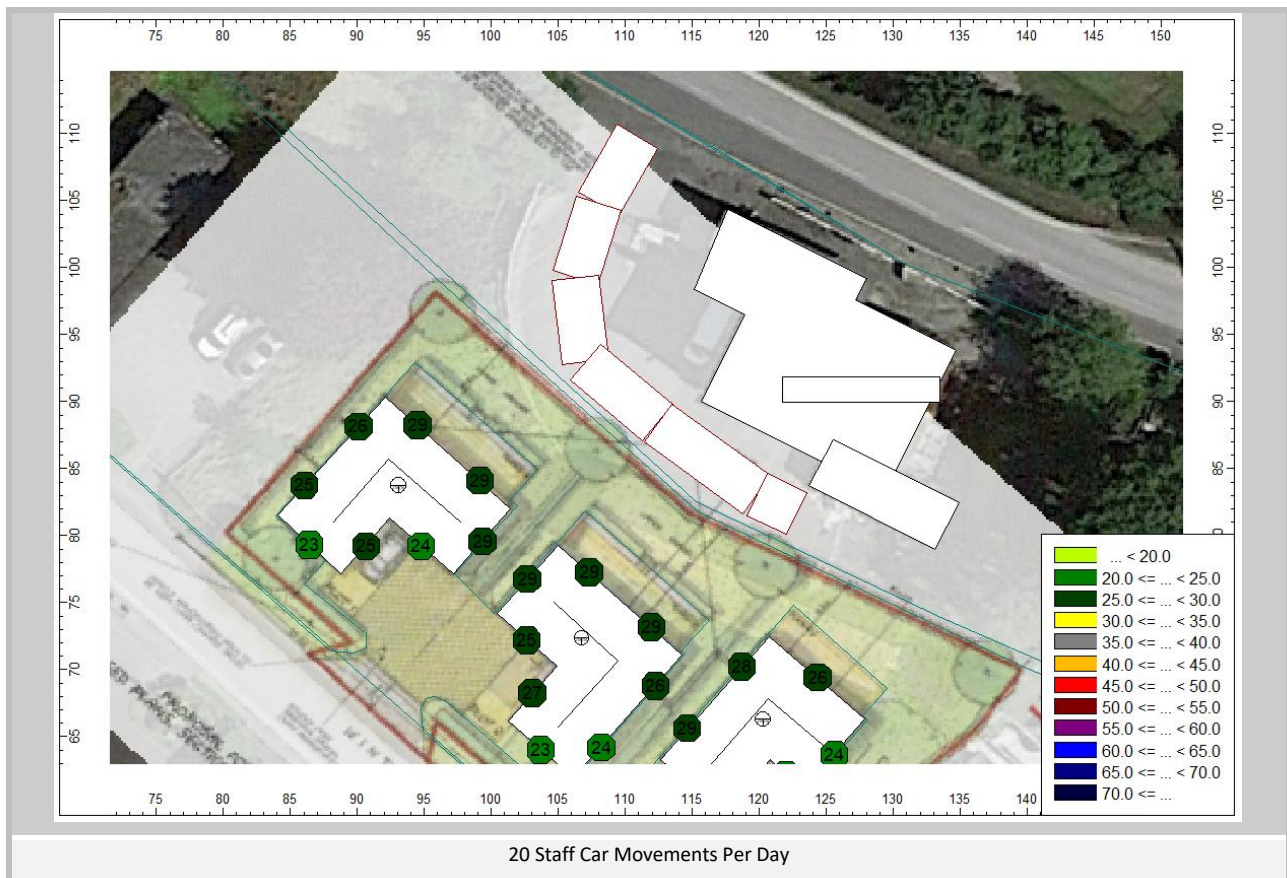


External Residential Assessment	20 Cars & 5 Lorries
Calculated Level at Residential	29 dB
Background Noise Level	44 dB
Excess Over Background	-15 dB
Assessment Conclusion	Low Impact

18 STAFF LEAVING AT 00:00 HRS

The following calculations demonstrate the effects on the proposed residential to the south east based on 20 staff car movements at night up to 00:00hrs.

Activity	Hours Likely to Occur
Staff Movements 20/day	23:45 – 00:00

These all occur during normal daytime hours, and whilst the peaks maybe audible, the background noise levels are at the highest during these times and therefore minimises any disturbance to the proposed residential.

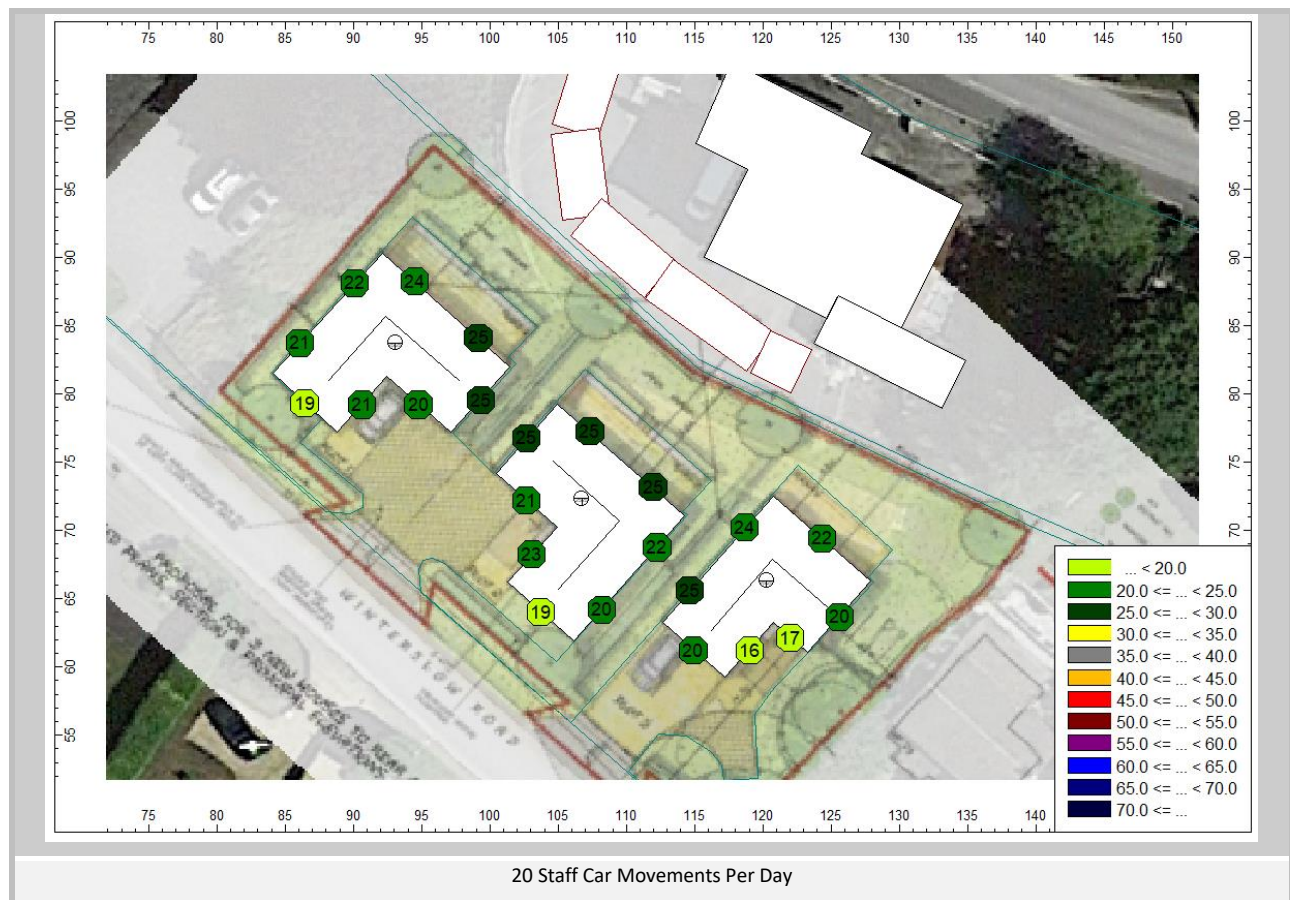

External Residential Assessment	20 Cars
Calculated Level at Residential	25 dB
Background Noise Level	36 dB
Excess Over Background	-11 dB
Assessment Conclusion	Low Impact

19 ELEMENT 4 – ASSESSMENT OF OTHER RELEVANT ISSUES

The National Planning Policy Framework 2024 (NPPF) and assessments to the Noise Policy Statement for England 2010 (NPSE) should be made in conjunction with each other. Paragraphs 198 - 201 of the National Planning Policy Framework 2024 (NPPF) states the following:

Paragraph 198 Planning policies and decisions should also ensure that new development is appropriate for its location taking into account the likely effects (including cumulative effects) of pollution on health, living conditions and the natural environment, as well as the potential sensitivity of the site or the wider area to impacts that could arise from the development. In doing so they should:

- a) Mitigate and reduce to a minimum potential adverse impacts resulting from noise from new development – and avoid noise giving rise to significant adverse impacts on health and the quality of life.
- b) Identify and protect tranquil areas which have remained relatively undisturbed by noise and are prized for their recreational and amenity value for this reason.

Paragraph 199 Planning policies and decisions should sustain and contribute towards compliance with relevant limit values or national objectives for pollutants. So far as possible these opportunities should be considered at the plan-making stage, to ensure a strategic approach and limit the need for issues to be reconsidered when determining individual applications.

Paragraph 200 Planning policies and decisions should ensure that new development can be integrated effectively with existing businesses and community facilities (such as places of worship, pubs, music venues and sports clubs). Existing businesses and facilities should not have unreasonable restrictions placed on them as a result of development permitted after they were established. Where the operation of an existing business or community facility could have a significant adverse effect on new development (including changes of use) in its vicinity, the applicant (or 'agent of change') should be required to provide suitable mitigation before the development has been completed.

Paragraph 201 The focus of planning policies and decisions should be on whether proposed development is an acceptable use of land, rather than the control of processes or emissions (where these are subject to separate pollution control regimes). Planning decisions should assume that these regimes will operate effectively. Equally, where a planning decision has been made on a particular development, the planning issues should not be revisited through the permitting regimes operated by pollution control authorities

The Noise Policy Statement for England gives various levels of effect as detailed within this report.

With the glazing / ventilation specifications achieved within this report, the development can be implemented within the guidelines of the aforementioned documents and ensure a conclusion of NOEL – No Observed Effect Level. This is the level below which no effect can be detected. In simple terms, below this level, there is no detectable effect on health and quality of life due to the noise.

20 ACOUSTIC DESIGN STATEMENT

Good Acoustic Design	Given the size and orientation of the proposed site, it is recommended that the developer adopted, where practically possible, a good acoustic design which should include careful consideration of the positioning of the proposed properties together with thoughts being taken as to internal layouts to minimise noise sensitive rooms facing onto dominant noise sources within the local areas.
Internal Noise Levels	Calculations have been carried out and assessments made to BS 8233: 2014 together with design specifications supplied for the required glazing and ventilation specifications required across the development to ensure compliance.
L _{Amax} dB Noise Levels	Assessments and calculations demonstrate that the L _{Amax} dB Levels are within the criteria set out within PRoPG
NPPF & NPSE	With the glazing / ventilation specifications achieved within this report, the development can be implemented within the guidelines of the aforementioned documents and ensure a conclusion of NOEL – No Observed Effect Level . This is the level below which no effect can be detected. In simple terms, below this level, there is no detectable effect on health and quality of life due to the noise.
External Living Areas	The guideline has been considered acceptable criteria for this assessment given the sites geographical location and proximity to a major trunk road and railway line. The layout has been in order to allow for acoustics and minimise the noise levels within these outdoor living spaces. The calculation demonstrates the external living spaces are likely to see noise levels just over the lower guideline of 50 dB.
BS 4142: 2014+A1: 2019	It can be seen from the above assessments that with the existing kitchen extract operational, an assessment conclusion of Low Impact could be expected during the daytime.
Patron Noise	Noise from the existing rear garden of the public house can be maintained without causing an acoustic issue to the proposed residential dwellings.
OVERALL OUTCOME	NOEL – No Observed Effect Level

21 RECOMMENDATION TO DECISION MAKER

Levels have been recorded and assessments made in accordance with the relevant standards. Internal criteria's have been set and calculations made in order to determine the minimum construction details required in order to meet the desired level within the proposed residential dwellings and satisfy the local council's requirements.

National Planning Policy Framework 2024 suggests that planning permission should be granted unless any adverse impacts of doing so would significantly and demonstrably outweigh the benefits, when assessed against the policies in the framework taken as a whole, or specific policies in the framework indicate the application should be restricted.

Based on the calculations and assessments made within this report it is the professional opinion of Impact Acoustics Ltd that the proposed development can demonstrate compliance with the National Planning Policy Framework 2024, NPPF & NPSE and that, with regards to sound, planning permission can be granted using the following parameters.

As indicated in Section 2 of PRoPG, following the PRoPG approach will lead to the choice of one of four possible recommendations from the noise practitioner to the decision maker:

- A. Planning consent may be granted without any need for noise conditions;
- B. Planning consent may be granted subject to the inclusion of suitable noise conditions;
- C. Planning consent should be refused on noise grounds in order to avoid significant adverse effects ("avoid"); or
- D. Planning consent should be refused on noise grounds in order to prevent unacceptable adverse effects ("prevent").

RECOMMENDATION TO DECISION MAKER

B: Grant with Noise Conditions

22 CONCLUSION

22.1 Summary of Results

A background noise survey was undertaken from 5th – 10th July 2023 at two positions to establish the underlying background noise levels. The recorded levels are as follows:-

Assessment Position	Date Start	Date Finish	Daytime LAeq (07:00-23:00)	Night Time LAeq (23:00-07:00)
Position 1	05.07.2023	10.07.2023	63.8	54.3
Position 2	05.07.2023	10.07.2023	55.3	47.5

Assessment Position	Date Start	Date Finish	Daytime LA90 (07:00-23:00)	Daytime LA90 (Average at 07:00-23:00)
Position 2	05.07.2023	10.07.2023	47	44

22.2 Potential Façade Noise Levels

22.2.1 Daytime (07:00-23:00)

Time Period	Highest Potential Façade Noise Level	Noise Risk Category 2 - Medium
Average Daytime (07:00-23:00)	L _{Aeq, 16 HOUR} 65 dB	64 - 70 dB

22.2.2 Night Time (23:00-07:00)

Time Period	Highest Potential Façade Noise Level	Noise Risk Category 1 - Low
Average Night Time (23:00-07:00)	L _{Aeq, 16 HOUR} 54 dB	40 - 55 dB
	Maximum (10 Times) – L _{Amax} 77.7 dB	>80 dB (10 Times in 8 Hours)

22.3 Risk Assessment

22.3.1 Daytime (07:00-23:00) – Position 1

Risk Assessment Category	Risk Assessment
2 - Medium	As noise levels increase, the site is likely to be less suitable from a noise perspective and any subsequent application may be refused unless a good acoustic design process is followed and is demonstrated in an ADS which confirms how the adverse impacts of noise will be mitigated and minimised, and which clearly demonstrate that a significant adverse noise impact will be avoided in the finished development.

22.3.2 Night Time (23:00-07:00) – Position 1

Risk Assessment Category	Risk Assessment
1 – Low	At low noise levels, the site is likely to be acceptable from a noise perspective provided that a good acoustic design process is followed and is demonstrated in an ADS which confirms how the adverse impacts of noise will be mitigated and minimised in the finished development.

The above table demonstrates this site is located within Noise Risk Category 2 for daytime and Category 1 for night time, which suggests further mitigation levels will be required at Stage 2 provided a good acoustic design process is followed.

22.4 Glazing & Ventilation Assessment

The development should be designed with a 6mm glass / 16mm Air Gap / 4mm glass and MVHR System to all room to ensure the internal noise levels are acceptable in terms of the assessment to British Standard 8233: 2014.

22.5 Commercial Noise Assessment

22.5.1 Daytime (Rear).

Rating Level	35 dB	9.1	The acoustic feature correction is added to the specific noise level
Background Noise Level $L_{A90,1 \text{ hour}}$	47 dB	8.1	Modal Background Noise Level (07:00 – 23:00)
Assessment Level	-12 dB	11	The background level is subtracted from the rating level.
Conclusion BS 4142:2014 _[1]	+10 dB Significant Adverse Effects, +5 dB Adverse Effects, +0 dB Low Impact		
Assessment	-12 dB		
Conclusion	The assessment level is 'Low Impact'		

22.6 Patron Noise Assessment 19:00 – 23:00

22.6.1 External Assessment

External Residential Assessment	20 Adults outside all at once with 10 Talking
Calculated Level at Residential	43 dB
Background Noise Level	47 dB
Excess Over Background	-4 dB
Assessment Conclusion	Low Impact

22.6.2 Internal Assessment

Internal Residential Assessment	20 Adults outside all at once with 10 Talking
Calculated Level at Residential	43 dB
Partially Open Window	-12 dB
Calculated Level Inside Residential	31 dB
BS 8233: 2014 Criteria	35 dB
Excess Over Target Level	-1 dB
Assessment Conclusion	Low Impact

22.7 20 Staff Cars + Collections and Deliveries 12:00 – 18:00

External Residential Assessment	20 Cars & 5 Lorries
Calculated Level at Residential	29 dB
Background Noise Level	47 dB
Excess Over Background	-18 dB
Assessment Conclusion	Low Impact

22.8 Staff Leaving 23:45 – 00:00

External Residential Assessment	20 Cars
Calculated Level at Residential	25 dB
Background Noise Level	36 dB
Excess Over Background	-11 dB
Assessment Conclusion	Low Impact

22.9 Ambient Noise BS 8233: 2014

The dominant noise source on the overall site is road traffic. Levels have been recorded and assessments made in accordance with the relevant standards. Internal criteria's have been set and calculations made in order to determine the minimum construction details required in order to meet the desired level within the proposed residential dwellings and satisfy the local council's requirements.

22.10 Commercial Noise

The operation of the existing commercial noise source has been assessed to establish if these will have a demonstrable adverse effect in terms of noise that outweigh the benefits of the development. Measurements have been undertaken in accordance with British Standard 4142: 2014+A1:2019 and ISO 1996 – Part 2: 2017. This report has established the existing background noise levels at the closest proposed residential façade to the existing noise sources. The resulting emissions from the site running on a worst case scenario show no conflict with 'low impact' criteria and give a strong indication that complaint and impact on the local amenity is unlikely.

22.11 Planning Approval

National Planning Policy Framework 2024 suggests that planning permission should be granted unless any adverse impacts of doing so would significantly and demonstrably outweigh the benefits, when assessed against the policies in the framework taken as a whole, or specific policies in the framework indicate the application should be restricted.

Based on the calculations and assessments made within this report it is the professional opinion of Impact Acoustics Ltd that the proposed development can demonstrate compliance with the National Planning Policy Framework 2024, NPPF & NPSE and that, with regards to sound, planning permission can be granted.


23 APPENDIX A - RESULTS

23.1 5th – 6th July 2023 – Position 1

NOISE LEVEL SUMMARY ASSESSMENT				Octave Band Centre Frequency (Hz)								
Date / Time	LAeq	LAmx	LA90	63	125	250	500	1.0k	2.0k	4.0k	8.0k	16.0k
DAYTIME 07:00 - 23:00 LAeq 16 HOUR & Cor r esponding LAmx 16 HOUR	63.8	90.4	51.0	67.8	63.6	60.7	58.2	61.3	54.8	47.6	41.7	32.5
NIGHT TIME 23:00 - 07:00 LAeq 8 HOUR & Cor r esponding LAmx 8 HOUR	54.0	87.7	21.0	57.6	53.1	49.8	47.8	51.3	45.3	38.2	38.5	25.9

DAYTIME NOISE LEVELS 07:00 - 23:00 1 HOUR SAMPLES				Octave Band Centre Frequency (Hz)								
Date / Time	LAeq	LAmx	LA90	63	125	250	500	1.0 k	2.0 k	4.0 k	8.0 k	16.0 k
07:00 - 08:00	65.8	59.3	54.8	70.3	66.3	61.8	60.2	63.1	57.6	50.4	43.9	31.5
08:00 - 09:00	66.0	85.4	56.6	72.8	66.7	63.8	60.5	63.1	57.5	51.0	45.2	38.4
09:00 - 10:00	64.8	83.5	54.5	69.7	63.2	61.0	59.3	62.1	56.1	50.0	43.2	37.0
10:00 - 11:00	63.4	90.4	50.6	67.2	62.6	60.2	58.7	60.3	54.7	49.9	46.9	37.0
11:00 - 12:00	62.7	80.6	50.6	67.6	60.9	59.0	57.0	60.4	53.4	46.6	40.3	34.3
12:00 - 13:00	63.5	85.3	51.8	67.4	62.9	59.7	57.8	60.9	54.8	48.9	43.2	30.8
13:00 - 14:00	63.3	87.9	51.3	66.6	62.2	60.0	58.2	60.3	55.1	49.0	43.3	29.9
14:00 - 15:00	63.8	81.5	49.7	66.1	62.6	60.0	58.2	61.6	54.5	46.4	39.0	28.7
15:00 - 16:00	64.9	87.6	48.7	67.3	64.5	62.5	59.5	62.7	55.3	46.1	40.2	32.3
16:00 - 17:00	66.5	88.6	51.3	68.4	64.0	62.9	60.6	64.5	57.2	48.1	39.5	29.5
17:00 - 18:00	66.1	82.8	51.7	69.1	66.9	62.9	59.8	64.1	56.5	47.3	41.0	28.7
18:00 - 19:00	64.2	87.6	47.1	63.4	62.6	60.4	58.7	62.1	54.7	46.7	38.3	28.4
19:00 - 20:00	61.6	86.3	44.5	68.3	66.9	62.6	56.5	58.3	51.0	42.9	36.8	25.7
20:00 - 21:00	56.9	81.9	40.9	59.7	53.6	52.8	51.5	54.8	47.6	39.0	32.8	18.6
21:00 - 22:00	55.6	78.0	35.5	55.3	50.6	51.2	49.6	53.8	46.0	35.1	26.3	17.8
22:00 - 23:00	52.5	77.5	32.9	54.1	50.1	48.2	46.3	50.5	43.5	32.9	24.5	12.3

NIGHT TIME NOISE LEVELS 23:00 - 07:00 15 MINUTE SAMPLES				Octave Band Centre Frequency (Hz)								
Date / Time	LAeq	LAmx	LA90	63	125	250	500	1.0 k	2.0 k	4.0 k	8.0 k	16.0 k
23:00 - 23:15	48.2	74.1	27.7	52.1	44.6	43.4	41.8	46.2	39.5	27.2	19.3	9.7
23:15 - 23:30	53.5	76.0	28.5	52.4	49.3	48.4	47.0	51.7	44.6	32.2	22.2	10.4
23:30 - 23:45	48.9	77.0	24.8	50.5	43.6	43.2	41.8	46.5	41.3	32.0	22.0	9.7
23:45 - 00:00	52.8	78.7	25.7	48.8	46.5	47.1	45.1	51.2	44.0	31.1	21.1	11.9
00:00 - 00:15	50.7	79.7	23.2	46.6	44.7	44.7	44.7	48.4	42.4	34.5	28.4	19.9
00:15 - 00:30	51.1	79.5	21.3	45.9	43.8	44.2	43.5	49.5	42.3	30.1	20.6	10.2
00:30 - 00:45	39.9	78.4	21.8	32.4	26.9	24.2	25.1	27.2	29.0	32.0	33.9	30.9
00:45 - 01:00	22.4	34.9	20.4	32.2	26.4	20.4	19.2	18.2	11.8	12.2	12.4	8.4
01:00 - 01:15	46.8	73.8	21.1	54.0	41.2	40.9	41.0	43.9	39.5	32.5	24.5	11.7
01:15 - 01:30	44.9	72.2	20.5	39.0	39.4	41.2	39.4	43.7	33.0	23.8	17.2	8.9
01:30 - 01:45	43.8	70.5	22.9	41.1	37.8	39.8	39.2	41.6	34.9	23.4	17.5	9.3
01:45 - 02:00	25.9	44.8	21.9	34.6	27.2	22.2	22.1	20.8	16.9	16.6	15.3	8.7
02:00 - 02:15	23.3	39.0	20.9	33.5	26.9	22.1	20.7	19.1	12.4	12.3	12.5	8.3
02:15 - 02:30	51.3	79.2	26.1	53.9	49.6	53.4	44.4	48.8	41.7	30.5	22.0	10.6
02:30 - 02:45	22.9	36.0	21.3	35.0	27.0	22.7	20.2	17.8	12.5	12.3	12.4	8.2
02:45 - 03:00	22.6	32.6	21.5	35.2	27.7	23.3	20.1	16.1	12.4	12.6	12.4	8.2
03:00 - 03:15	27.5	44.0	22.0	36.0	27.7	24.1	23.5	25.3	15.0	12.2	12.4	8.2
03:15 - 03:30	23.6	37.8	21.5	35.9	27.7	22.9	21.4	18.4	12.2	12.6	12.5	8.3
03:30 - 03:45	23.8	45.2	21.3	34.9	26.5	22.3	20.4	20.0	13.2	12.4	12.4	8.2
03:45 - 04:00	41.7	67.3	21.4	46.9	41.0	39.2	36.6	39.1	33.2	22.7	15.2	8.5
04:00 - 04:15	42.2	68.5	25.8	43.3	42.4	39.9	38.9	39.0	33.3	25.5	19.6	8.8
04:15 - 04:30	38.6	60.2	28.9	35.2	27.9	22.6	24.3	27.4	35.3	28.7	27.3	8.7
04:30 - 04:45	43.2	68.6	32.0	46.8	42.0	39.2	40.1	38.7	33.4	32.8	27.3	9.7
04:45 - 05:00	52.5	78.7	34.6	50.0	44.6	45.5	46.5	50.6	43.4	34.9	27.8	14.3
05:00 - 05:15	52.2	79.3	35.9	51.8	49.1	47.0	48.0	49.2	44.0	38.6	31.3	15.2
05:15 - 05:30	57.2	82.2	34.4	58.0	55.8	52.7	50.9	54.9	49.2	38.8	30.9	17.8
05:30 - 05:45	59.2	81.1	35.5	57.2	52.3	55.2	53.7	57.3	50.1	39.4	31.6	20.0
05:45 - 06:00	58.3	79.7	39.2	60.2	55.5	52.4	51.4	56.5	49.0	38.8	32.2	15.0
06:00 - 06:15	58.0	78.9	40.0	65.3	57.7	54.1	52.7	54.7	48.8	45.3	43.4	30.7
06:15 - 06:30	60.7	85.2	44.1	61.9	56.8	54.9	54.3	57.6	53.2	49.5	39.6	20.2
06:30 - 06:45	60.2	79.1	41.7	67.1	64.1	57.5	54.3	57.7	51.2	41.9	35.2	28.5
06:45 - 07:00	62.1	87.7	47.7	66.6	61.7	58.0	55.2	58.6	53.1	43.2	52.6	39.3

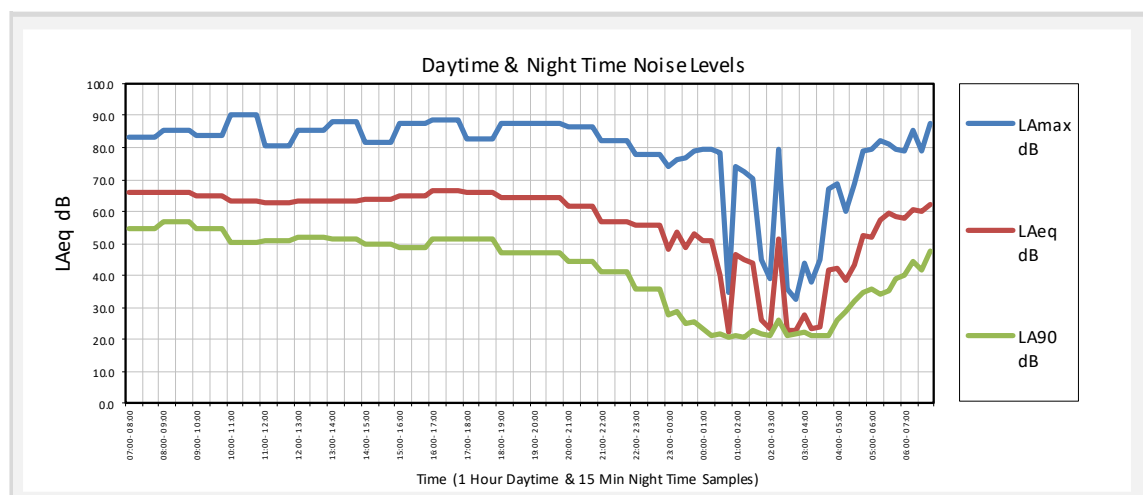


23.2 6th – 7th July 2023 – Position 1

NOISE LEVEL SUMMARY ASSESSMENT				Octave Band Centre Frequency (Hz)								
Date / Time	LAeq	LAmaz	LA90	63	125	250	500	1.0k	2.0k	4.0k	8.0k	16.0k
DAYTIME 07:00 - 23:00 LAeq 16 HOUR & Corresponding LAmaz 16 HOUR	63.4	91.1	54.0	69.1	65.3	60.9	58.3	60.7	54.3	47.1	40.2	31.2
NIGHT TIME 23:00 - 07:00 LAeq 8 HOUR & Corresponding LAmaz 8 HOUR	54.1	90.6	21.0	56.9	53.1	53.8	48.3	50.5	46.2	42.1	33.6	24.5

DAYTIME NOISE LEVELS 07:00 - 23:00 1 HOUR SAMPLES												
Date / Time	LAeq	LAmaz	LA90	63	125	250	500	1.0 k	2.0 k	4.0 k	8.0 k	16.0 k
07:00 - 08:00	64.8	82.4	52.0	70.9	68.9	63.1	59.5	61.6	55.9	49.1	42.8	30.1
08:00 - 09:00	66.3	91.1	54.0	73.6	67.1	64.1	62.0	62.9	57.9	51.5	44.3	33.5
09:00 - 10:00	64.1	83.6	50.0	69.1	64.1	61.9	59.4	61.1	55.1	49.1	42.4	30.4
10:00 - 11:00	62.9	87.4	53.8	72.5	70.7	61.5	57.6	59.0	53.3	47.2	40.3	32.7
11:00 - 12:00	63.1	81.5	56.1	73.9	67.8	62.6	58.5	59.4	53.9	47.8	40.8	28.9
12:00 - 13:00	62.8	86.3	46.8	65.7	61.3	59.6	58.3	59.9	53.9	47.2	40.7	36.9
13:00 - 14:00	62.5	83.3	45.1	67.1	61.8	59.0	57.7	59.8	53.5	47.0	41.2	35.2
14:00 - 15:00	63.0	82.0	45.7	64.9	61.3	59.6	57.5	60.7	53.7	45.4	37.3	31.7
15:00 - 16:00	64.8	84.5	48.2	67.1	63.0	61.8	59.8	62.3	55.7	49.1	42.3	30.9
16:00 - 17:00	66.4	84.1	50.7	70.0	67.0	63.9	60.9	64.1	57.0	49.5	42.5	30.6
17:00 - 18:00	65.6	81.3	48.8	69.1	66.5	62.6	59.9	63.5	56.0	46.7	38.2	30.1
18:00 - 19:00	63.7	80.4	45.6	66.4	62.8	60.5	58.1	61.6	54.2	44.5	36.0	27.1
19:00 - 20:00	60.2	83.2	40.3	64.1	65.1	57.2	54.5	57.7	51.0	42.4	33.8	22.5
20:00 - 21:00	57.6	82.3	36.8	56.6	52.2	52.8	51.7	55.8	48.2	36.9	27.3	23.6
21:00 - 22:00	55.8	80.5	34.4	58.3	53.5	51.7	49.7	53.9	46.4	35.6	27.9	13.9
22:00 - 23:00	54.1	79.0	30.1	58.5	51.2	49.9	48.1	52.1	44.7	34.7	30.8	21.9

NIGHT TIME NOISE LEVELS 23:00 - 07:00 15 MINUTE SAMPLES												
Date / Time	LAeq	LAmaz	LA90	63	125	250	500	1.0 k	2.0 k	4.0 k	8.0 k	16.0 k
23:00 - 23:15	45.7	73.1	23.4	44.5	38.5	39.5	38.5	43.9	37.3	28.3	20.6	10.3
23:15 - 23:30	49.7	73.3	25.1	45.4	44.2	44.9	42.9	48.1	40.6	27.9	18.5	9.3
23:30 - 23:45	53.7	76.5	33.4	59.0	48.9	47.4	46.5	51.7	45.7	34.2	22.8	11.2
23:45 - 00:00	46.3	74.0	23.7	48.4	38.8	40.2	41.2	44.3	37.9	27.5	17.7	9.3
00:00 - 00:15	50.5	75.2	23.9	49.4	45.6	44.9	43.9	48.4	42.4	30.5	21.3	10.5
00:15 - 00:30	46.4	75.1	21.0	42.9	39.0	39.7	38.3	44.3	39.0	26.0	18.7	9.3
00:30 - 00:45	23.9	38.8	21.3	32.1	25.7	23.0	18.8	17.6	18.1	13.3	12.8	8.5
00:45 - 01:00	26.4	38.7	24.9	33.1	28.5	25.5	21.8	19.9	18.7	17.7	14.0	8.4
01:00 - 01:15	46.7	71.5	25.3	48.7	43.3	43.0	41.7	43.8	39.2	29.8	21.2	9.8
01:15 - 01:30	30.7	49.6	22.2	38.7	35.6	26.7	25.6	24.9	24.3	20.8	15.7	8.4
01:30 - 01:45	54.3	83.8	21.7	46.1	41.8	46.6	46.5	52.9	44.6	33.5	25.3	10.4
01:45 - 02:00	23.2	40.9	20.5	32.1	23.8	22.1	18.5	19.2	13.8	13.0	12.8	8.5
02:00 - 02:15	42.8	68.7	20.8	44.2	39.8	40.2	36.5	40.2	34.0	28.6	20.8	9.6
02:15 - 02:30	21.4	33.4	20.4	32.0	24.2	21.2	17.5	15.3	12.4	12.8	12.5	8.6
02:30 - 02:45	45.6	73.3	20.8	46.6	45.1	40.6	40.9	43.3	35.6	31.9	26.5	10.0
02:45 - 03:00	23.5	38.8	20.2	32.9	24.3	20.9	19.0	20.3	13.8	12.3	12.5	8.3
03:00 - 03:15	28.3	54.3	19.7	34.4	25.0	21.3	19.1	24.7	23.1	13.4	12.6	8.3
03:15 - 03:30	20.3	34.9	19.1	31.1	23.2	20.0	16.1	14.4	11.1	12.3	12.6	8.3
03:30 - 03:45	23.6	38.8	20.5	33.3	25.6	23.9	21.7	18.5	12.2	12.1	12.4	8.3
03:45 - 04:00	22.9	36.3	21.1	32.2	23.8	22.1	19.7	18.7	12.4	12.4	12.7	8.3
04:00 - 04:15	48.0	70.0	25.4	52.2	47.9	45.7	42.1	45.8	38.7	29.5	22.6	10.9
04:15 - 04:30	49.1	77.9	27.3	48.5	47.1	43.1	42.5	47.1	40.1	34.4	28.2	12.4
04:30 - 04:45	48.4	74.8	34.7	42.2	44.4	41.1	40.3	44.9	41.7	37.3	33.2	11.2
04:45 - 05:00	41.6	57.0	34.7	33.8	27.0	25.8	36.7	31.0	35.2	35.0	29.9	8.5
05:00 - 05:15	43.7	62.3	35.7	41.2	30.2	29.1	45.7	28.5	31.4	32.9	26.7	8.6
05:15 - 05:30	61.9	90.6	36.9	57.6	59.8	56.8	54.8	55.8	57.5	50.6	44.2	27.0
05:30 - 05:45	56.6	77.2	36.1	56.4	51.7	51.1	51.2	54.6	47.5	37.9	31.1	13.4
05:45 - 06:00	60.1	85.5	40.7	64.1	55.3	52.7	52.3	55.7	48.7	54.3	41.2	27.8
06:00 - 06:15	58.8	82.5	40.7	60.5	54.4	52.2	51.7	56.2	50.8	45.3	41.0	29.3
06:15 - 06:30	58.8	78.9	39.8	61.2	57.7	54.5	53.6	55.6	50.7	45.3	38.8	33.1
06:30 - 06:45	57.9	76.9	43.9	65.1	60.4	55.1	52.8	55.1	49.1	40.4	31.1	16.0
06:45 - 07:00	62.9	86.4	47.4	66.9	64.3	67.6	58.5	58.4	52.1	43.3	37.1	36.7

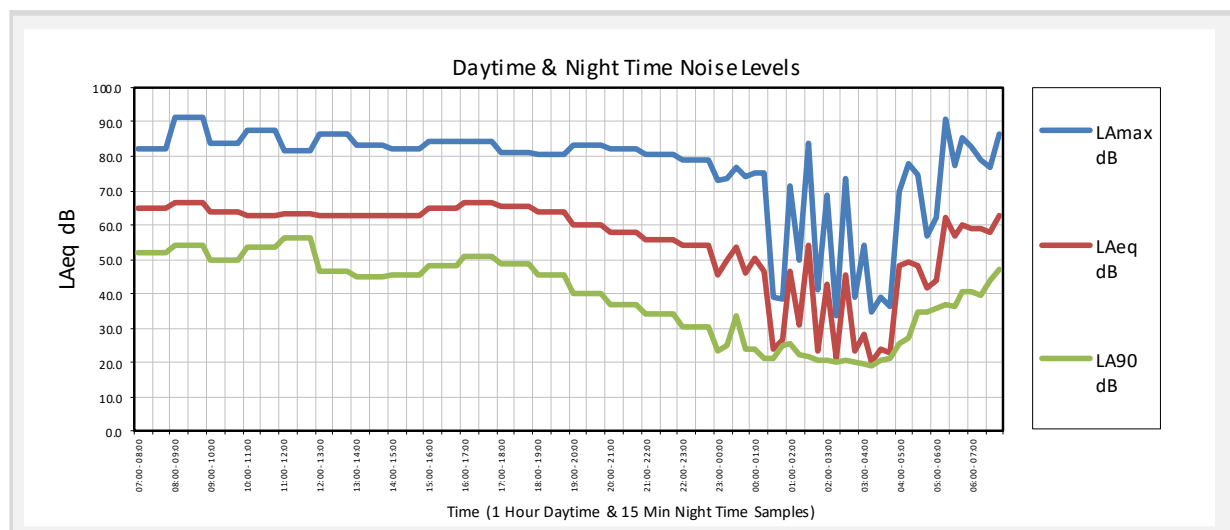


23.3 7th – 8th July 2023 – Position 1

NOISE LEVEL SUMMARY ASSESSMENT				Octave Band Centre Frequency (Hz)								
Date / Time	LAeq	LAmaz	LA90	63	125	250	500	1.0k	2.0k	4.0k	8.0k	16.0k
DAYTIME 07:00 - 23:00 LAeq 16 HOUR & Cor r esponding LAmaz 16 HOUR	62.5	92.9	47.0	67.0	64.0	60.3	57.6	59.8	53.1	46.4	40.9	31.7
NIGHT TIME 23:00 - 07:00 LAeq 8 HOUR & Cor r esponding LAmaz 8 HOUR	54.3	96.0	28.0	53.8	51.8	52.2	53.4	50.0	45.1	39.6	33.1	18.6

DAYTIME NOISE LEVELS 07:00 - 23:00 1 HOUR SAMPLES												
Date / Time	LAeq	LAmaz	LA90	63	125	250	500	1.0 k	2.0 k	4.0 k	8.0 k	16.0 k
07:00 - 08:00	64.0	87.3	51.8	70.0	65.5	61.1	58.8	61.0	55.6	48.6	41.8	35.2
08:00 - 09:00	63.6	89.2	51.1	71.1	65.9	62.0	59.1	60.5	54.4	47.9	41.7	31.7
09:00 - 10:00	62.2	89.4	47.7	68.6	62.7	59.1	56.7	59.5	52.5	45.0	47.4	31.1
10:00 - 11:00	62.3	90.7	44.3	65.8	68.2	62.4	57.8	58.6	52.1	46.3	38.1	29.4
11:00 - 12:00	61.6	83.9	44.3	65.7	62.8	58.4	56.3	59.0	52.3	45.2	37.4	29.8
12:00 - 13:00	63.4	84.2	46.0	66.8	63.3	61.0	58.6	60.8	53.9	46.3	40.0	33.4
13:00 - 14:00	63.9	89.6	45.5	67.5	64.5	63.1	60.6	60.7	54.0	47.6	39.3	31.8
14:00 - 15:00	63.6	83.6	45.1	66.7	62.1	60.8	58.6	61.2	54.0	46.4	41.4	34.4
15:00 - 16:00	64.3	84.5	46.6	69.0	64.4	61.3	58.6	62.2	54.6	45.9	40.1	32.3
16:00 - 17:00	64.6	84.9	46.7	67.9	66.9	62.7	59.1	62.2	54.6	46.0	38.7	31.9
17:00 - 18:00	64.1	84.6	46.6	67.4	65.8	61.8	58.8	61.7	54.4	45.8	39.1	35.8
18:00 - 19:00	63.0	92.9	42.1	63.7	60.8	58.8	57.6	59.7	54.3	51.6	45.6	32.0
19:00 - 20:00	58.9	80.9	38.2	62.4	58.6	56.3	54.0	56.5	49.4	41.2	33.8	26.2
20:00 - 21:00	56.8	79.2	36.8	61.9	62.5	54.1	51.7	54.2	47.1	39.2	33.5	19.3
21:00 - 22:00	57.3	81.4	34.8	62.5	59.0	54.3	53.3	53.9	48.7	43.1	32.1	19.2
22:00 - 23:00	53.4	83.5	30.2	55.7	50.9	48.8	47.7	51.2	44.7	34.1	25.5	15.6

NIGHT TIME NOISE LEVELS 23:00 - 07:00 15 MINUTE SAMPLES												
Date / Time	LAeq	LAmaz	LA90	63	125	250	500	1.0 k	2.0 k	4.0 k	8.0 k	16.0 k
23:00 - 23:15	66.3	96.0	30.3	61.1	64.0	65.3	67.4	60.1	56.1	50.8	43.1	29.0
23:15 - 23:30	50.6	75.1	27.4	56.3	46.7	47.0	44.1	48.9	41.0	29.9	24.1	13.0
23:30 - 23:45	48.9	74.0	32.0	55.4	47.5	46.9	45.3	46.0	38.6	30.7	27.8	19.1
23:45 - 00:00	48.5	74.9	29.0	51.5	50.4	47.4	42.2	45.7	40.7	30.2	19.9	10.9
00:00 - 00:15	50.0	78.5	27.8	42.2	41.7	45.0	43.2	48.9	38.1	31.5	23.3	12.2
00:15 - 00:30	45.5	64.2	28.4	48.8	43.6	42.7	40.1	42.1	37.6	33.6	25.4	13.3
00:30 - 00:45	59.3	86.1	30.8	56.9	56.0	56.7	57.7	54.3	50.8	46.2	39.4	21.9
00:45 - 01:00	38.2	63.0	25.8	41.5	39.8	36.7	34.7	34.5	29.1	24.1	17.5	10.6
01:00 - 01:15	41.2	64.5	27.3	47.6	36.8	37.0	34.9	34.4	37.1	28.1	18.3	10.5
01:15 - 01:30	28.5	35.2	27.5	34.3	26.7	27.1	25.9	22.8	19.7	18.7	14.8	10.4
01:30 - 01:45	44.9	72.0	27.3	52.5	42.4	40.1	39.0	43.1	35.2	28.8	23.1	12.0
01:45 - 02:00	28.1	48.9	26.8	41.0	27.9	26.3	25.4	23.1	18.4	17.3	14.1	11.0
02:00 - 02:15	26.3	41.8	25.4	34.8	27.4	26.2	23.9	20.3	16.8	16.1	13.5	9.3
02:15 - 02:30	27.5	49.1	26.5	33.8	26.7	26.5	24.6	21.5	18.9	17.9	14.5	9.9
02:30 - 02:45	42.9	69.6	28.4	40.4	38.4	39.4	36.7	41.3	32.6	24.6	17.9	10.6
02:45 - 03:00	29.8	43.3	28.6	33.8	27.2	27.2	25.8	23.8	22.0	20.8	16.2	11.6
03:00 - 03:15	45.5	73.5	28.7	46.4	43.7	40.0	40.6	43.2	35.8	31.1	26.9	12.1
03:15 - 03:30	41.1	67.3	28.1	40.2	39.7	39.9	36.8	38.4	31.6	24.6	18.0	11.8
03:30 - 03:45	29.3	38.9	28.0	35.4	27.8	27.3	25.4	23.0	21.4	20.3	15.8	11.1
03:45 - 04:00	30.8	39.1	29.1	36.3	29.2	29.9	26.4	24.0	23.2	22.1	17.2	11.2
04:00 - 04:15	38.7	61.4	28.6	46.2	39.1	36.3	34.5	34.8	30.5	25.2	17.9	11.6
04:15 - 04:30	40.1	59.2	30.0	35.2	28.2	30.4	29.4	27.8	33.1	34.8	30.3	10.2
04:30 - 04:45	46.4	69.8	34.4	38.8	37.8	39.3	37.3	40.6	36.4	40.2	36.0	9.8
04:45 - 05:00	47.1	66.7	36.4	47.5	45.1	42.9	45.4	40.2	34.5	39.3	34.5	9.5
05:00 - 05:15	47.9	74.2	35.7	40.1	38.6	40.7	42.5	44.5	37.8	38.4	33.3	10.1
05:15 - 05:30	57.6	80.6	37.8	56.8	51.9	52.1	51.4	55.3	49.3	41.4	34.9	17.1
05:30 - 05:45	58.2	84.9	35.1	51.8	57.1	54.7	52.3	54.5	51.6	44.4	38.0	21.0
05:45 - 06:00	52.7	77.5	36.2	55.8	50.6	48.9	47.7	49.5	44.1	40.4	33.8	17.2
06:00 - 06:15	54.7	75.9	38.5	56.9	51.3	51.7	50.3	52.2	45.8	37.8	28.5	14.2
06:15 - 06:30	55.0	77.2	35.1	62.2	53.6	50.9	50.1	52.3	44.6	42.2	39.3	25.5
06:30 - 06:45	56.9	77.8	38.4	59.1	54.5	53.0	51.5	54.6	48.0	38.6	31.5	20.8
06:45 - 07:00	54.9	76.7	36.6	56.4	51.7	51.4	48.9	52.8	45.8	36.3	27.7	24.3

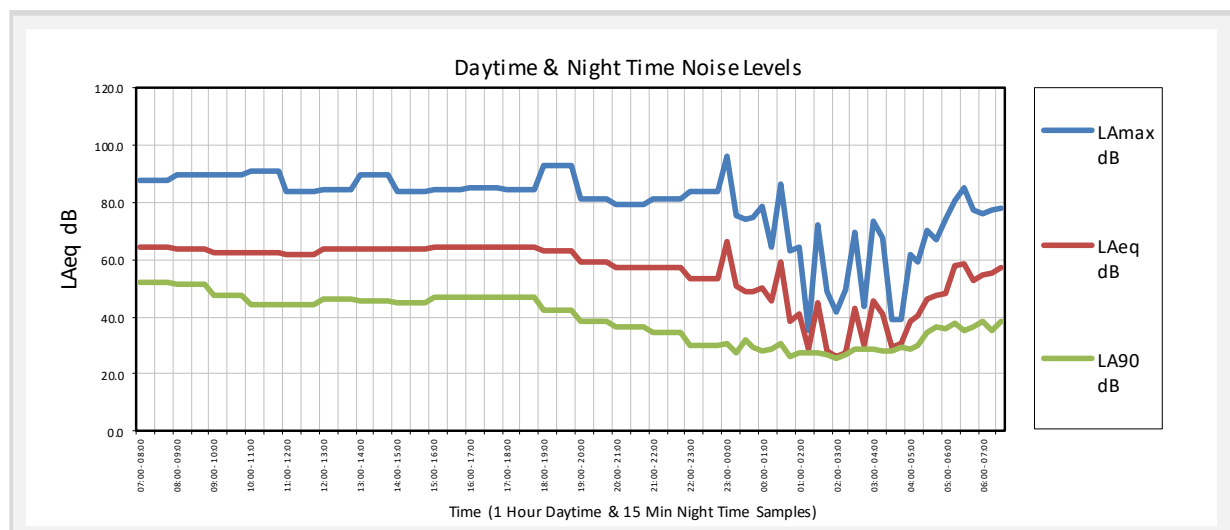


23.4 8th – 9th July 2023 – Position 1

NOISE LEVEL SUMMARY ASSESSMENT				Octave Band Centre Frequency (Hz)								
Date / Time	LAeq	LAmaz	LA90	63	125	250	500	1.0k	2.0k	4.0k	8.0k	16.0k
DAYTIME 07:00 - 23:00 LAeq 16 HOUR & Cor r esponding LAmaz 16 HOUR	59.8	89.9	40.0	62.1	58.2	55.4	53.7	57.2	51.3	44.9	39.4	29.6
NIGHT TIME 23:00 - 07:00 LAeq 8 HOUR & Cor r esponding LAmaz 8 HOUR	51.7	87.4	24.0	51.3	48.2	46.6	45.0	49.2	44.0	35.8	29.6	16.4

DAYTIME NOISE LEVELS 07:00 - 23:00 1 HOUR SAMPLES												
Date / Time	LAeq	LAmaz	LA90	Octave Band Centre Frequency (Hz)								
				63	125	250	500	1.0 k	2.0 k	4.0 k	8.0 k	16.0 k
07:00 - 08:00	57.6	81.3	39.6	60.4	60.6	55.2	52.0	55.1	47.9	40.8	34.0	25.7
08:00 - 09:00	58.0	81.1	40.3	62.5	55.9	53.8	52.7	55.8	48.6	40.5	33.0	26.2
09:00 - 10:00	60.3	79.9	48.6	61.9	56.6	54.8	53.6	57.8	52.3	46.1	39.9	26.9
10:00 - 11:00	60.8	89.9	45.7	63.1	58.2	55.7	55.6	58.1	52.3	45.7	41.3	28.9
11:00 - 12:00	61.6	82.8	44.9	63.3	58.7	56.7	55.4	59.5	52.8	44.5	37.9	31.6
12:00 - 13:00	60.6	78.9	44.3	62.0	59.4	56.1	54.2	58.4	51.8	43.7	39.1	25.0
13:00 - 14:00	60.3	83.7	43.2	63.5	61.0	57.5	54.9	57.8	50.9	43.1	35.5	31.5
14:00 - 15:00	60.9	80.4	44.8	62.6	58.4	56.6	55.0	58.4	52.4	45.9	39.0	28.7
15:00 - 16:00	58.9	79.9	40.1	64.1	61.9	56.2	53.3	56.5	49.2	40.9	34.1	33.5
16:00 - 17:00	60.0	82.2	41.3	64.6	59.1	57.8	55.3	57.3	50.7	43.5	36.4	23.5
17:00 - 18:00	60.2	80.9	42.3	62.1	58.9	56.3	54.2	58.2	50.6	40.5	40.8	31.9
18:00 - 19:00	60.7	82.9	46.6	62.6	57.1	56.0	54.4	58.4	52.3	45.4	39.2	29.1
19:00 - 20:00	61.9	81.1	54.3	61.1	56.0	53.9	53.7	57.6	55.6	52.0	46.7	34.5
20:00 - 21:00	57.9	81.9	39.9	58.5	53.3	52.3	51.0	55.1	50.4	44.5	38.6	27.9
21:00 - 22:00	54.7	77.8	35.6	55.5	50.0	49.8	47.9	52.3	46.9	38.8	31.5	20.3
22:00 - 23:00	54.4	80.5	32.3	54.5	50.2	48.9	46.8	52.2	46.4	38.7	31.9	21.3

NIGHT TIME NOISE LEVELS 23:00 - 07:00 15 MINUTE SAMPLES												
Date / Time	LAeq	LAmaz	LA90	Octave Band Centre Frequency (Hz)								
				63	125	250	500	1.0 k	2.0 k	4.0 k	8.0 k	16.0 k
23:00 - 23:15	48.6	71.1	26.8	49.3	45.6	43.7	41.5	46.4	40.6	31.2	23.5	11.8
23:15 - 23:30	52.7	76.2	29.2	49.4	47.8	47.5	45.5	50.7	44.2	34.5	26.5	13.5
23:30 - 23:45	54.2	77.4	28.9	53.5	47.5	47.9	47.2	52.4	45.5	35.8	27.9	14.9
23:45 - 00:00	51.0	74.2	29.0	52.8	47.7	46.7	44.9	48.6	43.0	33.7	24.2	12.1
00:00 - 00:15	54.5	78.0	31.6	51.4	47.8	48.9	47.1	52.6	45.9	37.6	30.3	16.9
00:15 - 00:30	54.3	78.4	33.7	51.6	48.4	48.9	47.1	52.6	45.3	34.7	26.9	13.8
00:30 - 00:45	28.1	50.3	24.6	35.6	28.4	25.2	23.7	23.5	19.5	17.9	15.1	10.3
00:45 - 01:00	30.1	49.6	28.1	44.3	30.8	25.9	26.1	26.2	20.5	18.6	15.5	9.2
01:00 - 01:15	48.0	69.6	29.6	51.3	46.5	44.3	42.1	45.3	40.2	33.2	26.1	12.7
01:15 - 01:30	47.9	76.0	26.3	39.2	37.0	41.1	39.8	46.3	39.6	29.2	21.1	11.0
01:30 - 01:45	29.0	59.9	25.0	36.7	29.2	24.7	24.8	24.8	20.3	18.3	16.2	8.9
01:45 - 02:00	49.2	77.3	24.1	40.0	40.3	43.2	41.1	47.7	40.0	28.2	19.5	9.9
02:00 - 02:15	27.4	47.2	24.3	35.9	28.0	23.2	24.0	22.6	19.0	17.4	14.9	9.0
02:15 - 02:30	27.8	50.8	24.3	35.9	27.3	23.1	22.5	22.9	20.2	18.4	15.5	9.0
02:30 - 02:45	27.8	43.8	24.3	37.1	27.2	22.4	22.2	21.6	20.9	19.2	16.3	9.2
02:45 - 03:00	26.6	47.0	23.3	36.0	27.2	21.5	21.1	20.4	19.5	18.4	15.3	9.0
03:00 - 03:15	25.9	50.5	22.7	34.4	27.0	21.5	20.7	19.8	18.3	17.7	15.3	8.9
03:15 - 03:30	29.1	45.9	25.0	38.1	35.2	33.0	24.6	19.6	19.2	17.2	14.8	8.8
03:30 - 03:45	44.0	71.6	24.3	39.4	39.4	39.4	38.3	41.9	35.2	28.1	21.6	9.7
03:45 - 04:00	28.6	59.2	24.1	36.2	28.9	24.7	23.9	22.3	21.0	19.9	17.1	9.6
04:00 - 04:15	50.0	75.6	25.5	51.2	44.9	44.8	43.4	47.8	41.9	32.3	24.2	12.0
04:15 - 04:30	37.1	54.7	28.3	36.5	34.8	27.3	30.2	22.3	33.7	27.2	23.4	9.9
04:30 - 04:45	36.2	53.3	30.4	35.3	29.1	23.9	31.6	24.4	27.6	30.9	25.5	10.8
04:45 - 05:00	46.6	70.8	36.8	46.8	43.9	43.0	43.1	41.8	36.9	37.5	33.4	10.4
05:00 - 05:15	47.8	75.2	34.3	38.8	38.1	39.7	41.8	45.3	38.8	35.4	31.0	9.5
05:15 - 05:30	58.7	87.4	36.9	54.0	58.8	55.7	52.0	51.9	53.8	47.4	41.3	23.9
05:30 - 05:45	57.4	82.4	34.5	49.4	47.7	49.3	49.5	55.4	50.0	39.1	32.9	16.3
05:45 - 06:00	59.2	81.3	34.0	53.3	50.8	52.5	51.3	57.6	50.8	37.8	28.6	15.2
06:00 - 06:15	46.4	66.2	33.6	46.6	40.9	39.6	46.2	41.3	36.8	30.2	21.9	9.3
06:15 - 06:30	55.1	78.3	33.8	51.4	49.9	50.3	49.0	53.3	46.0	35.1	27.4	28.3
06:30 - 06:45	56.3	78.8	38.4	63.1	56.5	52.4	50.7	53.8	47.1	37.8	31.0	15.4
06:45 - 07:00	51.7	72.3	35.5	54.1	50.6	48.5	47.0	48.6	42.8	37.9	33.5	11.5

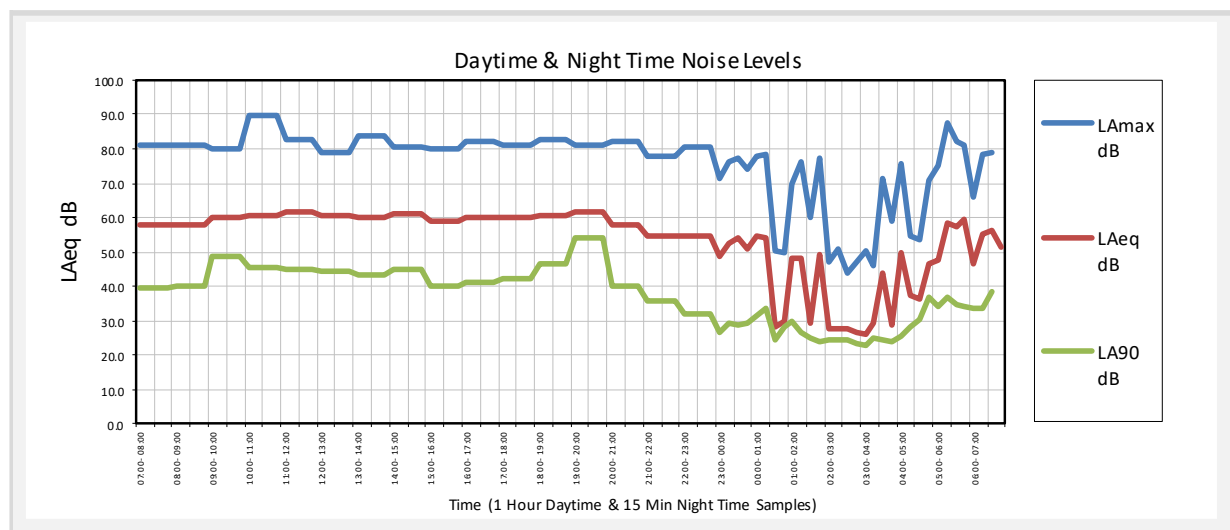


23.5 9th – 10th July 2023 – Position 1

NOISE LEVEL SUMMARY ASSESSMENT				Octave Band Centre Frequency (Hz)								
Date / Time	LAeq	LAmaz	LA90	63	125	250	500	1.0k	2.0k	4.0k	8.0k	16.0k
DAYTIME 07:00 - 23:00 LAeq 16 HOUR & Corresponding LAmaz 16 HOUR	59.3	94.5	43.0	63.0	61.2	57.9	54.3	56.7	49.5	41.7	36.3	28.6
NIGHT TIME 23:00 - 07:00 LAeq 8 HOUR & Corresponding LAmaz 8 HOUR	53.8	92.3	22.0	56.2	53.1	52.1	48.2	50.5	46.0	39.0	33.3	17.2

DAYTIME NOISE LEVELS 07:00 - 23:00 1 HOUR SAMPLES												
Date / Time	LAeq	LAmaz	LA90	Octave Band Centre Frequency (Hz)								
				63	125	250	500	1.0 k	2.0 k	4.0 k	8.0 k	16.0 k
07:00 - 08:00	54.8	80.9	36.4	60.4	51.6	49.8	49.0	52.6	46.1	37.4	30.4	26.3
08:00 - 09:00	57.5	80.1	40.0	63.3	57.2	53.3	52.1	55.2	48.5	40.2	33.6	30.7
09:00 - 10:00	59.3	83.4	42.2	60.2	57.0	54.1	54.0	57.1	50.1	41.7	36.9	29.9
10:00 - 11:00	59.7	80.2	41.7	63.6	57.8	55.2	53.7	57.7	50.1	42.3	36.0	26.7
11:00 - 12:00	62.7	94.5	42.8	64.4	67.8	63.8	57.3	59.6	52.0	43.1	39.7	31.6
12:00 - 13:00	61.2	84.8	43.3	67.0	61.6	58.1	56.4	59.0	51.1	42.1	34.5	29.8
13:00 - 14:00	60.2	79.5	43.9	63.9	61.6	57.8	55.2	57.8	50.3	43.0	34.1	30.1
14:00 - 15:00	59.8	78.5	42.6	62.4	59.5	57.0	54.4	57.6	50.0	41.1	34.4	31.2
15:00 - 16:00	61.0	83.5	46.4	65.1	61.5	58.9	56.4	57.9	51.9	46.9	43.4	32.5
16:00 - 17:00	60.7	83.1	43.8	65.6	64.4	62.0	55.2	57.8	50.0	41.8	34.0	28.1
17:00 - 18:00	59.5	81.8	44.4	61.3	61.8	56.3	53.6	57.1	50.3	42.5	37.7	26.9
18:00 - 19:00	59.4	82.9	46.3	63.6	61.8	57.6	54.3	57.0	49.5	41.0	35.8	24.6
19:00 - 20:00	59.3	87.3	40.0	62.5	62.2	60.1	55.2	55.8	49.5	42.7	34.4	21.6
20:00 - 21:00	53.8	77.4	36.1	55.6	50.4	49.6	48.7	51.6	45.0	34.9	26.3	24.7
21:00 - 22:00	55.9	85.0	32.9	58.9	54.8	54.1	54.2	52.4	45.2	35.2	28.1	13.8
22:00 - 23:00	50.9	79.0	28.4	53.4	49.4	47.5	46.9	48.5	41.6	31.2	22.7	11.0

NIGHT TIME NOISE LEVELS 23:00 - 07:00 15 MINUTE SAMPLES												
Date / Time	LAeq	LAmaz	LA90	Octave Band Centre Frequency (Hz)								
				63	125	250	500	1.0 k	2.0 k	4.0 k	8.0 k	16.0 k
23:00 - 23:15	45.8	74.2	24.3	42.8	40.5	40.1	38.7	44.5	35.3	23.1	15.9	9.2
23:15 - 23:30	48.1	75.2	25.2	45.7	41.5	43.5	43.3	46.5	37.1	25.1	18.2	10.1
23:30 - 23:45	43.6	66.9	24.2	50.3	41.4	39.8	37.6	39.7	37.7	28.9	18.7	10.1
23:45 - 00:00	47.4	74.9	22.7	44.3	39.9	39.8	39.7	45.3	39.3	31.1	25.6	13.5
00:00 - 00:15	48.8	77.2	22.8	44.6	40.4	41.1	42.3	46.7	40.4	31.2	24.5	12.1
00:15 - 00:30	26.1	38.5	22.2	35.9	35.3	27.6	21.8	19.2	15.4	13.0	12.7	9.1
00:30 - 00:45	39.4	65.5	25.3	40.5	37.4	36.8	33.9	37.0	30.2	19.6	14.2	9.2
00:45 - 01:00	45.3	72.9	22.4	38.4	39.3	40.4	39.2	43.9	34.9	23.2	15.8	8.7
01:00 - 01:15	25.7	44.0	23.0	33.7	28.3	28.1	23.9	18.6	13.3	13.9	13.0	9.2
01:15 - 01:30	40.4	64.0	23.9	46.5	36.1	35.1	32.7	33.3	36.6	27.7	17.1	9.2
01:30 - 01:45	24.0	37.1	21.7	34.5	29.3	26.0	21.5	17.8	12.3	12.6	12.6	9.3
01:45 - 02:00	40.7	66.4	21.5	46.2	40.8	38.4	36.4	38.0	30.9	22.8	17.1	8.9
02:00 - 02:15	41.1	66.8	22.3	42.6	40.7	38.5	37.3	38.5	31.2	24.8	18.9	9.3
02:15 - 02:30	22.4	33.9	21.5	34.0	25.7	22.1	20.1	16.4	12.4	12.7	12.5	8.4
02:30 - 02:45	48.0	73.9	24.4	43.8	43.5	43.4	41.5	46.5	38.4	27.8	20.1	9.3
02:45 - 03:00	45.4	71.7	22.6	40.6	40.0	40.9	39.4	43.9	35.3	22.7	15.6	8.5
03:00 - 03:15	22.6	36.7	21.7	33.3	26.4	21.8	19.1	17.5	13.2	13.0	12.7	8.3
03:15 - 03:30	23.3	37.6	22.0	34.6	27.9	25.3	19.6	17.3	13.1	12.9	12.7	8.3
03:30 - 03:45	23.3	40.3	22.0	34.5	25.9	21.7	20.6	17.6	13.5	14.2	13.3	8.4
03:45 - 04:00	40.8	66.8	22.1	44.4	39.2	38.7	36.8	38.7	30.0	20.2	14.6	8.7
04:00 - 04:15	42.8	69.8	22.9	49.8	40.9	39.2	40.0	39.5	33.9	27.9	19.5	9.6
04:15 - 04:30	44.5	68.4	29.6	43.7	42.8	40.4	38.9	39.7	38.7	31.7	25.8	9.2
04:30 - 04:45	52.0	78.3	33.7	56.8	50.2	47.1	48.0	48.8	43.8	37.9	32.0	16.4
04:45 - 05:00	53.4	78.6	32.5	53.1	53.7	47.9	48.5	51.0	44.5	36.0	29.4	11.6
05:00 - 05:15	47.7	74.4	34.0	41.4	38.8	40.8	45.4	44.4	38.7	32.9	26.9	13.4
05:15 - 05:30	63.2	92.3	37.7	60.3	60.9	58.0	56.3	58.2	58.0	51.6	45.7	29.3
05:30 - 05:45	58.5	81.5	34.5	56.9	51.0	51.3	51.4	56.8	49.6	40.0	35.3	14.2
05:45 - 06:00	55.1	77.2	38.2	58.4	55.0	52.3	50.0	52.2	46.4	40.3	32.4	20.9
06:00 - 06:15	54.8	75.8	39.9	57.3	53.4	51.4	50.3	52.2	45.6	38.8	30.5	14.4
06:15 - 06:30	57.4	76.6	40.0	60.9	55.2	53.5	52.0	54.9	48.3	42.4	38.5	17.2
06:30 - 06:45	61.0	85.1	40.9	65.4	62.5	64.3	56.0	57.0	50.5	42.4	38.8	21.4
06:45 - 07:00	61.7	85.6	45.5	66.6	62.9	59.8	56.9	59.1	52.2	44.2	37.1	22.2

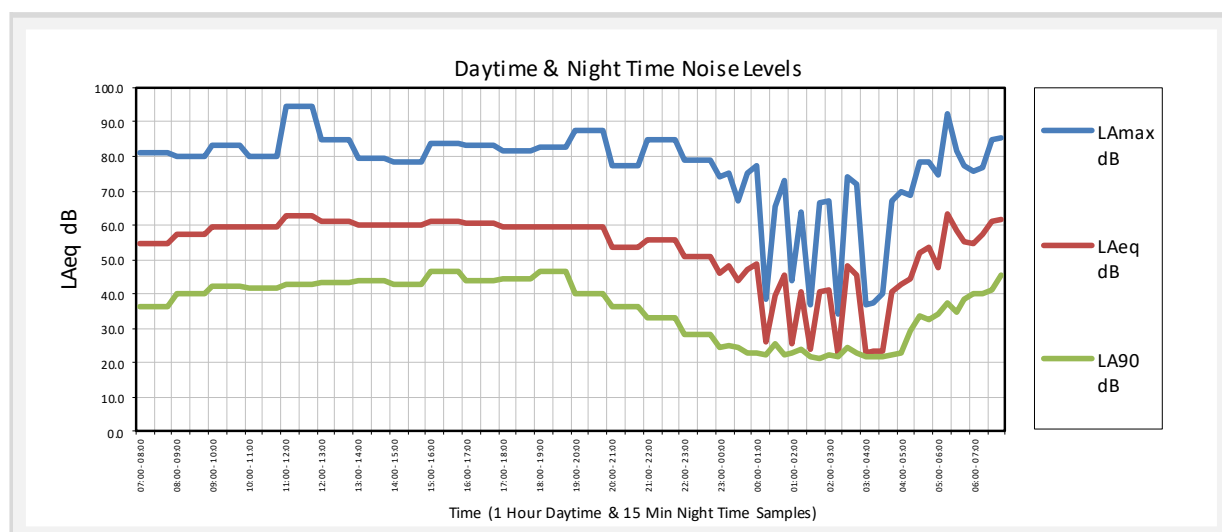


23.6 5th – 6th July 2023 – Position 2

NOISE LEVEL SUMMARY ASSESSMENT				Octave Band Centre Frequency (Hz)								
Date / Time	LAeq	LAmx	LA90	63	125	250	500	1.0k	2.0k	4.0k	8.0k	16.0k
DAYTIME 07:00 - 23:00 LAeq 16 HOUR & Cor r esponding LAmx 16 HOUR	55.3	89.4	48.0	60.9	54.2	51.1	50.1	52.0	47.2	43.4	38.8	25.5
NIGHT TIME 23:00 - 07:00 LAeq 8 HOUR & Cor r esponding LAmx 8 HOUR	46.3	73.1	37.0	50.4	43.3	44.1	41.9	42.7	38.0	35.4	29.5	11.6

DAYTIME NOISE LEVELS 07:00 - 23:00 1 HOUR SAMPLES												
Date / Time	LAeq	LAmx	LA90	Octave Band Centre Frequency (Hz)								
				63	125	250	500	1.0 k	2.0 k	4.0 k	8.0 k	16.0 k
07:00 - 08:00	56.1	56.8	49.6	62.5	56.9	51.8	51.1	53.4	47.5	41.3	34.8	17.4
08:00 - 09:00	58.1	75.0	52.9	64.4	56.2	52.4	51.9	54.3	51.6	46.9	40.0	26.6
09:00 - 10:00	55.3	72.9	49.5	62.5	54.9	50.5	49.9	52.3	47.0	43.7	39.0	26.3
10:00 - 11:00	55.0	80.0	47.8	60.7	52.6	49.7	49.8	50.9	46.8	46.1	42.5	28.0
11:00 - 12:00	54.2	69.7	47.9	59.1	52.5	51.2	49.1	51.1	45.3	43.0	37.6	23.7
12:00 - 13:00	55.9	81.7	49.0	62.1	54.4	50.8	50.3	51.9	48.4	46.5	42.7	30.2
13:00 - 14:00	58.1	89.4	49.7	62.7	57.6	54.9	52.1	53.1	51.6	48.6	45.0	29.8
14:00 - 15:00	55.1	70.4	48.0	61.3	54.9	52.3	51.0	52.2	46.0	39.9	35.2	25.4
15:00 - 16:00	55.9	76.9	47.8	60.6	54.5	51.8	51.1	53.5	46.9	40.1	34.7	27.4
16:00 - 17:00	57.0	72.0	49.0	61.7	55.1	51.9	51.6	54.8	48.1	41.0	36.0	26.2
17:00 - 18:00	56.6	73.6	48.1	62.6	55.7	51.3	51.0	54.3	47.8	41.4	36.7	21.7
18:00 - 19:00	54.4	72.4	45.6	59.0	52.4	48.9	49.5	51.7	45.7	41.1	35.7	23.0
19:00 - 20:00	52.2	78.4	44.1	58.8	52.5	50.0	49.1	48.3	42.5	41.2	34.5	18.3
20:00 - 21:00	51.0	68.8	45.0	54.6	47.5	48.3	47.6	46.9	42.1	41.2	34.6	16.6
21:00 - 22:00	49.1	73.2	43.4	52.7	45.3	47.3	45.4	45.8	40.8	34.2	29.8	13.7
22:00 - 23:00	46.8	67.7	42.4	49.4	43.6	46.7	42.9	43.4	38.6	29.5	21.7	12.0

NIGHT TIME NOISE LEVELS 23:00 - 07:00 15 MINUTE SAMPLES												
Date / Time	LAeq	LAmx	LA90	Octave Band Centre Frequency (Hz)								
				63	125	250	500	1.0 k	2.0 k	4.0 k	8.0 k	16.0 k
23:00 - 23:15	44.0	61.5	41.5	47.8	41.4	45.7	40.8	40.3	33.6	24.9	17.8	9.5
23:15 - 23:30	46.2	60.4	42.6	47.8	42.9	46.8	42.5	43.1	36.3	26.4	18.7	9.5
23:30 - 23:45	47.0	67.0	40.7	47.7	42.6	46.2	42.1	41.9	41.7	32.2	21.4	9.7
23:45 - 00:00	43.8	63.4	37.2	44.1	39.0	41.9	39.0	41.5	34.4	24.3	17.5	9.5
00:00 - 00:15	42.2	62.6	36.7	44.5	39.4	42.5	37.8	39.1	33.4	25.6	19.9	9.8
00:15 - 00:30	43.1	65.6	36.8	42.6	38.4	42.0	38.0	40.8	33.9	24.5	18.3	9.4
00:30 - 00:45	37.2	49.6	36.0	39.6	36.7	41.0	35.5	31.7	25.5	21.2	16.0	9.9
00:45 - 01:00	36.6	46.9	35.0	39.7	36.4	41.3	35.1	30.6	24.5	19.9	14.4	9.2
01:00 - 01:15	42.7	63.9	35.1	48.5	38.3	42.4	37.9	37.7	37.2	28.3	18.2	9.6
01:15 - 01:30	39.6	61.4	36.8	40.6	37.6	42.2	36.9	36.0	28.4	22.5	16.0	9.3
01:30 - 01:45	38.5	57.3	34.9	42.3	37.7	42.2	35.6	34.3	27.9	21.2	15.0	10.0
01:45 - 02:00	36.1	56.9	34.6	39.6	36.4	41.5	34.0	30.1	24.4	20.4	14.9	9.4
02:00 - 02:15	36.2	47.0	35.0	40.0	36.1	42.0	34.1	29.5	23.7	20.5	14.3	9.1
02:15 - 02:30	43.2	62.5	36.8	50.9	41.8	45.8	38.8	39.9	32.8	24.1	16.6	9.3
02:30 - 02:45	39.9	42.1	39.4	42.4	39.9	45.0	38.3	33.6	27.6	23.6	17.5	9.6
02:45 - 03:00	40.0	55.7	39.5	42.4	39.6	44.7	38.4	33.7	29.0	23.4	18.5	9.6
03:00 - 03:15	40.2	47.7	39.5	42.5	39.9	45.1	38.7	34.2	27.8	22.9	17.3	9.3
03:15 - 03:30	37.9	46.9	36.9	40.9	37.7	42.7	36.5	31.5	25.7	21.6	16.0	9.3
03:30 - 03:45	38.4	46.6	37.4	40.9	38.0	43.2	36.7	32.3	26.3	21.9	15.6	9.2
03:45 - 04:00	39.4	58.9	37.2	42.8	38.3	42.3	37.1	35.1	28.8	22.3	16.0	9.6
04:00 - 04:15	39.4	57.5	37.3	41.8	38.5	43.2	37.0	34.4	29.7	23.7	18.3	16.9
04:15 - 04:30	39.8	56.4	36.6	39.2	36.3	41.3	34.5	30.4	31.4	33.4	31.2	10.5
04:30 - 04:45	42.2	59.7	38.0	42.9	37.7	42.4	38.4	34.5	30.9	36.6	32.5	10.8
04:45 - 05:00	46.3	64.6	40.3	45.8	39.6	42.8	42.0	41.0	37.7	39.5	33.2	11.4
05:00 - 05:15	46.3	65.6	40.4	45.6	40.3	42.6	42.5	40.8	38.0	39.4	32.8	11.7
05:15 - 05:30	50.1	69.8	38.9	51.8	46.4	45.9	44.0	46.9	43.2	37.7	30.9	11.1
05:30 - 05:45	49.8	65.5	38.9	51.3	43.0	44.1	44.5	47.1	41.4	37.3	35.2	13.5
05:45 - 06:00	51.1	73.1	40.5	52.7	45.3	44.4	49.8	46.8	42.1	38.6	33.6	14.1
06:00 - 06:15	51.0	68.6	41.3	59.0	48.6	46.6	45.6	47.5	43.0	41.0	34.5	13.4
06:15 - 06:30	51.1	63.2	42.9	54.8	47.1	45.1	45.5	47.2	42.1	43.4	37.2	16.0
06:30 - 06:45	51.7	63.1	43.0	57.4	50.3	45.2	45.9	48.7	42.8	42.1	35.4	15.4
06:45 - 07:00	53.2	71.8	42.5	58.1	51.6	47.8	47.1	50.3	45.6	40.5	33.0	13.7

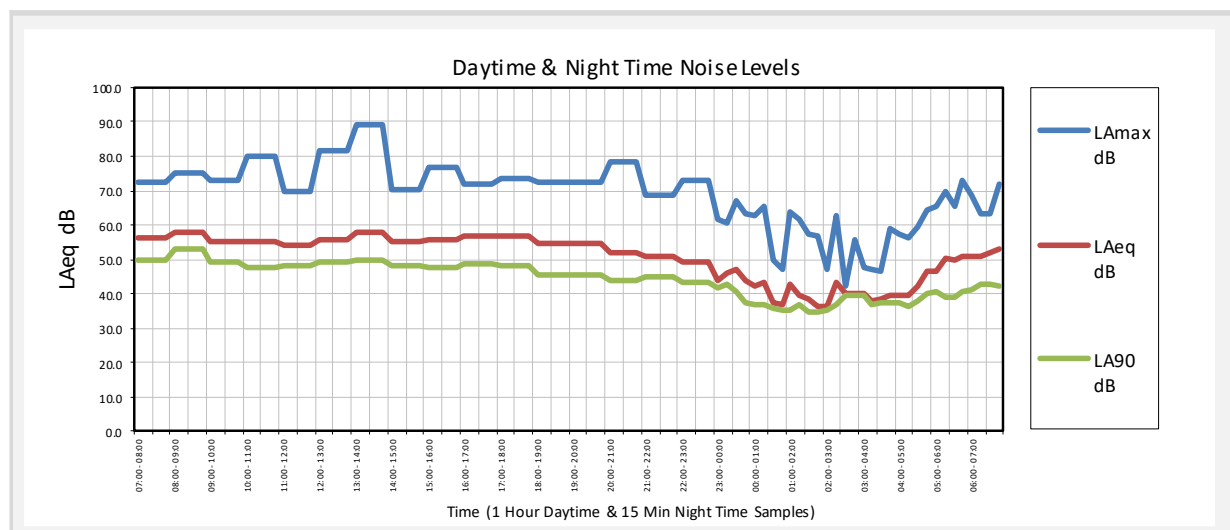


23.7 6th – 7th July 2023 – Position 2

NOISE LEVEL SUMMARY ASSESSMENT				Octave Band Centre Frequency (Hz)								
Date / Time	LAeq	LAmaz	LA90	63	125	250	500	1.0k	2.0k	4.0k	8.0k	16.0k
DAYTIME 07:00 - 23:00 LAeq 16 HOUR & Cor r esponding LAmaz 16 HOUR	54.6	89.6	47.0	60.9	54.5	50.3	49.7	51.5	46.4	42.0	37.3	24.1
NIGHT TIME 23:00 - 07:00 LAeq 8 HOUR & Cor r esponding LAmaz 8 HOUR	46.0	76.9	37.0	50.1	43.9	42.7	41.6	41.9	38.4	36.1	30.7	12.7

DAYTIME NOISE LEVELS 07:00 - 23:00 1 HOUR SAMPLES												
Date / Time	LAeq	LAmaz	LA90	Octave Band Centre Frequency (Hz)								
				63	125	250	500	1.0 k	2.0 k	4.0 k	8.0 k	16.0 k
07:00 - 08:00	54.9	71.9	46.9	62.9	56.9	50.9	50.0	52.1	46.1	40.1	34.7	15.5
08:00 - 09:00	55.6	73.4	49.2	64.2	54.7	51.2	50.5	52.8	47.1	42.9	36.9	19.1
09:00 - 10:00	55.8	80.3	48.6	62.4	56.0	52.4	51.2	52.5	47.4	43.4	38.6	27.1
10:00 - 11:00	56.7	89.6	51.2	61.0	58.3	52.8	51.5	51.7	50.4	46.6	40.5	27.1
11:00 - 12:00	53.8	72.2	47.0	61.4	54.6	50.4	48.9	50.5	45.7	40.8	36.2	21.6
12:00 - 13:00	54.2	72.0	46.2	60.4	53.2	50.2	49.3	50.8	45.8	43.0	38.4	24.2
13:00 - 14:00	53.9	69.8	45.7	59.9	53.3	48.5	48.2	50.7	45.6	42.5	39.8	26.6
14:00 - 15:00	54.9	75.2	46.7	60.8	53.5	50.1	49.8	51.9	46.5	42.6	38.9	27.3
15:00 - 16:00	56.1	80.7	47.8	61.8	54.7	51.6	51.3	53.2	47.8	42.8	39.0	25.9
16:00 - 17:00	57.0	74.2	49.0	62.7	57.2	52.5	51.7	54.5	48.0	41.9	36.9	24.6
17:00 - 18:00	56.8	78.2	48.7	63.6	56.2	51.4	51.3	54.2	48.3	42.6	38.2	25.9
18:00 - 19:00	54.8	69.4	46.7	59.4	52.2	50.0	50.0	52.1	45.7	41.8	36.8	21.7
19:00 - 20:00	53.0	74.8	45.2	57.9	52.3	47.9	48.7	49.4	45.2	41.2	37.5	24.6
20:00 - 21:00	50.2	68.9	43.5	52.0	46.6	45.4	47.0	46.8	41.9	38.2	31.8	15.0
21:00 - 22:00	48.2	68.1	41.5	51.3	45.2	44.1	45.2	45.1	39.4	32.5	29.3	11.8
22:00 - 23:00	46.3	65.3	40.3	51.7	44.9	43.7	42.7	43.5	37.5	28.4	22.9	13.9

NIGHT TIME NOISE LEVELS 23:00 - 07:00 15 MINUTE SAMPLES												
Date / Time	LAeq	LAmaz	LA90	Octave Band Centre Frequency (Hz)								
				63	125	250	500	1.0 k	2.0 k	4.0 k	8.0 k	16.0 k
23:00 - 23:15	40.5	58.5	37.0	43.9	40.5	40.5	39.0	36.3	30.8	24.3	22.6	10.9
23:15 - 23:30	41.7	60.0	37.4	43.8	40.3	40.0	39.6	38.7	31.2	21.7	15.3	9.3
23:30 - 23:45	46.5	65.4	36.9	54.6	42.3	40.9	41.3	42.5	41.0	30.9	18.9	9.4
23:45 - 00:00	39.4	56.6	36.0	43.8	39.2	38.7	38.8	35.3	28.2	20.5	14.5	9.3
00:00 - 00:15	42.4	59.8	35.1	45.1	39.8	39.5	38.9	39.7	33.8	22.8	15.5	9.2
00:15 - 00:30	37.3	53.4	35.6	40.9	38.5	38.6	37.5	31.8	25.2	19.2	14.0	9.7
00:30 - 00:45	37.1	48.0	36.2	40.6	38.7	39.4	37.8	29.8	24.4	19.3	14.9	9.5
00:45 - 01:00	37.5	45.5	36.2	41.0	39.1	38.9	38.0	30.5	25.5	23.5	20.4	10.2
01:00 - 01:15	44.7	65.6	37.0	47.1	41.9	41.9	40.1	39.8	39.2	30.6	23.0	10.5
01:15 - 01:30	37.8	45.2	37.2	41.6	39.7	40.5	38.1	31.0	24.9	21.1	16.8	9.8
01:30 - 01:45	44.7	68.2	36.6	43.6	39.9	41.3	40.1	42.8	34.8	25.3	19.3	10.2
01:45 - 02:00	37.2	43.1	36.5	41.1	39.1	40.3	37.8	30.1	23.7	18.6	13.7	9.3
02:00 - 02:15	38.2	57.6	35.0	43.7	38.5	38.2	37.5	33.8	27.2	21.6	15.6	9.4
02:15 - 02:30	36.3	45.3	34.7	40.3	38.1	37.8	37.2	29.4	23.0	18.7	13.9	9.7
02:30 - 02:45	38.7	57.3	35.2	43.5	39.1	38.2	37.9	34.3	27.4	22.8	18.5	9.7
02:45 - 03:00	36.7	45.7	35.3	40.5	38.1	39.0	37.4	30.0	23.0	18.3	13.2	9.8
03:00 - 03:15	39.2	63.9	35.7	40.9	38.3	39.5	37.4	33.7	32.4	21.4	13.7	9.2
03:15 - 03:30	35.6	45.4	34.2	39.6	37.1	38.5	36.5	28.1	21.6	17.3	12.9	9.2
03:30 - 03:45	36.1	46.1	34.8	40.1	37.7	38.8	37.0	28.9	22.1	17.6	13.0	9.1
03:45 - 04:00	37.5	45.6	37.0	41.1	38.9	39.4	38.6	30.6	23.7	18.3	14.2	9.1
04:00 - 04:15	41.9	60.4	37.3	45.6	41.7	41.3	40.0	38.5	31.9	23.8	17.7	9.3
04:15 - 04:30	42.3	60.3	37.6	44.3	41.6	40.5	39.7	37.7	32.3	32.6	30.3	17.0
04:30 - 04:45	47.9	68.3	40.8	43.0	40.2	40.4	40.1	38.8	42.9	41.6	37.2	20.4
04:45 - 05:00	45.9	64.0	41.6	43.1	39.4	40.9	41.5	34.8	39.4	40.5	35.0	13.2
05:00 - 05:15	46.1	62.0	42.8	52.6	44.0	43.7	44.0	37.3	36.5	40.4	33.3	11.8
05:15 - 05:30	52.6	76.9	41.0	51.7	49.5	47.4	46.8	47.4	47.4	41.6	35.6	15.5
05:30 - 05:45	47.7	67.0	38.9	48.4	41.9	42.0	43.3	44.4	38.5	38.3	33.2	11.0
05:45 - 06:00	49.8	66.4	41.4	57.4	44.8	43.1	44.3	46.7	40.4	41.2	33.1	12.1
06:00 - 06:15	50.8	72.0	43.5	54.3	45.6	45.9	44.7	47.1	41.3	42.3	40.5	17.0
06:15 - 06:30	50.9	67.8	43.4	54.2	48.3	47.6	45.7	46.8	43.1	42.2	33.8	13.4
06:30 - 06:45	50.2	64.8	43.8	56.5	50.0	46.1	44.9	47.0	41.0	40.1	33.2	12.9
06:45 - 07:00	52.9	69.7	44.3	57.9	52.9	50.6	47.4	49.8	45.0	39.5	32.3	17.5

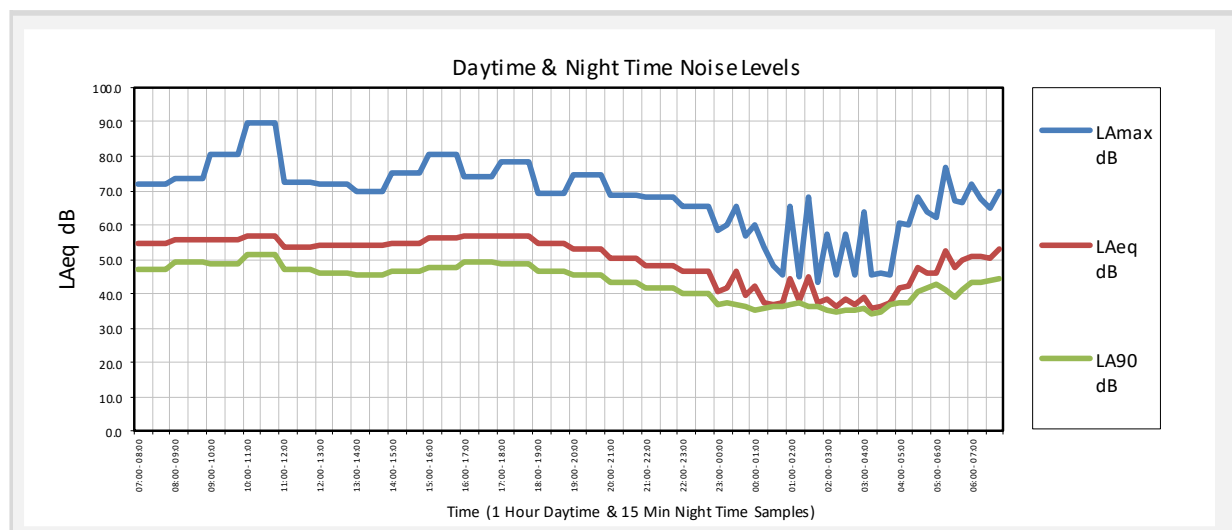


23.8 7th – 8th July 2023 – Position 2

NOISE LEVEL SUMMARY ASSESSMENT				Octave Band Centre Frequency (Hz)								
Date / Time	LAeq	LAmaz	LA90	63	125	250	500	1.0k	2.0k	4.0k	8.0k	16.0k
DAYTIME 07:00 - 23:00 LAeq 16 HOUR & Cor r esponding LAmaz 16 HOUR	54.0	81.2	47.0	60.0	54.0	50.0	49.2	50.6	45.5	43.2	36.7	31.4
NIGHT TIME 23:00 - 07:00 LAeq 8 HOUR & Cor r esponding LAmaz 8 HOUR	47.5	79.0	40.0	49.4	45.5	44.9	45.6	42.3	38.7	37.6	31.9	16.7

DAYTIME NOISE LEVELS 07:00 - 23:00 1 HOUR SAMPLES												
Date / Time	LAeq	LAmaz	LA90	63	125	250	500	1.0 k	2.0 k	4.0 k	8.0 k	16.0 k
07:00 - 08:00	54.9	71.9	47.1	61.8	55.0	50.3	49.7	51.8	46.1	43.8	36.9	17.6
08:00 - 09:00	54.7	70.3	47.4	61.9	54.0	49.9	49.7	51.2	45.2	46.3	38.6	25.4
09:00 - 10:00	56.3	79.5	49.0	60.1	54.5	50.3	49.9	51.6	50.2	47.7	39.5	31.4
10:00 - 11:00	53.3	70.3	44.1	59.4	55.7	49.7	48.0	49.0	44.0	45.5	37.5	30.8
11:00 - 12:00	54.1	81.2	46.7	59.0	53.8	51.2	49.5	50.4	45.0	44.5	37.4	28.1
12:00 - 13:00	54.4	74.4	45.6	59.9	54.8	51.2	49.9	51.4	45.5	40.9	34.3	27.0
13:00 - 14:00	54.8	75.3	45.5	59.5	55.6	51.2	50.7	51.4	45.8	43.5	37.3	26.9
14:00 - 15:00	54.8	74.2	46.1	59.8	53.9	50.6	49.4	51.9	46.0	43.7	36.6	34.5
15:00 - 16:00	55.2	75.3	46.8	61.7	54.9	50.8	49.5	52.4	46.0	44.3	36.7	36.4
16:00 - 17:00	54.9	70.8	46.8	60.5	56.1	51.1	49.6	52.3	45.8	39.7	34.3	37.0
17:00 - 18:00	54.8	78.8	46.5	60.6	54.2	51.0	50.8	52.0	45.5	38.8	40.0	35.7
18:00 - 19:00	53.4	79.8	45.4	56.5	50.9	48.9	48.5	50.1	45.0	41.5	38.2	31.5
19:00 - 20:00	51.7	72.7	45.1	58.7	51.4	49.0	48.3	48.0	43.5	37.5	31.6	22.2
20:00 - 21:00	50.9	72.1	45.4	56.0	51.9	47.8	47.0	46.6	42.6	41.3	33.7	17.7
21:00 - 22:00	50.1	75.1	44.1	57.9	51.5	46.9	48.3	45.6	41.5	36.1	29.5	16.4
22:00 - 23:00	49.5	73.7	43.8	61.4	48.9	46.5	46.0	45.5	41.9	35.2	30.2	17.2

NIGHT TIME NOISE LEVELS 23:00 - 07:00 15 MINUTE SAMPLES												
Date / Time	LAeq	LAmaz	LA90	63	125	250	500	1.0 k	2.0 k	4.0 k	8.0 k	16.0 k
23:00 - 23:15	56.3	79.0	43.4	56.5	55.3	53.9	56.1	50.8	47.4	42.3	36.0	19.6
23:15 - 23:30	45.3	57.7	43.2	49.4	44.1	43.7	44.3	41.4	34.6	27.2	22.5	12.0
23:30 - 23:45	44.4	59.2	42.8	49.3	44.6	43.7	43.3	40.0	34.1	28.1	24.6	13.8
23:45 - 00:00	47.9	67.3	42.7	49.9	46.0	44.8	44.4	43.0	41.9	33.4	27.2	14.0
00:00 - 00:15	43.6	62.1	40.6	44.8	42.0	41.4	41.7	40.4	32.8	27.3	22.4	11.8
00:15 - 00:30	45.1	60.3	42.6	52.3	45.0	44.0	43.8	40.3	35.6	29.9	26.1	15.0
00:30 - 00:45	49.8	70.6	40.0	51.2	46.0	46.0	48.4	44.9	41.5	36.4	29.7	16.0
00:45 - 01:00	40.9	52.4	40.0	44.5	41.1	40.6	40.6	35.7	30.2	25.0	20.2	16.7
01:00 - 01:15	46.5	66.7	42.0	48.4	43.9	43.9	43.6	40.8	40.8	32.1	25.2	12.8
01:15 - 01:30	40.5	45.8	40.0	44.0	40.8	40.5	40.0	35.1	30.1	26.0	22.4	11.7
01:30 - 01:45	41.9	61.4	39.7	48.3	41.7	40.9	40.7	37.2	32.4	27.3	24.3	12.7
01:45 - 02:00	41.1	47.9	40.4	45.6	41.6	41.4	40.5	35.8	30.6	25.4	20.9	11.7
02:00 - 02:15	42.2	69.2	41.1	45.4	42.1	42.0	41.0	36.6	33.3	28.8	23.4	12.0
02:15 - 02:30	40.8	47.7	40.2	44.6	41.4	41.4	40.2	35.6	30.3	24.9	20.0	11.5
02:30 - 02:45	41.8	53.1	40.9	45.0	41.8	41.5	40.9	37.0	31.5	26.6	22.2	12.2
02:45 - 03:00	40.5	45.2	39.9	44.2	40.9	40.5	39.7	35.3	30.4	26.3	22.5	12.2
03:00 - 03:15	41.8	56.4	40.2	45.3	41.5	40.9	41.0	37.1	31.6	27.4	23.7	12.8
03:15 - 03:30	42.4	49.3	41.2	45.7	42.8	42.5	42.1	37.0	31.8	27.7	24.3	13.1
03:30 - 03:45	41.2	49.5	40.7	44.4	41.3	41.7	41.1	35.5	30.5	26.1	21.8	12.0
03:45 - 04:00	40.9	48.0	39.4	44.0	40.8	40.9	40.4	35.0	30.7	27.9	25.1	13.3
04:00 - 04:15	42.0	55.2	40.5	45.0	41.1	41.3	42.0	36.1	31.8	27.8	24.9	13.9
04:15 - 04:30	44.9	65.8	41.3	44.5	41.6	42.0	42.4	36.9	38.3	36.0	34.0	15.5
04:30 - 04:45	45.0	56.6	42.2	45.0	41.9	41.7	41.7	36.8	33.3	39.7	36.3	22.0
04:45 - 05:00	45.8	57.0	43.6	47.0	42.9	42.4	42.9	38.2	34.5	40.4	34.6	14.4
05:00 - 05:15	46.1	59.9	44.2	46.6	43.6	43.6	44.5	39.3	35.4	38.9	33.9	12.9
05:15 - 05:30	50.9	69.3	44.5	51.6	46.8	46.5	47.0	47.0	43.2	40.1	34.6	13.9
05:30 - 05:45	48.0	67.8	43.9	48.0	45.1	44.9	45.6	43.4	39.1	38.0	33.2	12.8
05:45 - 06:00	47.9	60.4	44.4	49.3	45.0	44.8	46.1	41.6	36.2	41.5	33.7	14.0
06:00 - 06:15	51.8	70.1	45.4	51.4	46.9	47.9	47.6	46.7	44.1	44.1	36.0	17.1
06:15 - 06:30	49.4	62.9	45.3	54.6	46.1	45.5	46.3	43.7	37.7	43.5	37.0	16.3
06:30 - 06:45	50.7	62.5	45.8	53.0	47.0	46.2	46.5	45.8	40.3	44.1	39.3	23.8
06:45 - 07:00	51.0	68.6	44.9	52.5	48.8	48.3	46.9	46.8	43.2	41.3	35.0	25.3

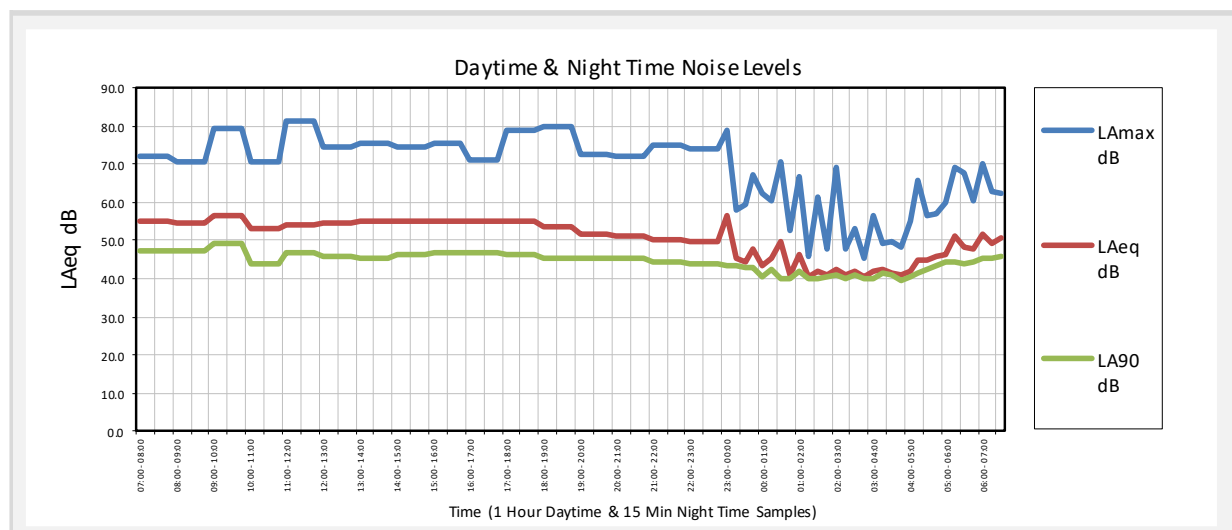


23.9 8th – 9th July 2023 – Position 2

NOISE LEVEL SUMMARY ASSESSMENT				Octave Band Centre Frequency (Hz)								
Date / Time	LAeq	LAmx	LA90	63	125	250	500	1.0k	2.0k	4.0k	8.0k	16.0k
DAYTIME 07:00 - 23:00 LAeq 16 HOUR & Corresponding LAmx 16 HOUR	52.9	88.6	45.0	58.2	51.9	48.4	47.9	48.9	45.3	43.1	38.8	26.2
NIGHT TIME 23:00 - 07:00 LAeq 8 HOUR & Corresponding LAmx 8 HOUR	44.9	68.6	36.0	47.6	43.6	42.9	41.2	40.8	36.3	34.7	29.0	14.5

DAYTIME NOISE LEVELS 07:00 - 23:00 1 HOUR SAMPLES												
Date / Time	LAeq	LAmx	LA90	63	125	250	500	1.0 k	2.0 k	4.0 k	8.0 k	16.0 k
07:00 - 08:00	52.2	69.2	46.5	64.7	52.4	47.5	48.1	47.1	42.2	44.9	38.8	26.1
08:00 - 09:00	51.8	69.4	45.2	55.0	49.0	47.3	47.5	47.4	42.6	44.2	37.8	24.1
09:00 - 10:00	56.3	88.6	51.5	58.2	53.5	51.4	51.0	50.8	49.4	48.5	43.4	28.6
10:00 - 11:00	53.0	79.3	46.4	57.2	51.7	48.7	48.8	49.4	44.9	42.0	37.1	21.8
11:00 - 12:00	53.5	73.7	45.3	59.5	55.2	49.5	48.6	50.3	45.3	41.4	35.2	24.6
12:00 - 13:00	52.3	69.2	44.4	57.6	51.2	48.0	47.2	49.4	44.2	39.6	32.9	22.6
13:00 - 14:00	54.2	86.6	45.5	58.3	52.3	48.9	48.4	51.2	46.4	42.7	37.8	24.9
14:00 - 15:00	52.9	70.3	45.7	58.4	51.5	48.9	47.0	49.4	45.4	42.1	38.1	26.3
15:00 - 16:00	51.8	76.0	43.5	58.0	52.4	47.8	46.5	48.6	44.2	38.6	34.3	28.6
16:00 - 17:00	52.6	74.0	45.5	57.7	51.1	50.0	48.0	48.9	45.2	39.4	34.2	21.2
17:00 - 18:00	51.9	68.3	44.9	56.5	50.4	47.9	47.7	48.9	43.6	37.7	32.3	18.0
18:00 - 19:00	53.1	73.4	47.4	56.7	51.1	48.3	48.4	49.3	45.6	42.5	38.9	25.4
19:00 - 20:00	56.1	70.9	53.3	57.6	53.5	49.3	49.1	50.1	49.8	48.4	46.6	34.0
20:00 - 21:00	50.6	72.3	43.6	54.0	50.8	46.3	46.5	46.4	43.3	40.2	32.6	16.6
21:00 - 22:00	48.7	68.9	41.9	55.8	52.3	46.0	45.6	44.5	41.2	34.0	28.4	15.7
22:00 - 23:00	46.2	67.6	39.8	50.0	43.7	42.1	42.9	43.0	38.5	30.0	22.6	11.8

NIGHT TIME NOISE LEVELS 23:00 - 07:00 15 MINUTE SAMPLES												
Date / Time	LAeq	LAmx	LA90	63	125	250	500	1.0 k	2.0 k	4.0 k	8.0 k	16.0 k
23:00 - 23:15	42.6	59.5	39.9	46.6	42.5	40.8	419	38.4	32.8	24.1	17.5	10.8
23:15 - 23:30	44.8	65.4	39.0	50.7	44.2	42.3	417	41.3	36.2	29.7	26.7	22.8
23:30 - 23:45	45.1	61.9	39.7	48.0	42.7	41.8	415	42.4	36.0	27.4	20.4	11.3
23:45 - 00:00	45.9	67.3	39.2	49.7	43.5	42.5	413	41.8	39.8	31.0	20.8	15.6
00:00 - 00:15	45.5	61.6	39.5	47.6	43.4	42.8	410	43.0	36.6	28.6	21.9	11.1
00:15 - 00:30	45.5	63.3	40.6	48.2	43.7	43.3	413	43.0	36.4	27.4	20.3	10.5
00:30 - 00:45	41.0	53.5	40.5	45.0	42.9	42.7	39.9	35.6	30.0	24.9	20.1	10.2
00:45 - 01:00	41.9	60.3	40.7	47.1	43.5	43.0	40.1	36.9	32.2	26.9	23.1	11.7
01:00 - 01:15	44.0	63.0	39.5	49.0	43.9	43.2	40.3	39.7	36.9	28.4	20.6	9.9
01:15 - 01:30	41.1	58.2	38.2	43.9	41.2	41.0	38.3	37.6	31.4	23.8	17.5	9.5
01:30 - 01:45	39.3	46.8	38.3	44.0	41.2	41.0	38.0	34.3	28.4	22.6	17.1	9.5
01:45 - 02:00	41.4	61.1	37.5	43.6	40.4	40.2	37.9	38.3	32.0	23.5	17.0	9.6
02:00 - 02:15	38.6	46.9	38.0	43.5	40.4	39.8	37.6	33.5	27.6	22.2	16.7	9.4
02:15 - 02:30	38.0	42.7	37.3	42.6	40.0	39.8	37.1	32.6	26.9	21.6	16.5	9.4
02:30 - 02:45	37.9	47.7	37.2	42.9	39.9	39.3	37.0	32.5	26.8	21.7	16.7	9.4
02:45 - 03:00	37.9	46.1	37.2	42.7	39.8	39.0	37.0	32.6	27.0	21.9	16.5	9.7
03:00 - 03:15	37.3	47.8	36.3	42.1	39.4	38.6	36.5	31.9	26.3	21.1	16.0	10.4
03:15 - 03:30	37.4	46.7	36.4	42.9	40.5	39.2	36.5	31.6	26.4	21.0	15.6	10.7
03:30 - 03:45	38.4	54.2	36.3	42.1	39.3	38.6	36.9	34.1	28.1	22.5	16.7	9.4
03:45 - 04:00	40.3	59.1	36.4	44.4	39.9	38.7	37.4	37.0	31.1	23.1	16.7	9.4
04:00 - 04:15	41.0	59.7	36.4	45.2	39.9	39.2	37.6	36.6	34.1	26.4	26.4	10.3
04:15 - 04:30	39.1	48.0	37.3	42.5	39.9	39.5	37.2	32.0	30.7	28.7	26.3	21.4
04:30 - 04:45	43.1	54.5	41.2	42.9	42.1	43.0	40.3	35.8	31.5	26.6	32.6	21.0
04:45 - 05:00	46.0	62.4	43.5	46.0	44.3	44.9	43.4	38.4	35.1	29.8	34.8	11.9
05:00 - 05:15	45.7	59.2	43.1	44.8	43.7	43.8	42.2	39.2	36.4	29.0	33.1	11.3
05:15 - 05:30	48.0	68.6	43.4	48.7	45.6	45.1	44.1	42.3	39.8	40.4	35.0	12.5
05:30 - 05:45	48.4	66.2	42.5	47.8	45.1	45.1	44.1	45.4	40.0	35.2	29.2	10.8
05:45 - 06:00	50.3	67.1	41.9	48.0	45.2	45.8	44.3	47.9	41.9	36.4	29.1	11.1
06:00 - 06:15	46.1	63.0	42.8	46.5	44.9	44.8	44.0	39.8	37.9	37.5	29.1	10.9
06:15 - 06:30	47.2	63.1	41.7	46.8	44.2	44.3	42.6	43.7	37.8	37.7	29.7	10.6
06:30 - 06:45	50.2	65.3	44.3	55.5	49.7	47.6	45.4	45.2	41.9	42.1	37.2	19.4
06:45 - 07:00	50.2	68.1	44.3	53.7	49.3	47.1	45.4	45.4	42.3	42.1	36.2	16.2

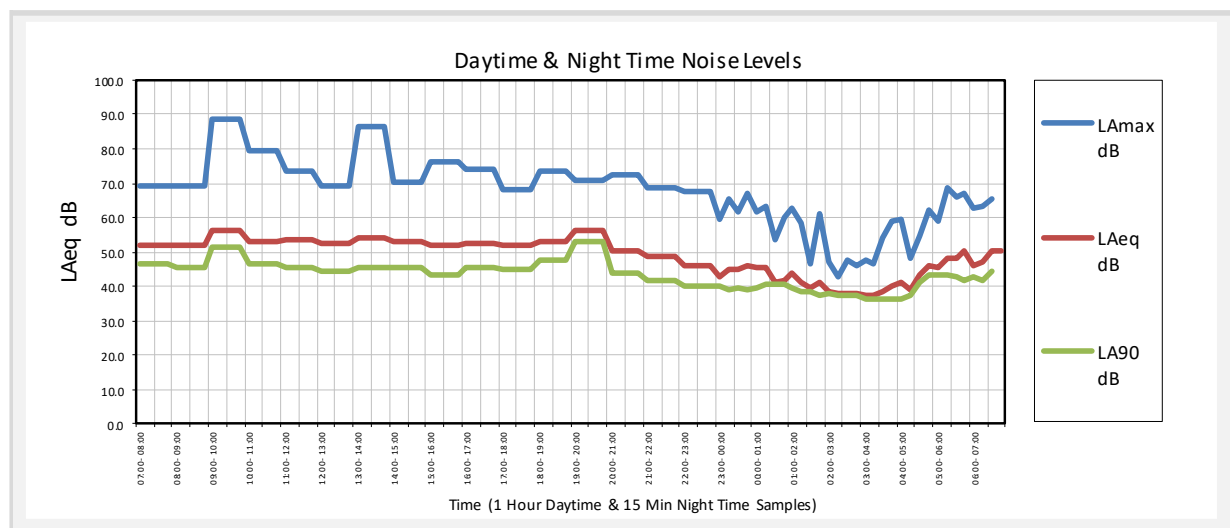


23.10 9th – 10th July 2023 – Position 2


NOISE LEVEL SUMMARY ASSESSMENT				Octave Band Centre Frequency (Hz)								
Date / Time	LAeq	LAmaz	LA90	63	125	250	500	1.0k	2.0k	4.0k	8.0k	16.0k
DAYTIME 07:00 - 23:00 LAeq 16 HOUR & Cor r esponding LAmaz 16 HOUR	52.1	78.4	47.0	58.3	53.5	49.1	47.2	48.4	43.8	41.2	36.0	24.4
NIGHT TIME 23:00 - 07:00 LAeq 8 HOUR & Cor r esponding LAmaz 8 HOUR	46.4	70.6	38.0	49.6	45.2	45.9	42.7	42.3	38.0	34.9	30.2	11.6

DAYTIME NOISE LEVELS 07:00 - 23:00 1 HOUR SAMPLES												
Date / Time	LAeq	LAmaz	LA90	63	125	250	500	1.0 k	2.0 k	4.0 k	8.0 k	16.0 k
07:00 - 08:00	48.9	69.0	42.9	52.7	47.0	45.8	45.0	45.2	41.2	36.8	31.5	14.3
08:00 - 09:00	50.1	68.2	41.9	54.1	47.7	45.5	44.7	46.5	42.3	40.3	34.3	14.9
09:00 - 10:00	52.4	73.2	43.1	56.1	53.8	48.0	46.8	48.2	43.2	45.1	37.5	24.2
10:00 - 11:00	52.5	68.9	43.4	56.1	51.3	47.2	46.1	48.6	43.0	45.9	37.2	26.1
11:00 - 12:00	54.5	78.4	44.3	59.5	58.5	51.9	49.4	51.2	46.1	41.8	36.3	29.7
12:00 - 13:00	54.3	72.3	47.1	61.5	54.9	49.5	49.1	50.8	46.4	42.9	38.9	27.6
13:00 - 14:00	53.2	72.8	46.8	60.3	55.2	49.2	48.5	49.7	44.8	41.9	38.2	27.5
14:00 - 15:00	52.8	71.0	46.9	58.9	53.0	49.5	48.3	49.4	44.7	39.7	37.0	26.5
15:00 - 16:00	53.4	71.9	47.6	60.2	54.0	50.7	48.7	49.6	45.4	42.1	38.1	26.4
16:00 - 17:00	53.3	73.5	47.1	61.2	55.8	51.9	48.4	49.8	44.8	41.1	37.2	23.8
17:00 - 18:00	52.6	69.6	46.7	60.2	55.0	50.5	47.8	48.9	44.4	40.0	36.6	23.3
18:00 - 19:00	51.9	70.5	45.6	58.4	53.6	49.6	47.2	48.6	43.7	38.4	34.6	21.1
19:00 - 20:00	51.6	70.3	44.8	58.7	54.6	50.1	47.8	47.3	43.3	39.6	34.8	20.4
20:00 - 21:00	48.6	68.7	43.2	51.7	45.8	45.4	44.4	44.1	41.3	38.4	33.0	16.9
21:00 - 22:00	48.8	74.6	40.7	54.6	46.9	46.7	45.6	44.7	41.2	34.0	28.8	13.1
22:00 - 23:00	45.7	70.7	39.9	49.2	44.3	43.9	41.5	41.3	39.2	31.7	25.8	12.5

NIGHT TIME NOISE LEVELS 23:00 - 07:00 15 MINUTE SAMPLES												
Date / Time	LAeq	LAmaz	LA90	63	125	250	500	1.0 k	2.0 k	4.0 k	8.0 k	16.0 k
23:00 - 23:15	41.1	57.5	38.9	43.9	41.9	43.1	38.4	37.2	30.5	23.7	19.0	9.9
23:15 - 23:30	42.2	60.4	39.0	45.3	42.7	43.7	39.1	38.8	31.6	24.0	18.3	11.8
23:30 - 23:45	45.2	69.8	39.1	48.8	42.8	43.8	40.1	39.6	40.1	32.1	24.5	12.0
23:45 - 00:00	41.4	66.9	38.2	43.5	41.1	42.2	37.7	37.5	33.0	27.2	21.1	10.8
00:00 - 00:15	41.5	67.7	38.5	43.1	41.4	42.6	38.0	37.4	33.0	27.1	20.0	11.4
00:15 - 00:30	39.3	61.7	38.4	43.4	41.7	42.4	37.3	33.9	29.0	22.9	17.0	10.3
00:30 - 00:45	39.8	68.7	37.0	42.4	40.2	41.8	36.7	34.5	31.6	26.9	20.1	10.3
00:45 - 01:00	40.2	56.8	37.8	42.7	40.5	42.2	37.3	36.4	29.5	22.7	16.7	10.2
01:00 - 01:15	41.5	65.5	37.4	45.2	41.0	42.7	37.4	35.3	35.8	28.1	19.8	9.8
01:15 - 01:30	39.8	59.7	37.4	43.0	40.6	42.1	37.1	34.7	31.5	23.4	16.9	9.4
01:30 - 01:45	39.5	65.1	38.1	43.1	41.0	42.5	37.5	33.8	29.9	24.1	17.5	10.3
01:45 - 02:00	41.4	55.7	40.5	45.6	42.7	44.3	39.3	36.6	30.6	24.4	18.8	9.8
02:00 - 02:15	42.0	66.3	40.5	45.1	42.8	44.9	39.6	37.0	32.2	26.8	20.5	10.1
02:15 - 02:30	40.8	42.3	40.3	44.7	42.4	44.6	39.0	35.3	29.7	23.7	18.5	9.5
02:30 - 02:45	41.8	63.6	38.2	43.7	41.0	42.5	38.5	38.6	32.2	24.3	17.9	9.6
02:45 - 03:00	42.7	56.2	41.9	44.5	43.6	46.2	41.0	37.6	31.3	24.2	17.9	9.5
03:00 - 03:15	43.5	45.2	43.0	45.2	44.7	47.1	41.8	38.0	31.9	24.7	19.5	9.8
03:15 - 03:30	43.8	45.3	43.4	45.7	44.9	46.9	42.8	38.3	32.1	24.9	19.5	9.8
03:30 - 03:45	43.8	49.8	43.4	45.9	45.0	47.0	42.8	38.2	32.1	24.9	19.6	9.9
03:45 - 04:00	44.1	56.1	43.5	46.3	45.0	46.8	43.1	38.8	32.4	25.2	19.3	9.7
04:00 - 04:15	44.7	57.5	43.5	46.8	45.0	47.0	43.2	39.0	35.9	27.3	19.9	9.7
04:15 - 04:30	45.7	58.4	43.9	46.5	45.1	47.0	43.4	39.5	38.0	33.4	30.2	10.7
04:30 - 04:45	47.0	63.4	44.1	53.4	45.7	47.3	44.1	41.5	38.2	37.1	34.6	12.3
04:45 - 05:00	47.5	63.1	44.6	50.8	46.8	47.4	44.7	42.3	36.8	38.7	34.7	13.5
05:00 - 05:15	46.8	63.1	44.8	46.1	45.2	47.3	44.4	39.9	37.9	39.0	32.7	11.8
05:15 - 05:30	51.9	70.6	44.9	52.6	49.5	49.6	47.2	47.8	44.7	40.7	34.7	13.6
05:30 - 05:45	49.8	64.7	44.5	50.7	46.1	47.6	45.7	46.1	40.4	39.5	36.8	12.9
05:45 - 06:00	49.8	68.7	43.4	51.4	47.3	48.2	45.1	45.6	42.4	39.2	32.1	12.8
06:00 - 06:15	49.9	68.9	43.3	52.1	47.5	47.3	45.8	46.1	42.1	38.4	32.0	12.7
06:15 - 06:30	49.6	65.3	41.9	53.2	45.9	45.2	44.8	45.5	41.0	40.8	37.1	14.6
06:30 - 06:45	50.5	66.8	41.3	56.6	49.3	46.9	44.7	47.8	42.6	36.6	31.9	13.9
06:45 - 07:00	53.3	69.8	43.9	57.8	51.4	48.9	47.6	50.2	45.0	41.6	37.2	16.0

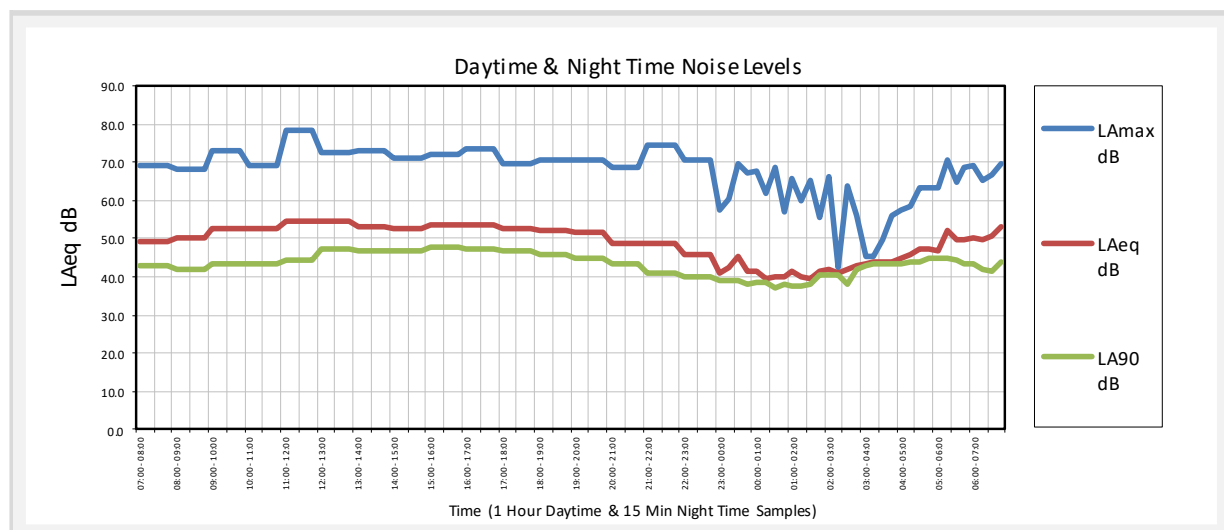

24 APPENDIX B - ENVIRONMENTAL CONDITIONS

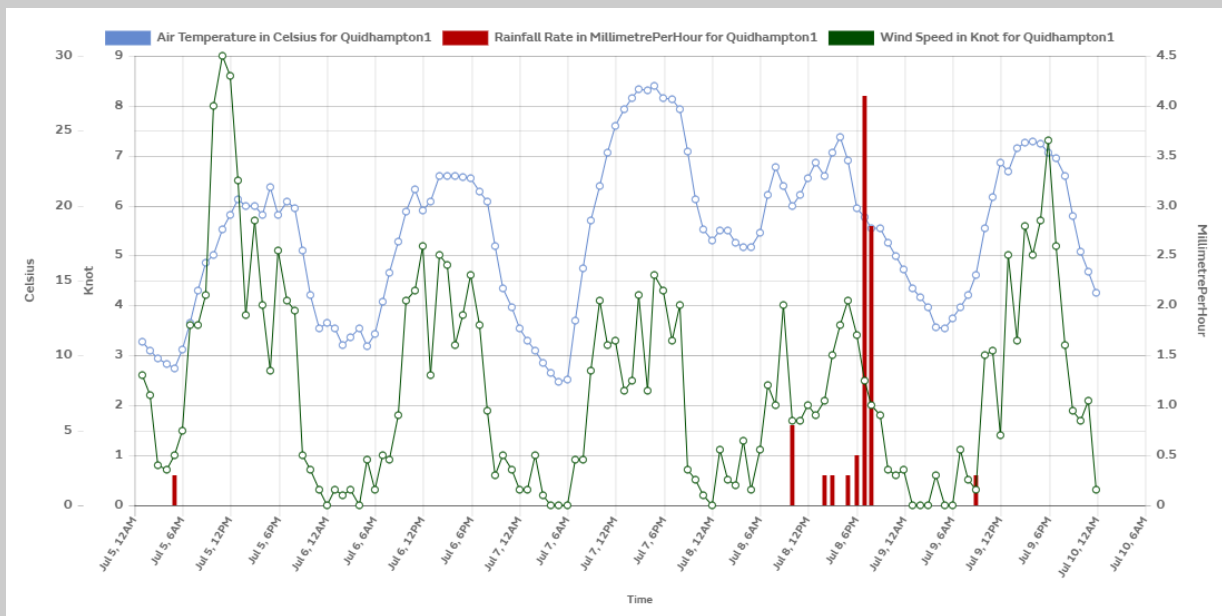

5th – 10th July 2023

25 APPENDIX C - UNCERTAINTY

In line with the requirements of section 10 of British Standard 4142: 2014+A1:2019 it is expected that the reported expanded uncertainty with a confidence limit of 95% and assuming a convergence of $k=2$ is likely to be ± 2.1 dB. Uncertainty, in this instance has been minimised by undertaking longer background noise measurements over a 96-hour period.

25.1 Uncertainty Budget

Sources of Uncertainty	Uncertainty Notes	Commentary	Value (half Width)	Convert to Same Units (dB)	Distribution Divisor			Standard Uncertainty (u) dB
					Normal	Rectangular	Other	
Measurement Position	Choice of position, ,	1m in 20m		0.2		rect($\sqrt{3}$)		0.13
	microphone orientation	Type 1 0 - 30deg	0.4		Normal			0.50
Instrumentation	Calibration	Calibration Drift	0.1		Normal			0.10
	Accuracy and precision (type 1)	Type 1 practical	1.9			rect($\sqrt{3}$)		0.50
Background Noise Level	Timing of Measurement							
Background Noise Level	Modal Analysis Day	Calculated Standard Deviation	3.7				s/ $\sqrt{n}$	0.39
Background Noise Level	Modal Analysis Night	Calculated Standard Deviation	2.2				s/ $\sqrt{n}$	0.16
Combined Uncertainty (root sum of squares)								1.05
Expanded Uncertainty U = Kuc (95% Confidence K =2)								2.1
Final Answer Expressed as Value $\pm$ U dB with a confidence Level of 95%								
REFERENCE: Uncertainty Budget Calculated in line with M3003: The Expression of Uncertainty and Confidence in Measurement Edition 3, November 2012 and A Good Practice Guide on the Sources and Magnitude of Uncertainty Arising in the Practical Measurement of Environmental Noise N J Craven, G Kerry Edition 1a – May 2007.								

#END OF REPORT#