


GENERAL NOTES

- DO NOT SCALE FROM THIS DRAWING, IF IN DOUBT ASK.
- ALL DIMENSIONS ARE IN MILLIMETRES UNLESS NOTED OTHERWISE.
- ALL LEVELS ARE IN METRES UNLESS NOTED OTHERWISE.
- THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL RELEVANT ARCHITECTS, SERVICES' AND ENGINEER'S DRAWINGS AND SPECIFICATIONS.
- ANY DISCREPANCIES ARE TO BE REPORTED IMMEDIATELY IN WRITING TO THE ARCHITECT AND ENGINEER FOR VERIFICATION.
- REFER TO ARCHITECT'S DRAWING FOR SETTING OUT DIMENSIONS.
- ALL TEMPORARY WORKS ARE TO BE THE RESPONSIBILITY OF THE CONTRACTOR. THE CONTRACTOR SHALL ESTABLISH AND MAINTAIN SAFE WORKING PRACTICES AND SHALL FULLY DISCHARGE THEIR OBLIGATIONS UNDER HEALTH AND SAFETY REGULATIONS.
- ALL WORKS SHALL COMPLY WITH ALL RELEVANT STATUTORY REQUIREMENTS, BRITISH STANDARDS, EUROCODES, CODES OF PRACTICE, BUILDING REGULATIONS AND RECOGNISED GOOD PRACTICE.
- ALL PROPRIETARY MATERIALS TO BE USED IN STRICT ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS.

CONCRETE NOTES

- ALL REINFORCED CONCRETE MIXES TO BE DESIGNATED GRADE RC28/35 DC-1 CLASS IN ACCORDANCE WITH BS 8500-2 & BS EN 206-1.
- ALL REINFORCEMENT TO BE HIGH YIELD GRADE 500. IN ACCORDANCE WITH BS4449.
- SAMPLING AND TESTING OF CONCRETE IS TO BE CARRIED OUT IN ACCORDANCE WITH BS EN 12350-1 & 2 BY THE CONCRETE SUPPLIER.
- CONCRETE TO BE WELL COMPACTED BY MEANS OF A MECHANICAL VIBRATOR.
- THE CONTRACTOR IS RESPONSIBLE TO PROVIDE ADEQUATE CHAIRS AND SPACERS TO SUPPORT REINFORCEMENT PRIOR TO POUR.
- IT IS THE CONTRACTOR'S RESPONSIBILITY TO CHECK BAR BENDING SCHEDULES AGAINST THESE DETAILS, TO ENSURE THAT ALL REINFORCEMENT HAS BEEN INCLUDED ON THE SCHEDULE, AND IS CORRECT.
- ALL FOUNDATION PROPOSALS ARE SUBJECT TO CONFIRMATION OF SITE CONDITIONS, AND INSPECTION BY BUILDING CONTROL. IF IN DOUBT CONTACT THE ENGINEER.
- AGGREGATE NOMINAL SIZE FOR ALL RC TO BE 20mm U.N.O.
- MIN.COVER TO REINFORCEMENT TO BE:
*BURIED FACES : 40mm *NON BURIED FACES : 35mm
- LAP LENGTHS ARE TO BE MINIMUM (UNLESS NOTED OTHERWISE):
H10 = 400mm
H12 = 500mm
H16 = 700mm
- MESH LAPS ARE TO BE MINIMUM 300mm STAGGER AND NEST MESH LAPS TO AVOID EXCESSIVE BUILD UP OF LAYERS.
- FOR REINFORCEMENT BENDING REFER TO SCHEDULES.

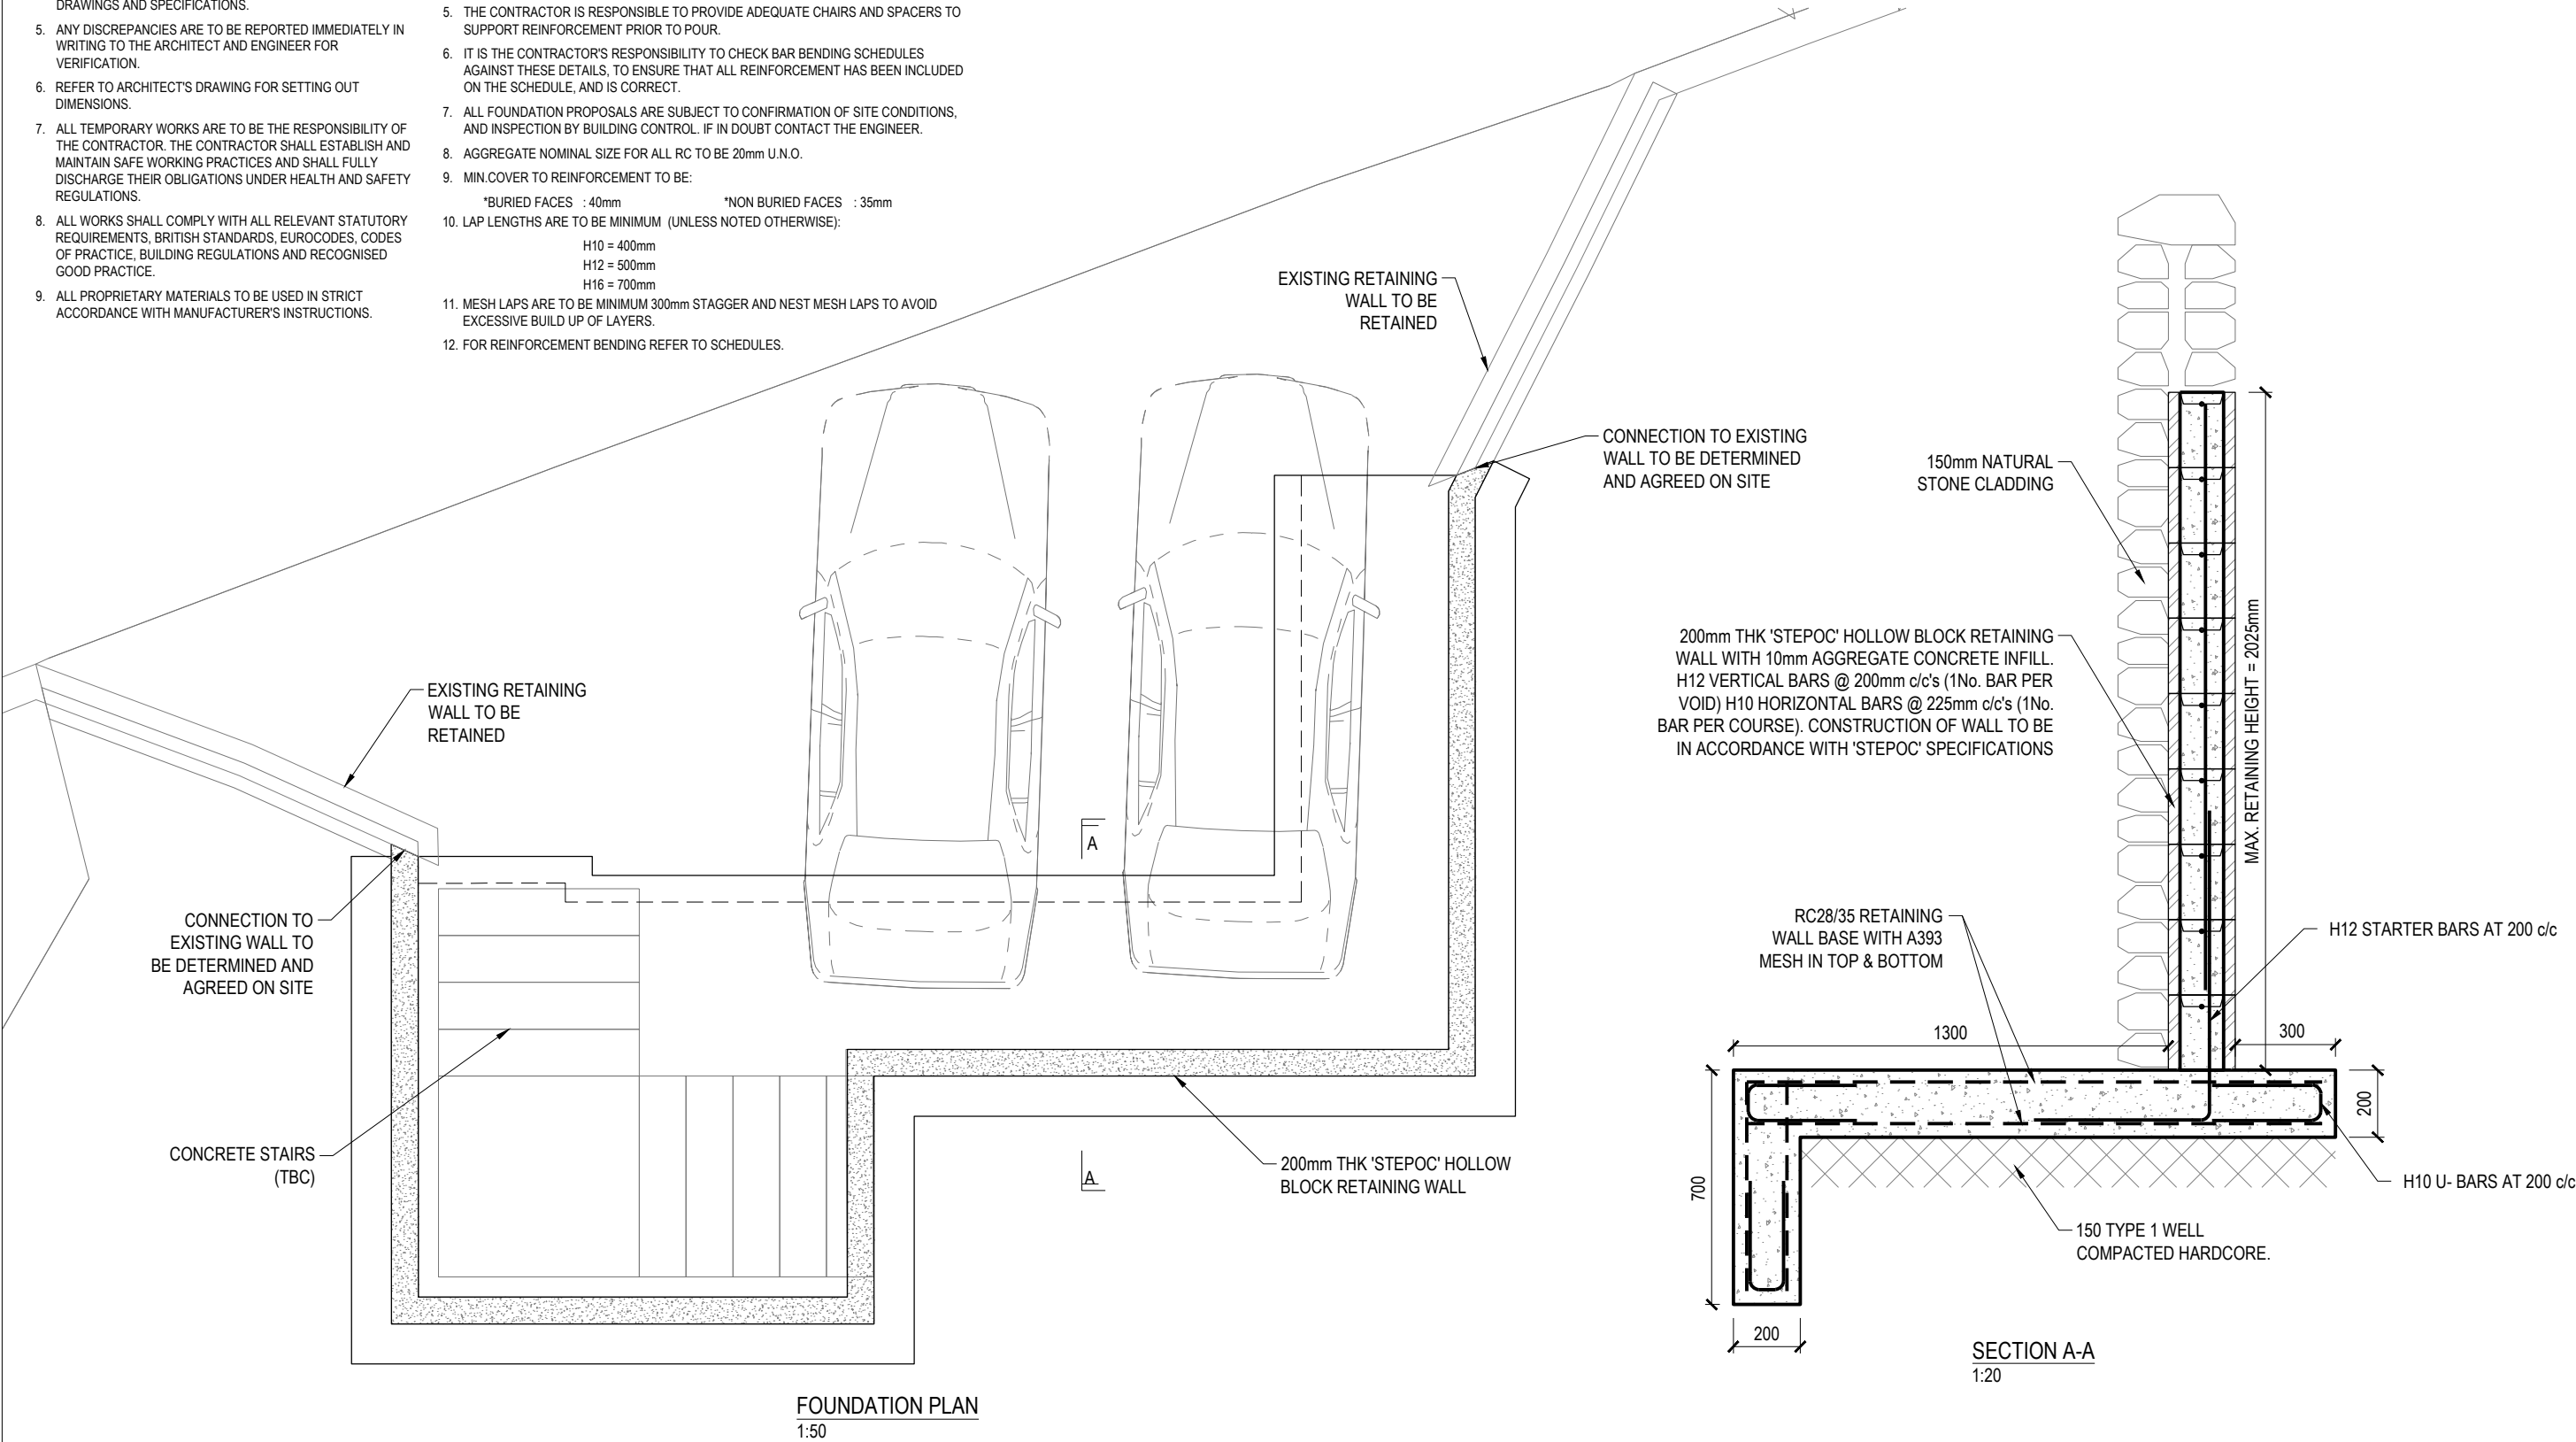

FOR INFORMATION

				PROJECT 34 LOWER STOKE, LIMPLEY STOKE, NR. BATH		
				TITLE PARKING RETAINING WALL		
REV	DATE	AMENDMENT		SCALE	DATE	SHEET SIZE
P2	17/10/25	EXISTING RETAINING WALL INFO ADDED	WX	MM	16/10/25	A3
P1	16/10/25	FIRST ISSUE	WX	MM		
DRAWING STATUS				PROJECT NO.	DRAWING NO.	REV.
PRELIMINARY				10889EDW48	100	P2