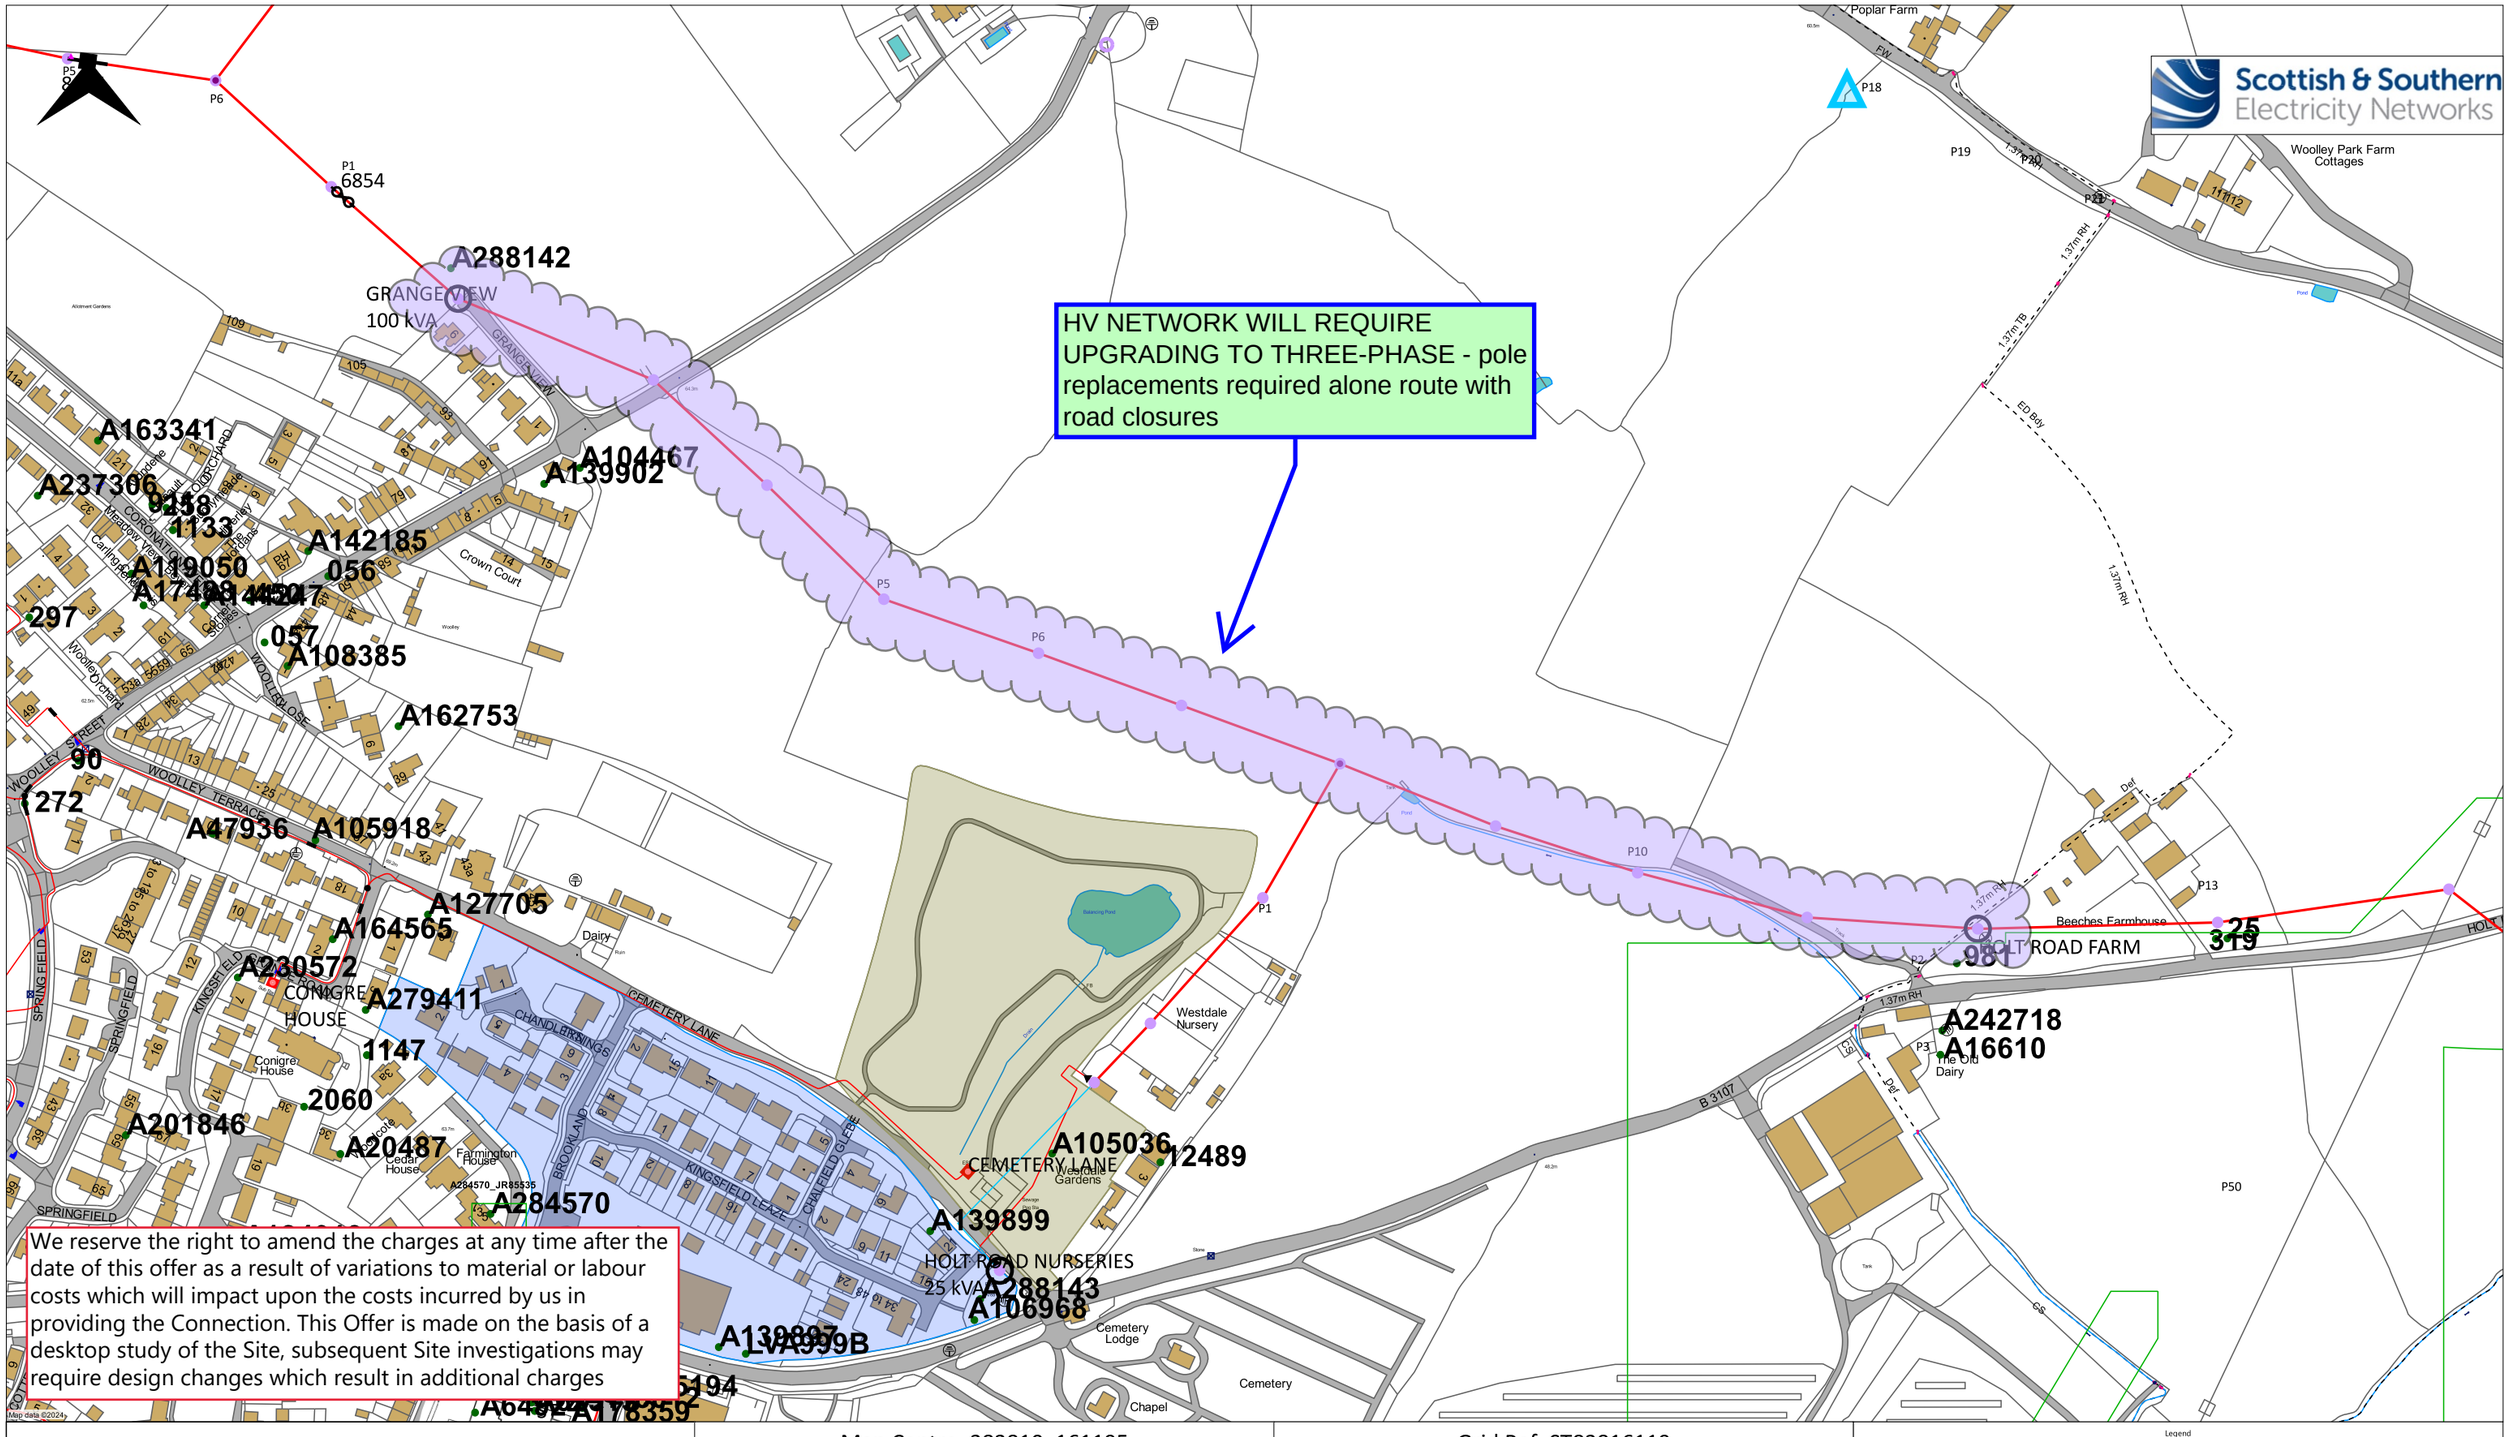


We reserve the right to amend the charges at any time after the date of this offer as a result of variations to material or labour costs which will impact upon the costs incurred by us in providing the Connection. This Offer is made on the basis of a desktop study of the Site, subsequent Site investigations may require design changes which result in additional charges

Map data ©2024

WARNING

There may have been subsequent alterations to the surface levels. Trial holes must be taken to determine positions and depths of cables. HS (G) 47 Booklet from the Health and Safety Executive - Avoiding Danger from Buried Cables - should be consulted before commencing excavation work. WHEN WORKING IN THE VICINITY OF OVERHEAD LINES THE HEALTH AND SAFETY GUIDANCE NOTE GS6 SHOULD BE CONSULTED (AVAILABLE FROM THE HSE WEBSITE)

Map Centre: 383810, 161195		Grid Ref: ST83816119
Scale: 1:3000	Page Size: A3	Plot Date: 12/12/2024
Designer Name: Masters, Jamie J (Distribution)		Job Number: FDZ404

UNCONTROLLED COPY
Subject to revision
Master held by SSEN Asset Data Team - Asset.Data@sse.com

If you are unsure & need to seek advice before commencing excavations please contact;

General Enquiries	0800 048 3516

NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID

	Services	LV	HV	EHV
FOOTPATH/UNMADE	0.45m	0.45m	0.6m	0.8m
ROAD CROSSING	0.6m	0.6m	0.75m	0.9m
AGRICULTURAL	1m	1m	1m	1.1m

Legend