



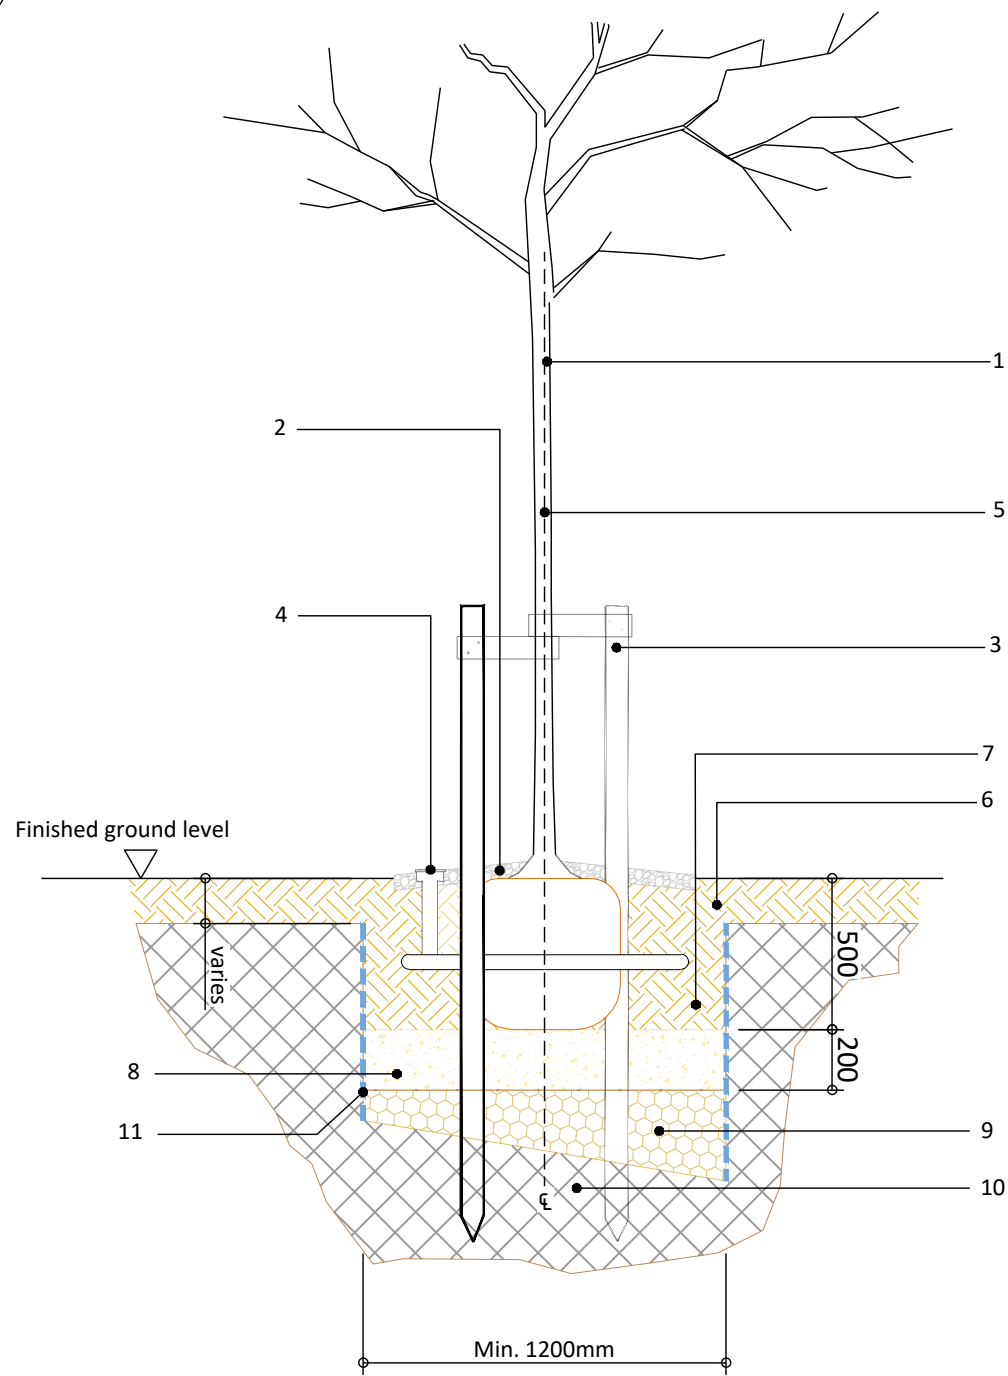


- KEY:
1. Proposed tree, refer to Planting Plan and Planting Schedules. Tree pit shown for Extra Heavy Standard trees under 20cm girth. Trees to be supplied and planted in accordance with the landscape specifications.
 2. 50mm deep bark mulch to min. 1000mm diameter around base of tree.
 3. 2no. 1200mm below ground, 75mm Ø pressure treated stakes to be driven into the ground until firm with 900mm above finished ground level. One of the stakes shall be positioned on the side of the prevailing wind. Tie to tree with 2no. rubber tree ties (Green-Tech product code 160PS1750-PRO, or equal) and spacers.
 4. Irrigation/ aeration pipe, to be Green-Tech 'Mona Relief Grande', 3m circumference ring below ground, or equal and approved. Opening to have proprietary grated cap and positioned outside of weldmesh tree guard.
 5. Location of tree pit centre to be marked or recorded if tree pit excavated in advance of planting at a later date.
 6. Adjacent topsoil depth requirements minimum 150mm deep for turfed area, 350mm for shrub and hedge planting - refer to soil specification.
 7. Topsoil tree pit backfill to BS3882:2015, ameliorated and laid as per specification, to 500mm depth. Tree pit to be square with sides and base of the tree pit loosened to avoid any smearing and compaction due to excavation.
 8. 200mm medium coarse washed sand.
 9. Approx 100mm-300mm deep 15-20mm diameter pea gravel laid to base of pit as specified to aid drainage.
 10. Subsoil to be broken up and loosened to 1m depth to reduce bulk density in accordance with BS 8545:2014 and laid in accordance with specification.
 11. Trees in proximity to underground services and/or adjacent to hard surfaces will require Root Barrier to be installed to avoid potential root damage. Barriers should be deeper than the subbase level of the paving as a minimum, extending to the necessary depth within 3m of services. To be Green-Tech 'Root Barrier 260 Permeable' cut to depths as required, or equal and approved.

- NOTES:
- Tree to have rooting volume of minimum **10m³** comprising topsoil and sand layers of the tree pit plus any adjacent natural ground.

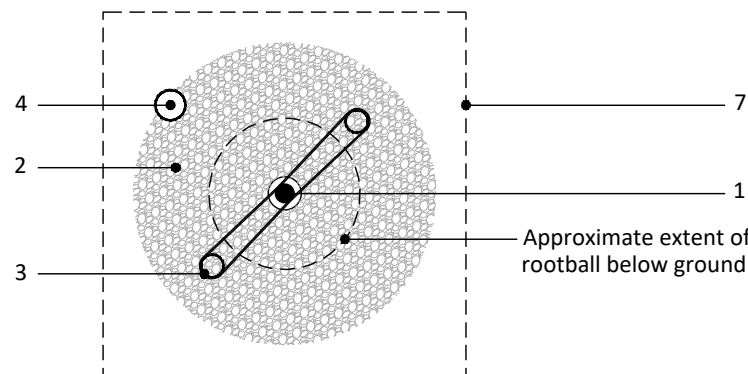

Rev	Note	Date
P1	For Planning	18.11.2025
-	-	-



GREENHALGH

Landscape Architecture

Project
Fives Court
Mere

Drawing Name Detail - Tree pit for under 20cm girth in soft landscape		
Drawn By LB	Checked By IG	Scale 1:25 @A3
Job No. 324	Status S4	
Drawing No. 324_GLA_01_XX_DR_L_5401	Rev P1	