



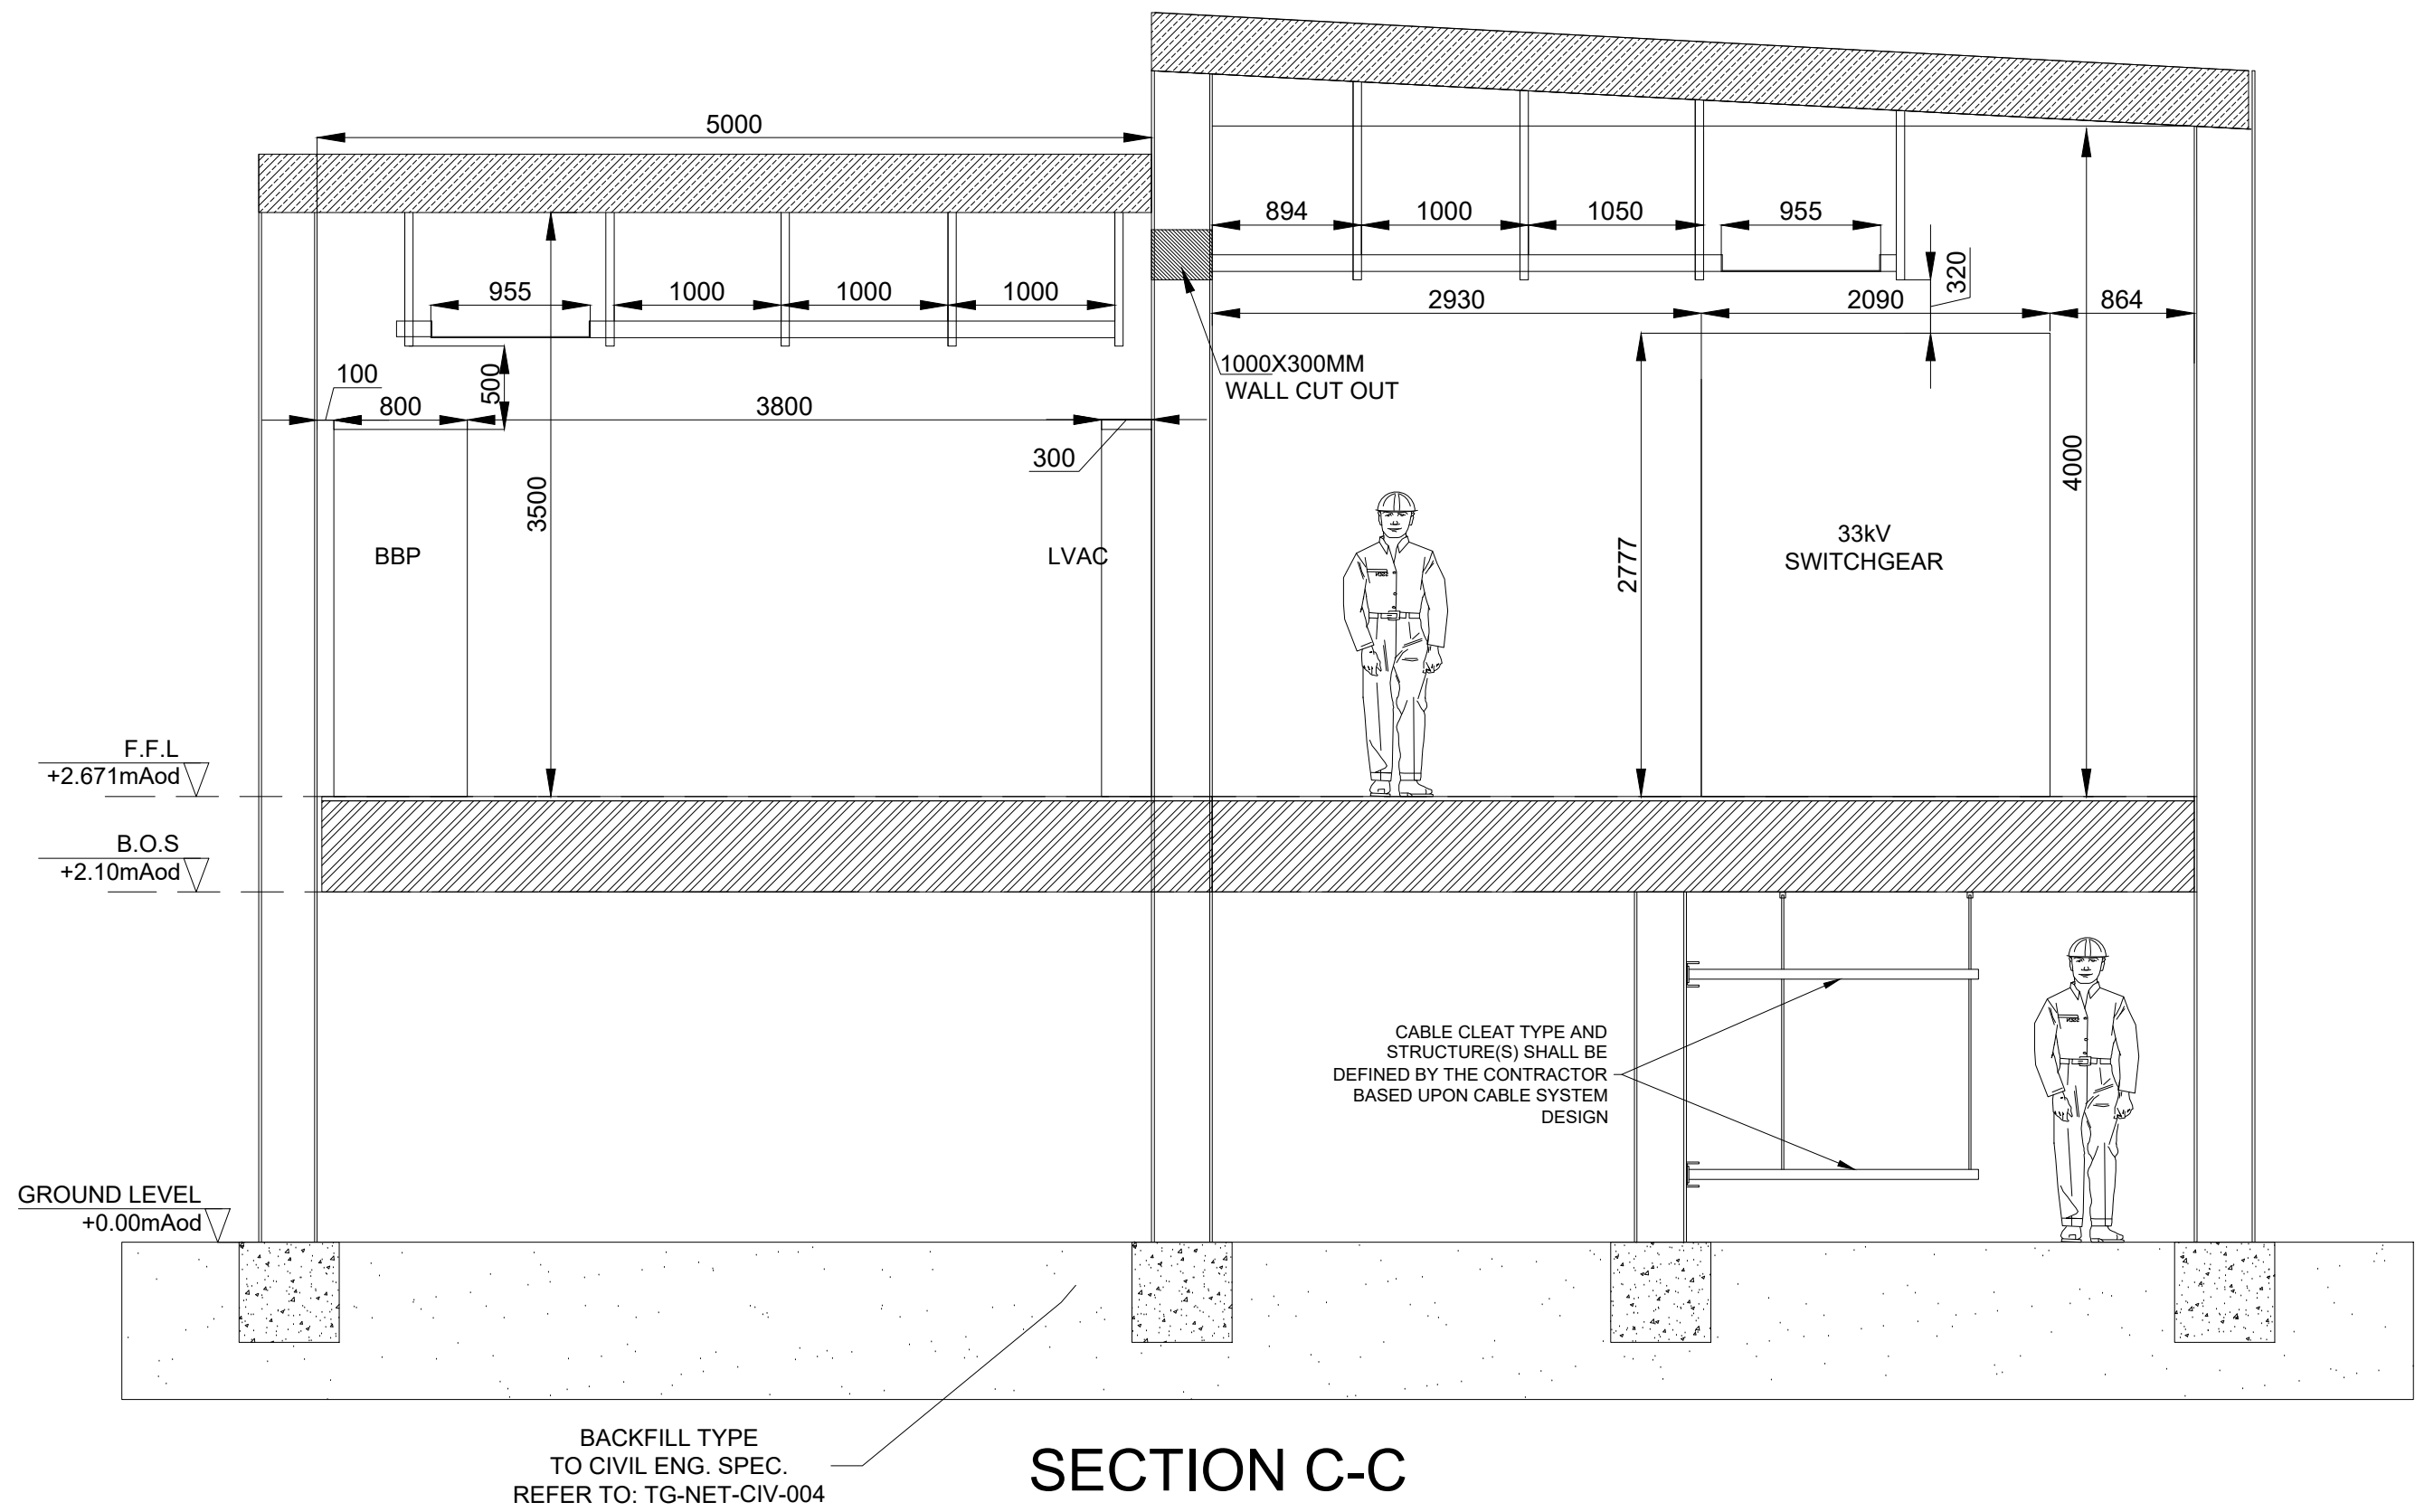

SECTION C-C

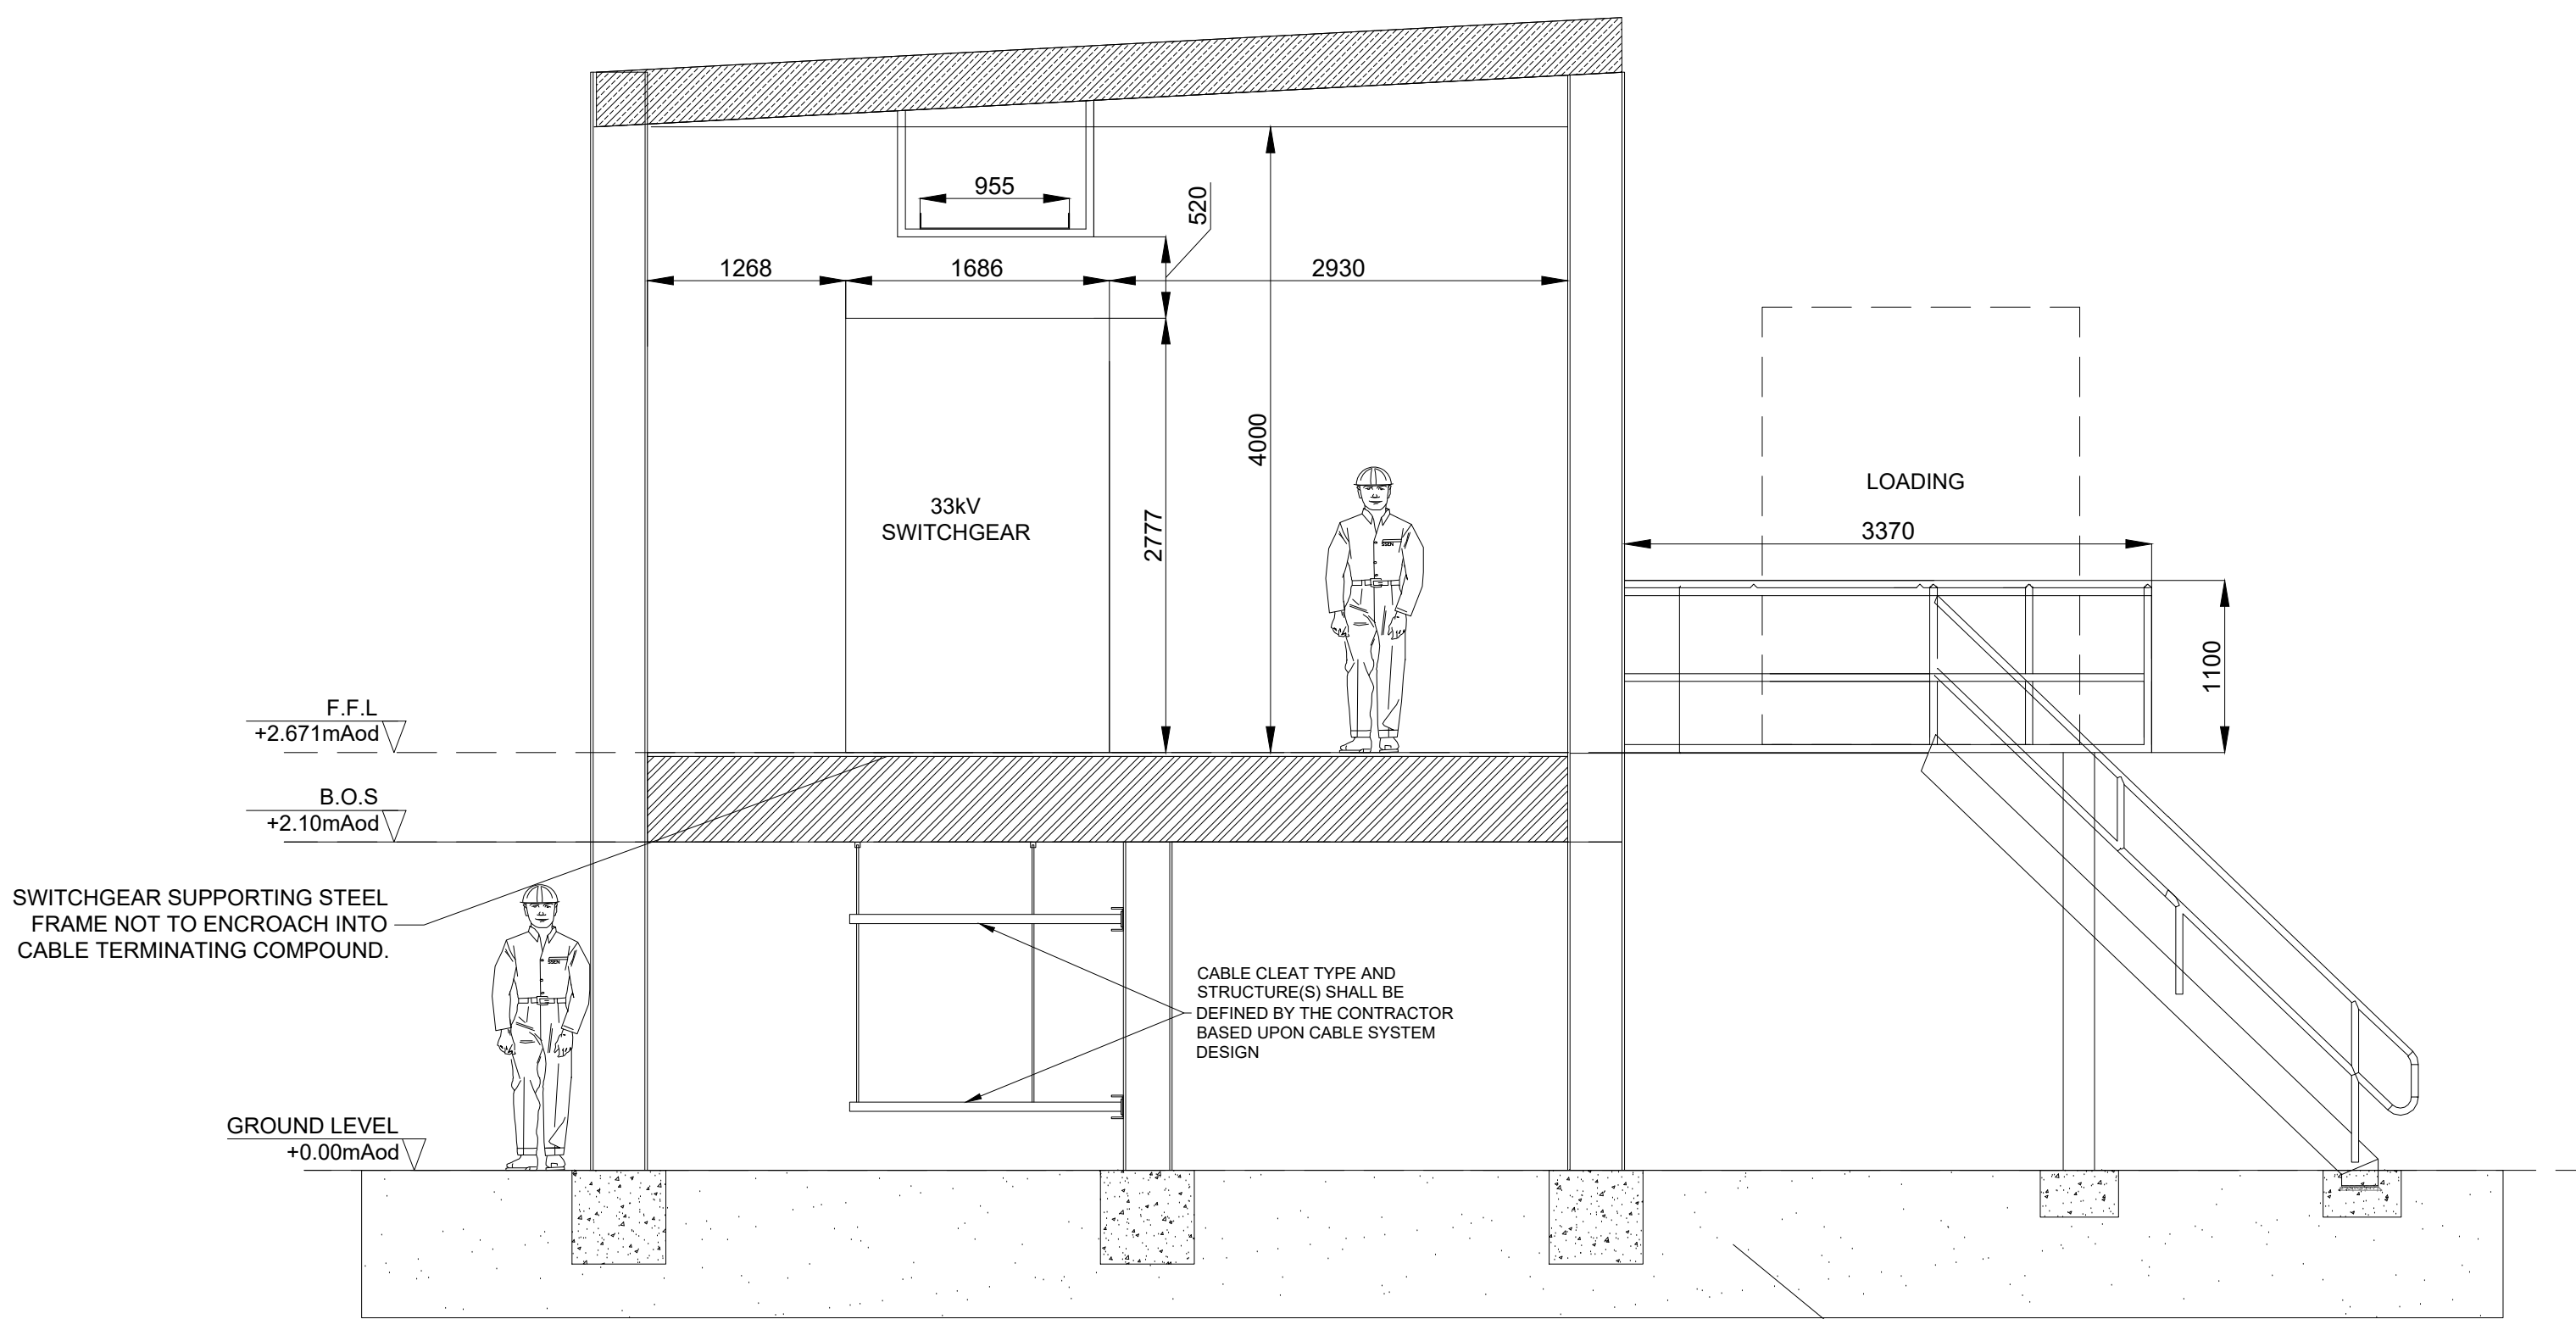

SECTION D-D

NOTES:

1. All levels are in metres (m) relative to Ordnance Datum.
2. All dimensions are in millimetres.
3. Minimum operation and working clearances in accordance with PR-NET-SST-005

VOLTAGE	PHASE TO EARTH CLEARANCE (P-E)	SAFETY WORKING CLEARANCE VERTICAL (D _{sv})	SAFETY WORKING CLEARANCE HORIZONTAL (D _{sh})	INSULATION HEIGHT - PEDESTRIAN ACCESS (IH)	PHASE TO PHASE CLEARANCE (P-P)
33kV	0.5m	2.90m	2.3m	2.4m	0.43m

WORK IN PROGRESS

P02	05.09.2025	SECOND ISSUE	KS	KS	AA	WF
P01.01	28.04.2025	FIRST ISSUE	KS	KS	AA	WF
Rev	Date	Revision Desc.	Dm	Dsn	Rvr	App

Contractor

AUREOS

2nd Floor, Lindsey Street, London (EC1A 9HP)

Project Title
**CHIPPENHAM 132/33kV
SUBSTATION**

Client

**Scottish & Southern
Electricity Networks**

Drawing Title
**33kV SWITCHGEAR ROOM
PLAN & ELEVATION DRAWING**

Drawing Stage: FOR APPROVAL	Drawing Status: S3: Suitable for review and comment
--------------------------------	--

Job No. PS009350	Scale at 1:40	Date First Issued 28.04.2025
Document No. ME305-KEL-EYE-XX-DR-E-3301	Sheet 3/3	Rev. P02