




Scale 1:500 @ A3




Trench Route

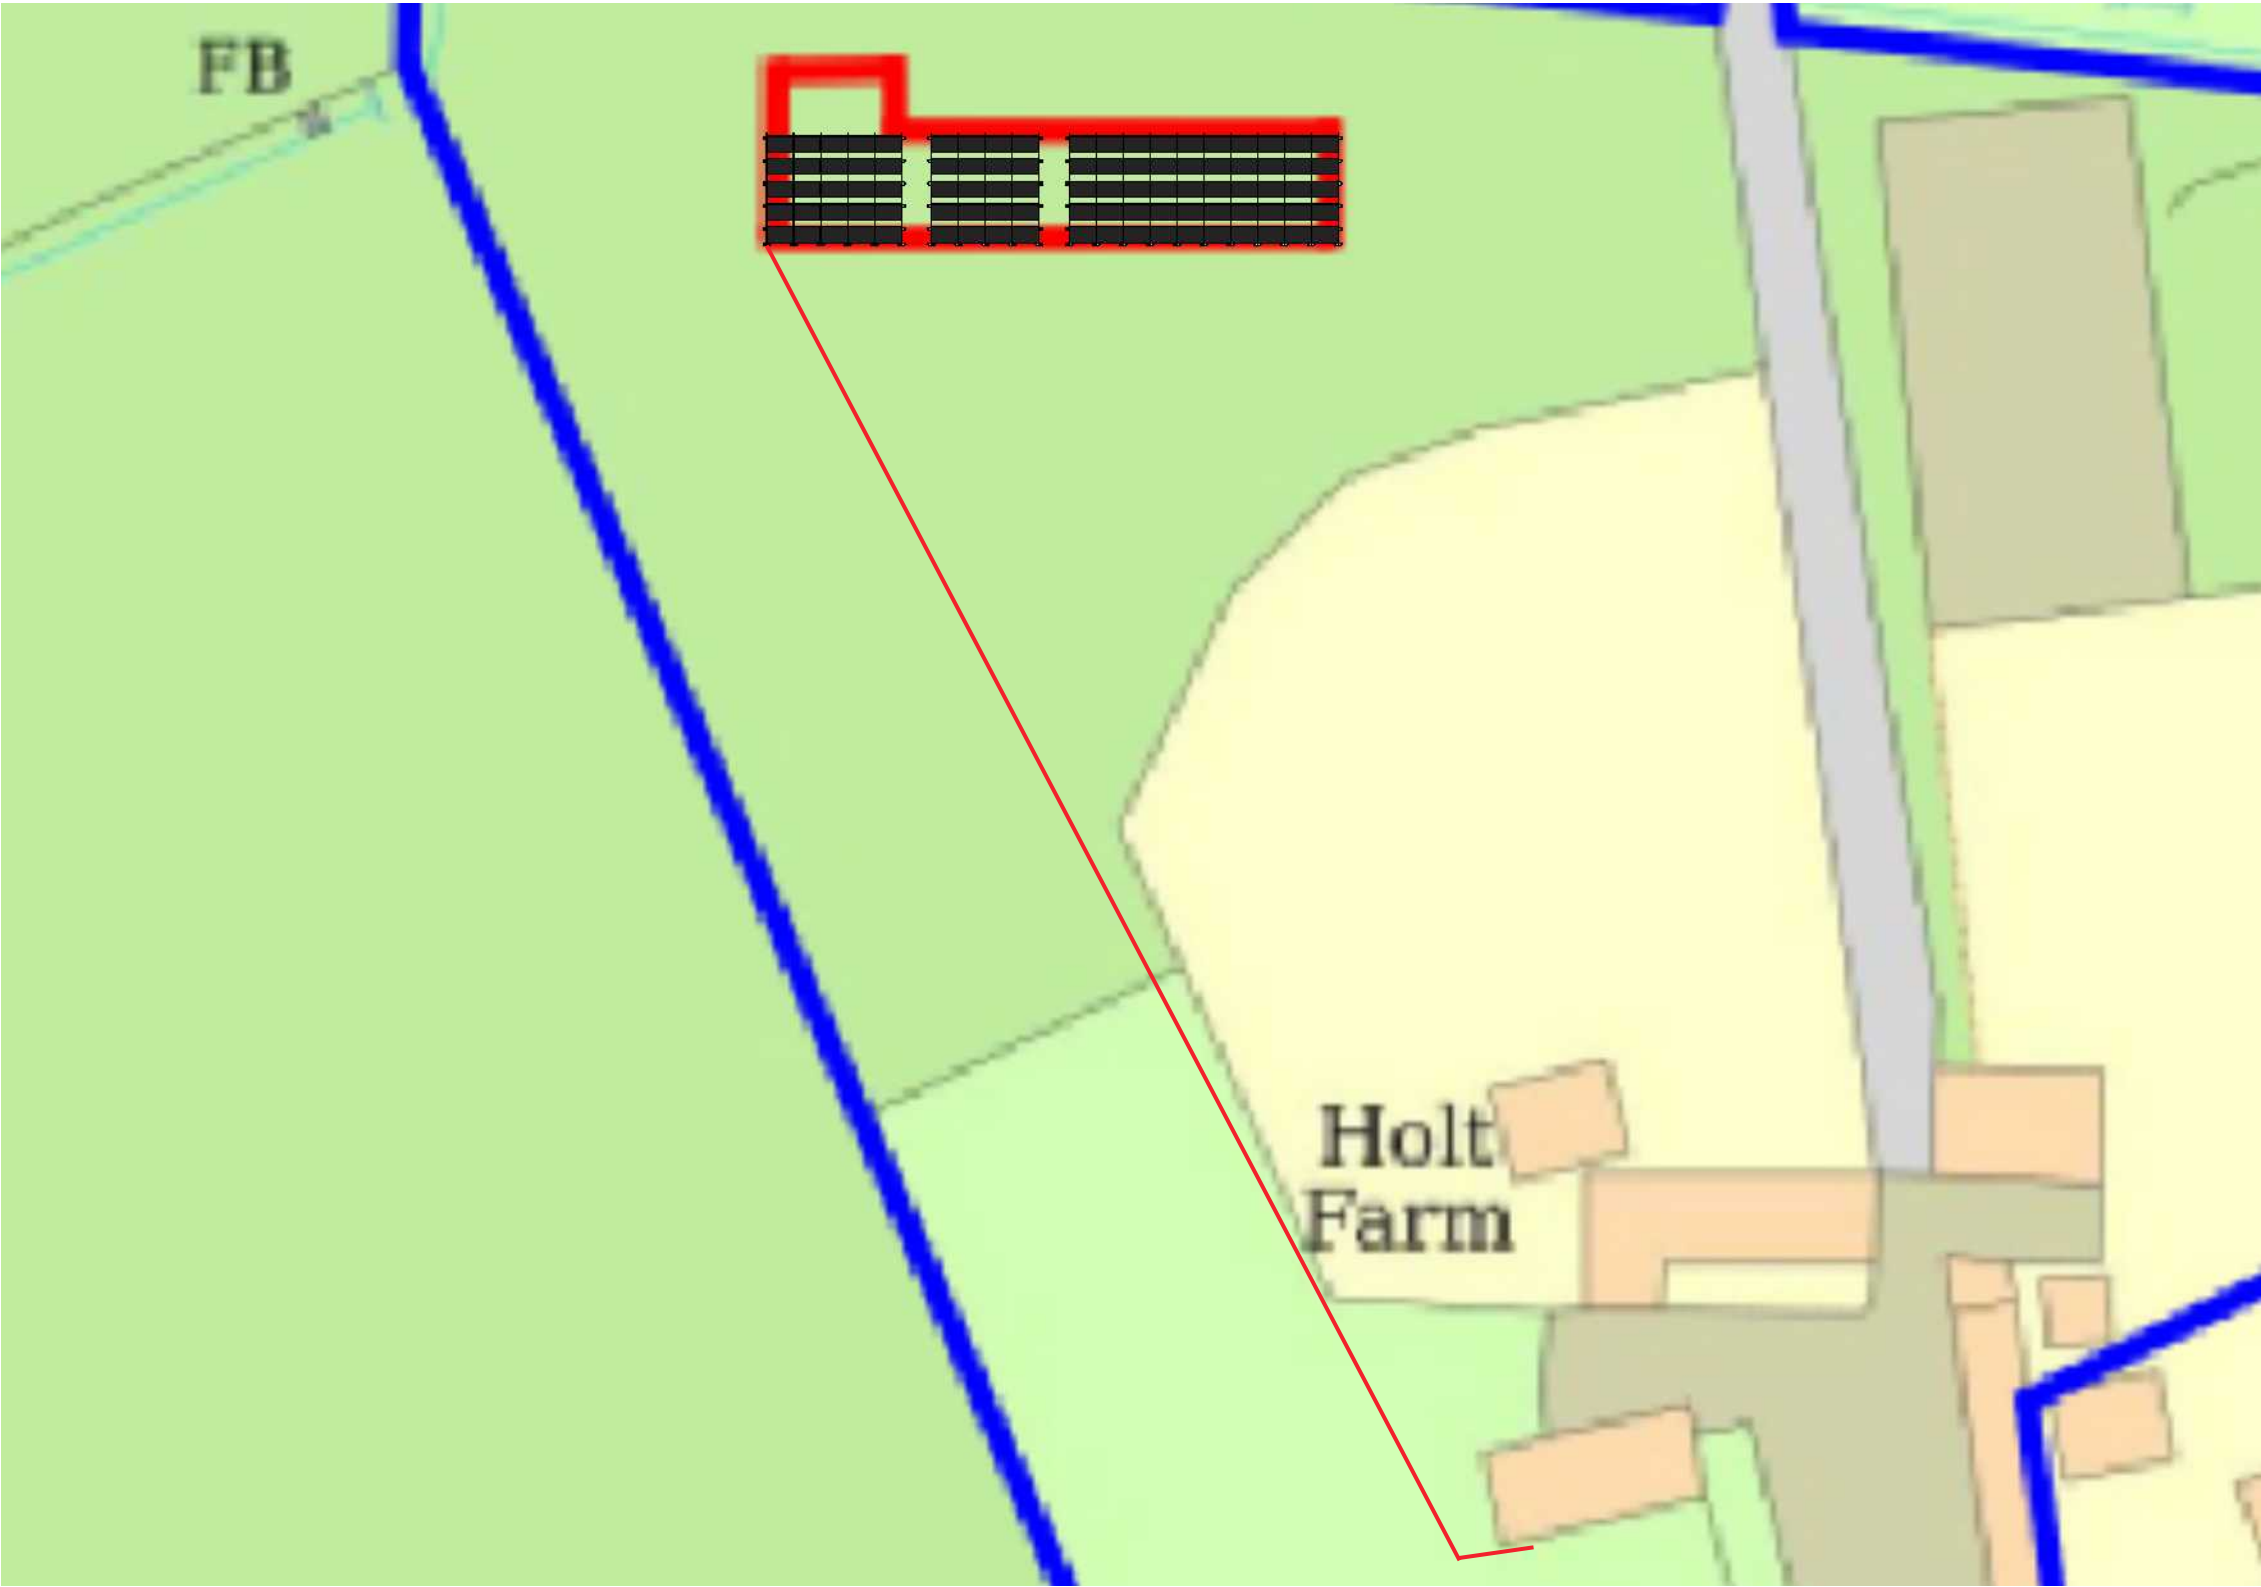

The trench will be approximately 350-400mm deep and 400-500mm wide. Following the trench being dug, it will be partly filled by sand, and the cables will then be laid in a duct with a drawstring (whilst being correctly marked) before the trench is filled.

The delivery of the equipment to site will use existing highways and parking on the client site. The materials required for the installation will then be manually handled to the location of the proposed ground mount array in the field.



Spirit Energy

44 Portman Road, Reading, Berkshire, RG30 1EA
Telephone: 01189514490 Fax: 01189514499

SITE		Holt Farm House B14 6RT	
DESCRIPTION		Trenching Details	
CLIENT		Mr Richard Learoyd	
DATE	11/02/2026	SCALE	1:500 @A3
DRAWN	JT	DRAWING NO.	40621-6
		REV	A