


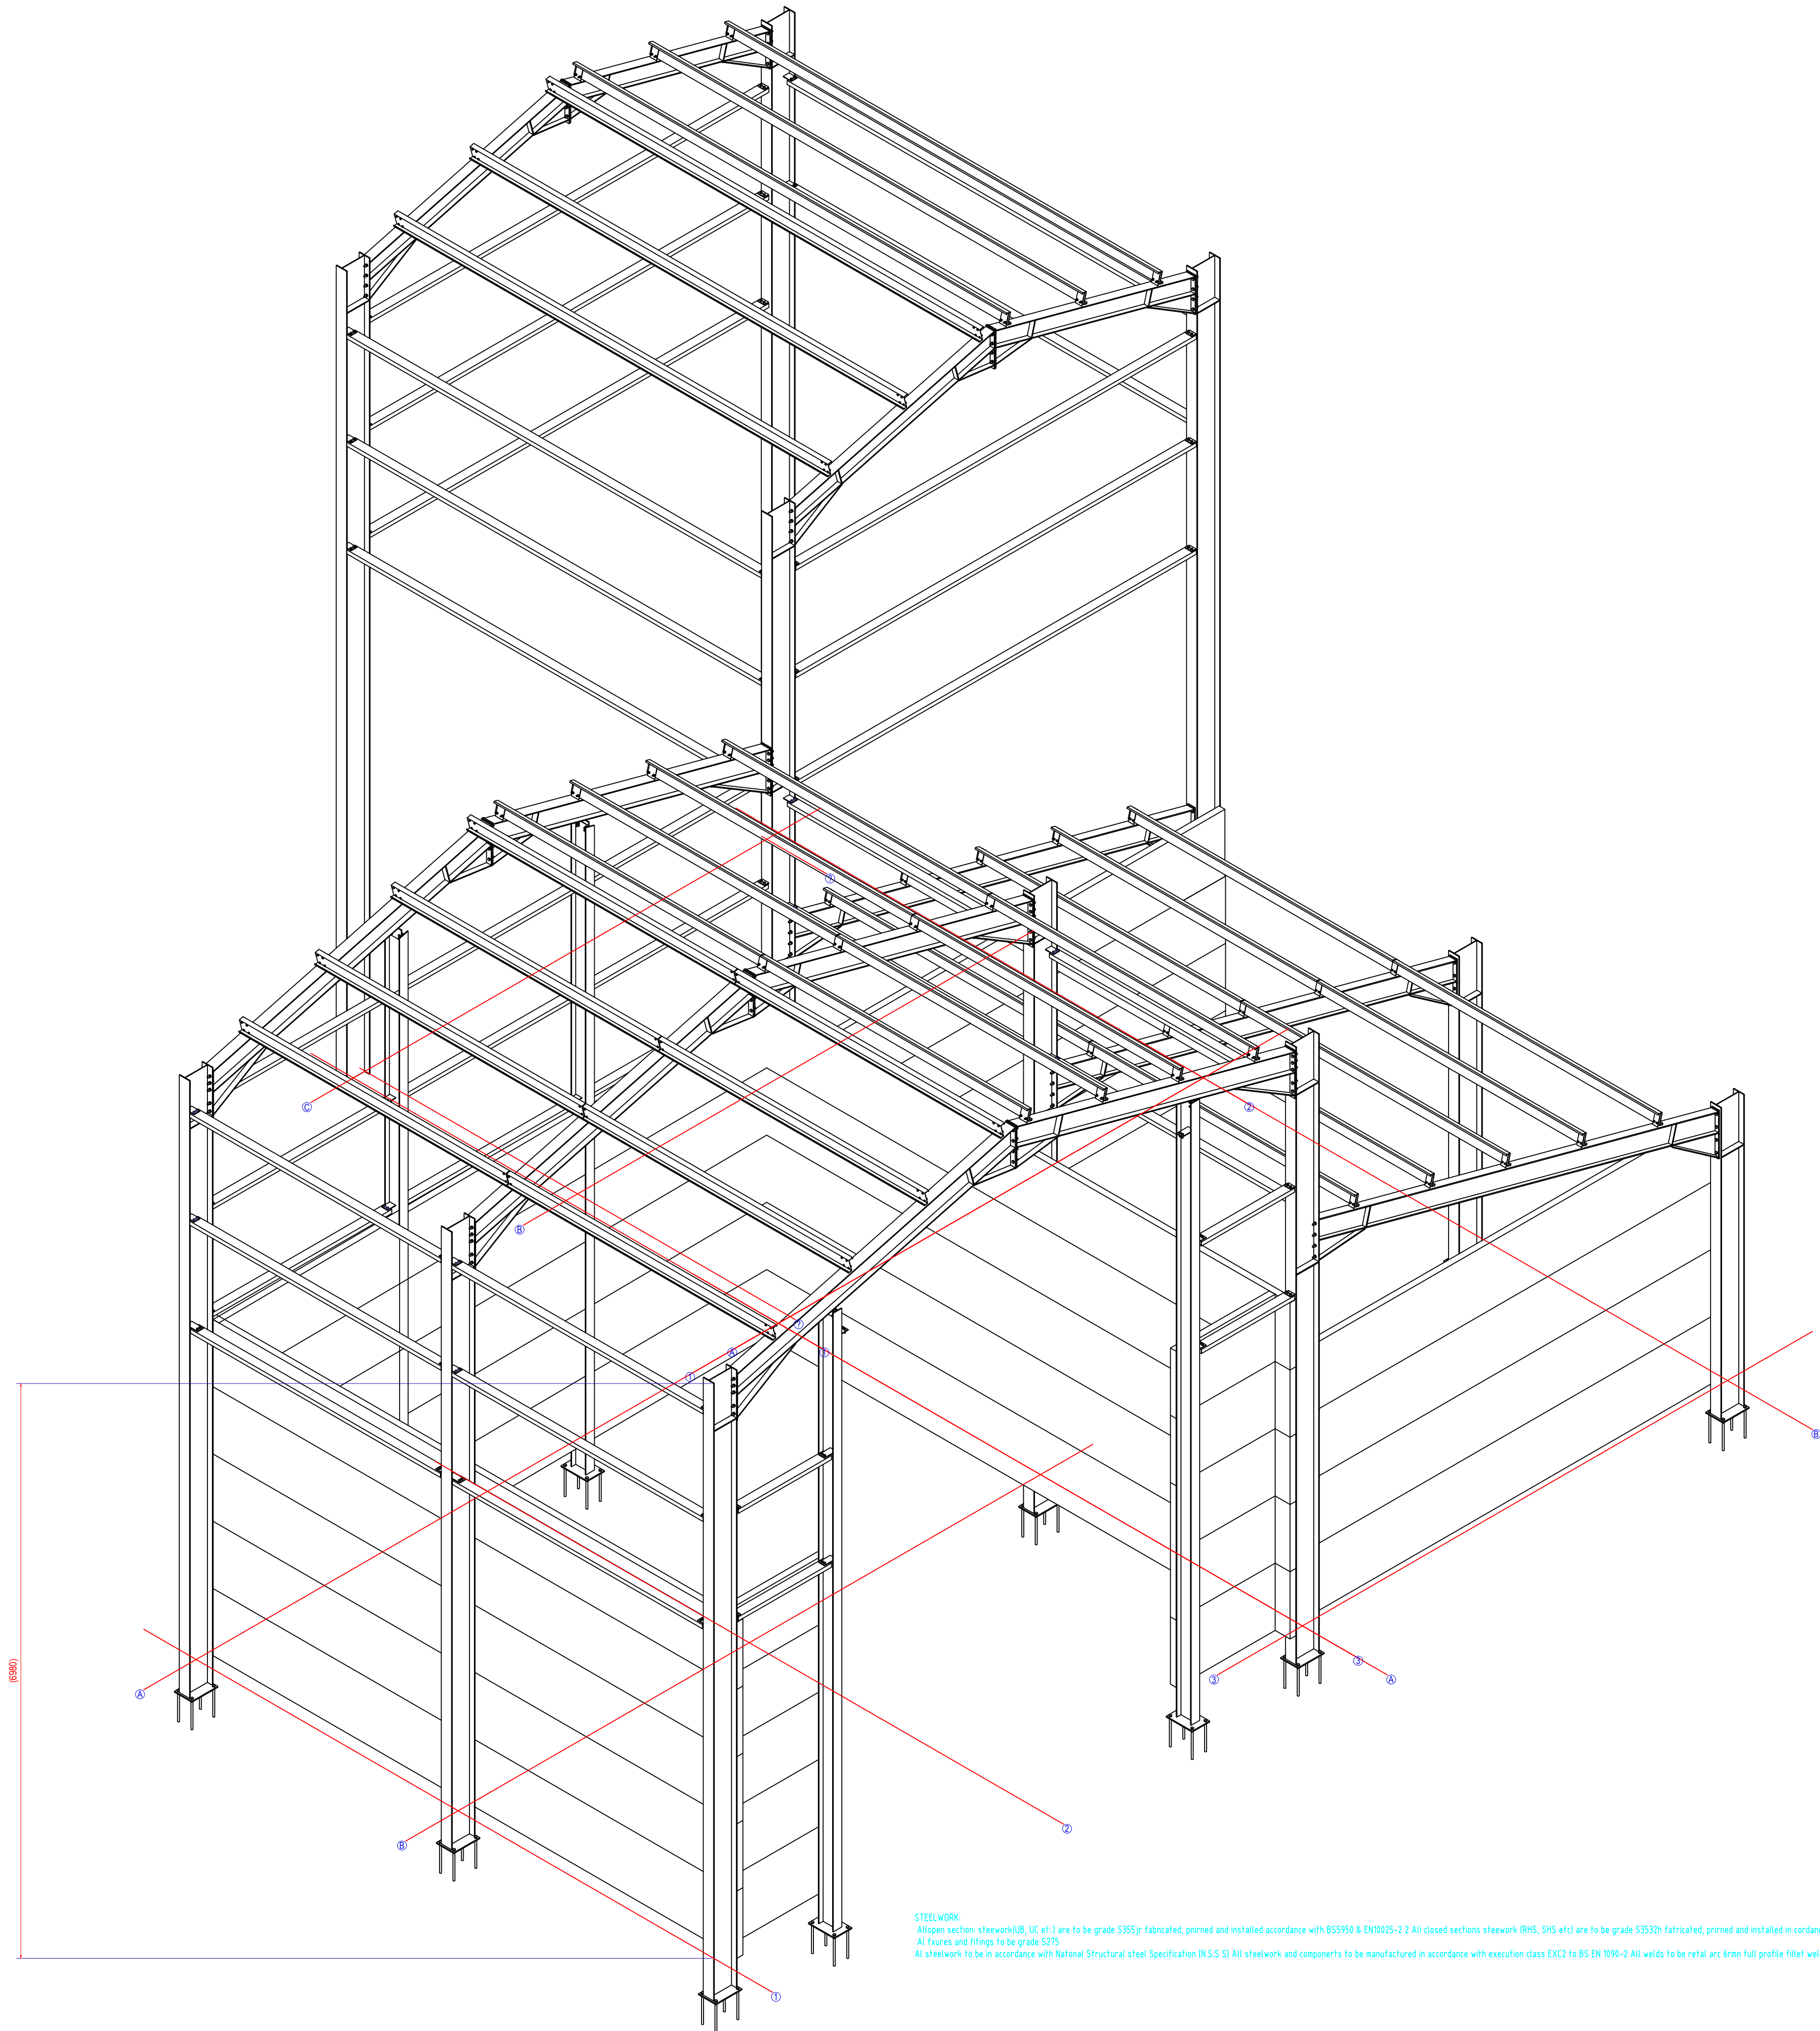

STEELWORK  
All open section steelwork (UB, UC etc.) are to be grade S355jr fabricated, primed and installed in accordance with BS5950 & EN10225-2.2 All closed sections steelwork (RHS, SHS etc) are to be grade S355Dh fabricated, primed and installed in accordance with BS5950 & EN10210  
All fixings and fittings to be grade S275  
All steelwork to be in accordance with National Structural steel Specification (N.S.S SI) All steelwork and components to be manufactured in accordance with execution class EXC2 to BS EN 1090-2 All welds to be rebar arc 6mm full profile fillet welds u.n.o. bolts. To be galvanised if in external/exposed conditions.