



NOTES (CONT.)

6. DEPTH OF FOOTINGS TO BE APPROVED BY THE BUILDING INSPECTOR
7. EXTERNAL WALLS TO BE RENDERED 100mm BLOCKS, 150mm CAVITY FILLED WITH DRITHERM 32, 100mm INSULATION BLOCKS AND DRY-LINE WITH 12.5mm PLASTERBOARD.
8. PROVIDE S/S WALL TIES AT 450mm CRS VERTICALLY AND 700mm CRS HORIZONTALLY; AT REVEALS TO BE 225mm VERTICALLY.
9. PROVIDE CATNAC CG 150/100 LINTELS OVER ALL OPENINGS AND PRE-FORMED CAVITY CLOSERS TO REVEALS.
10. PROVIDE S/S FIRFIX TO FIX NEW BLOCKWORK TO EXISTING AND CUT IN A VERTICAL DPC INTO EXISTING AT CENTRE LINE OF CAVITIES.
11. LINE EXISTING W.C./GARAGE WALLS WITH 100mm STUDWORK WITH 50mm CAVITY, 100mm CELOTEX BETWEEN STUDS, AND 12.5mm PLASTERBOARD ON 50mm CELOTEX.
12. ALL STRUCTURAL TIMBERS TO BE TREATED
13. ALL ELECTRICS TO BE CARRIED OUT BY QUALIFIED ELECTRICIANS; ON COMPLETION PROVIDE TEST CERTIFICATE FOR THE BUILDING INSPECTOR.
14. ALL LIGHT FITTINGS TO BE LOW ENERGY.
15. PROVIDE MECHANICAL VENTILATION TO W.C. AND UTILITY (15L/SEC)
16. PROVIDE 75mm RUNNING TRAPS TO BASIN (32mm DIA) AND SINK (38mm DIA)
17. CONNECT FITTINGS TO EXISTING DRAINAGE TO APPROVAL OF THE BUILDING INSPECTOR.

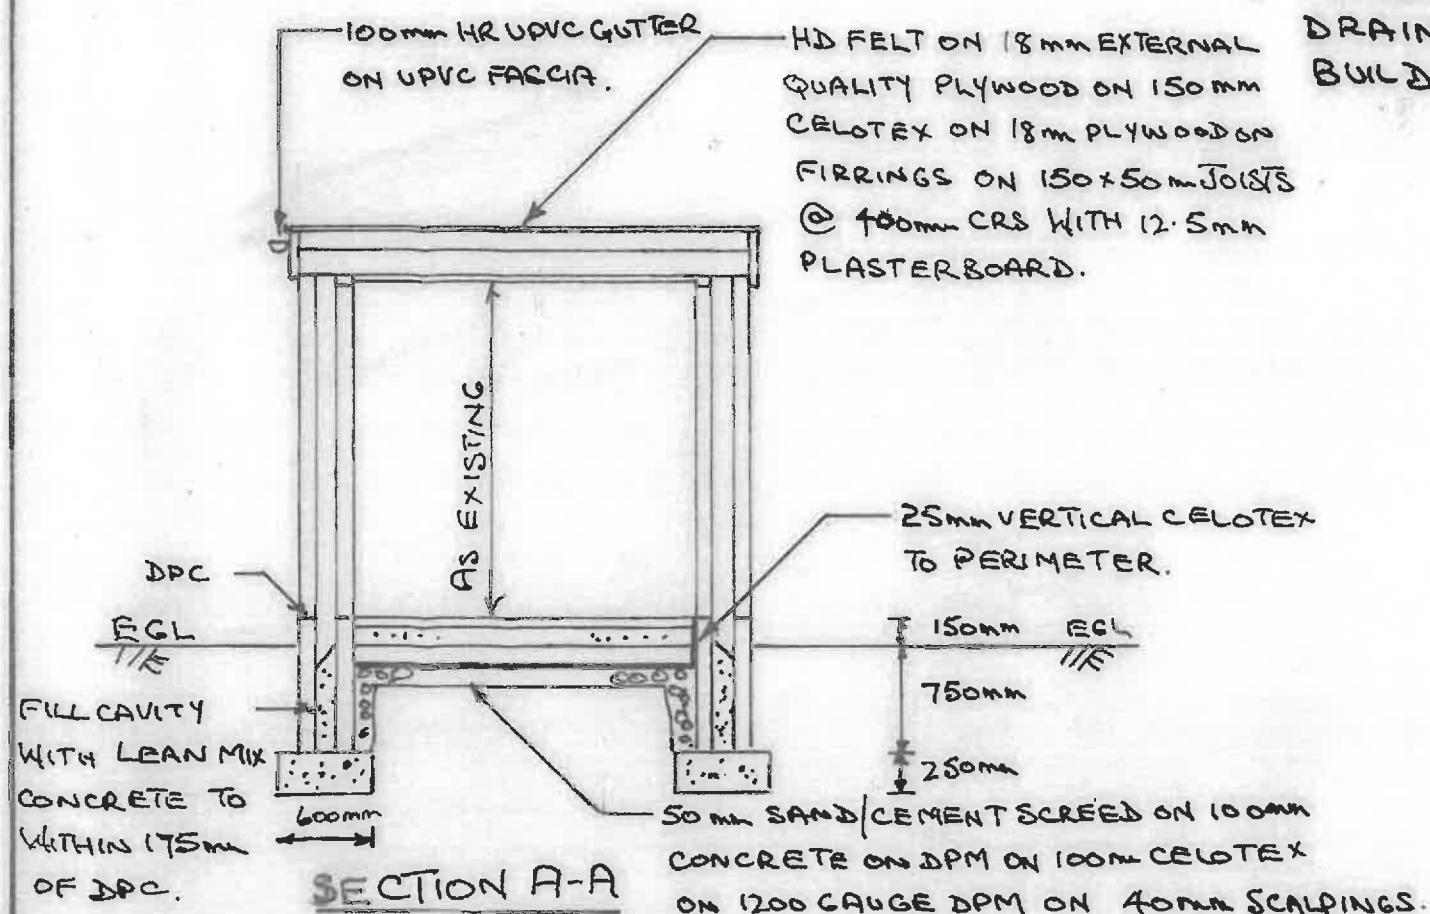

SCALE:- 1 TO 50

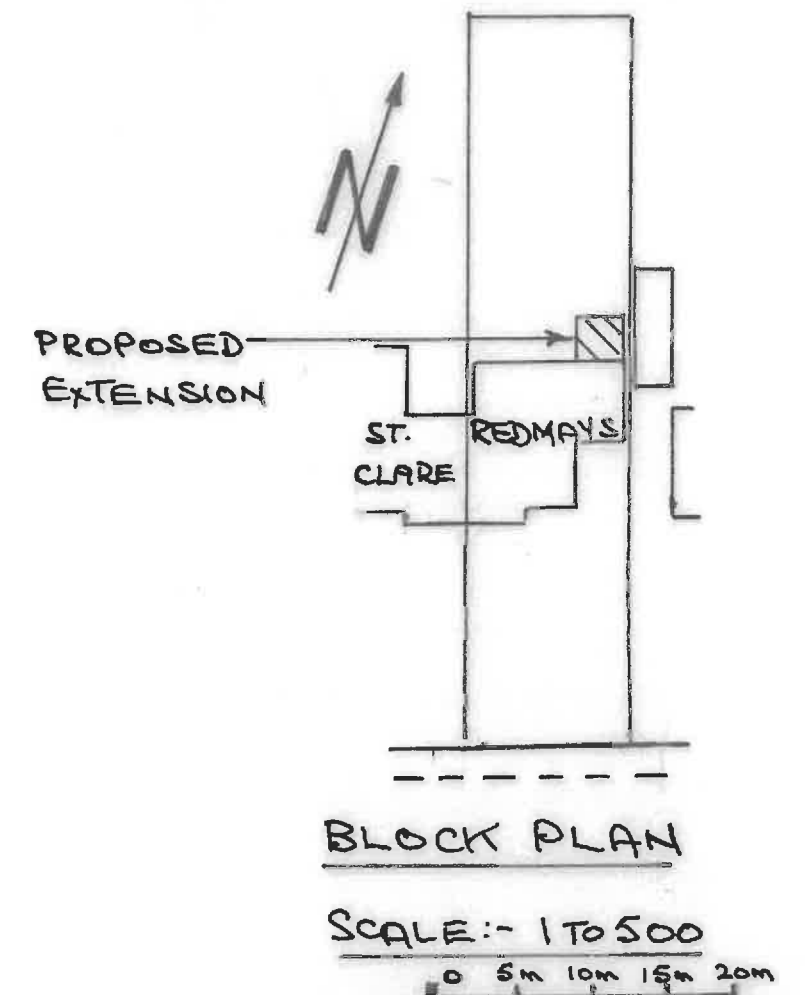

CLIENT:-

MR AND MRS B. AKRAM

ADDRESS:-

REDMAYS

BATH ROAD

DEVIZES SN10 1QG

PROPOSED
EXTENSION

SCALES:- AS SHOWN

DATE:- FEB 2026

DRAWING N° 6