


EN SUITE	Required Flow (l/s)	Required Ticks (l/s)
En Suite 1	9.4	8.5
En Suite 2	9.4	8.5
Total	18.7	17.0

QUIET	Required Flow (l/s)	Required Ticks (l/s)
Bedroom 2	12.3	11.2
Bedroom 3	6.4	5.8
Total	18.7	17.0

(Above flow rates based on duration design for 100% reliability, less than 10% in 24 hours. If more than 10% the noise level will be lower).

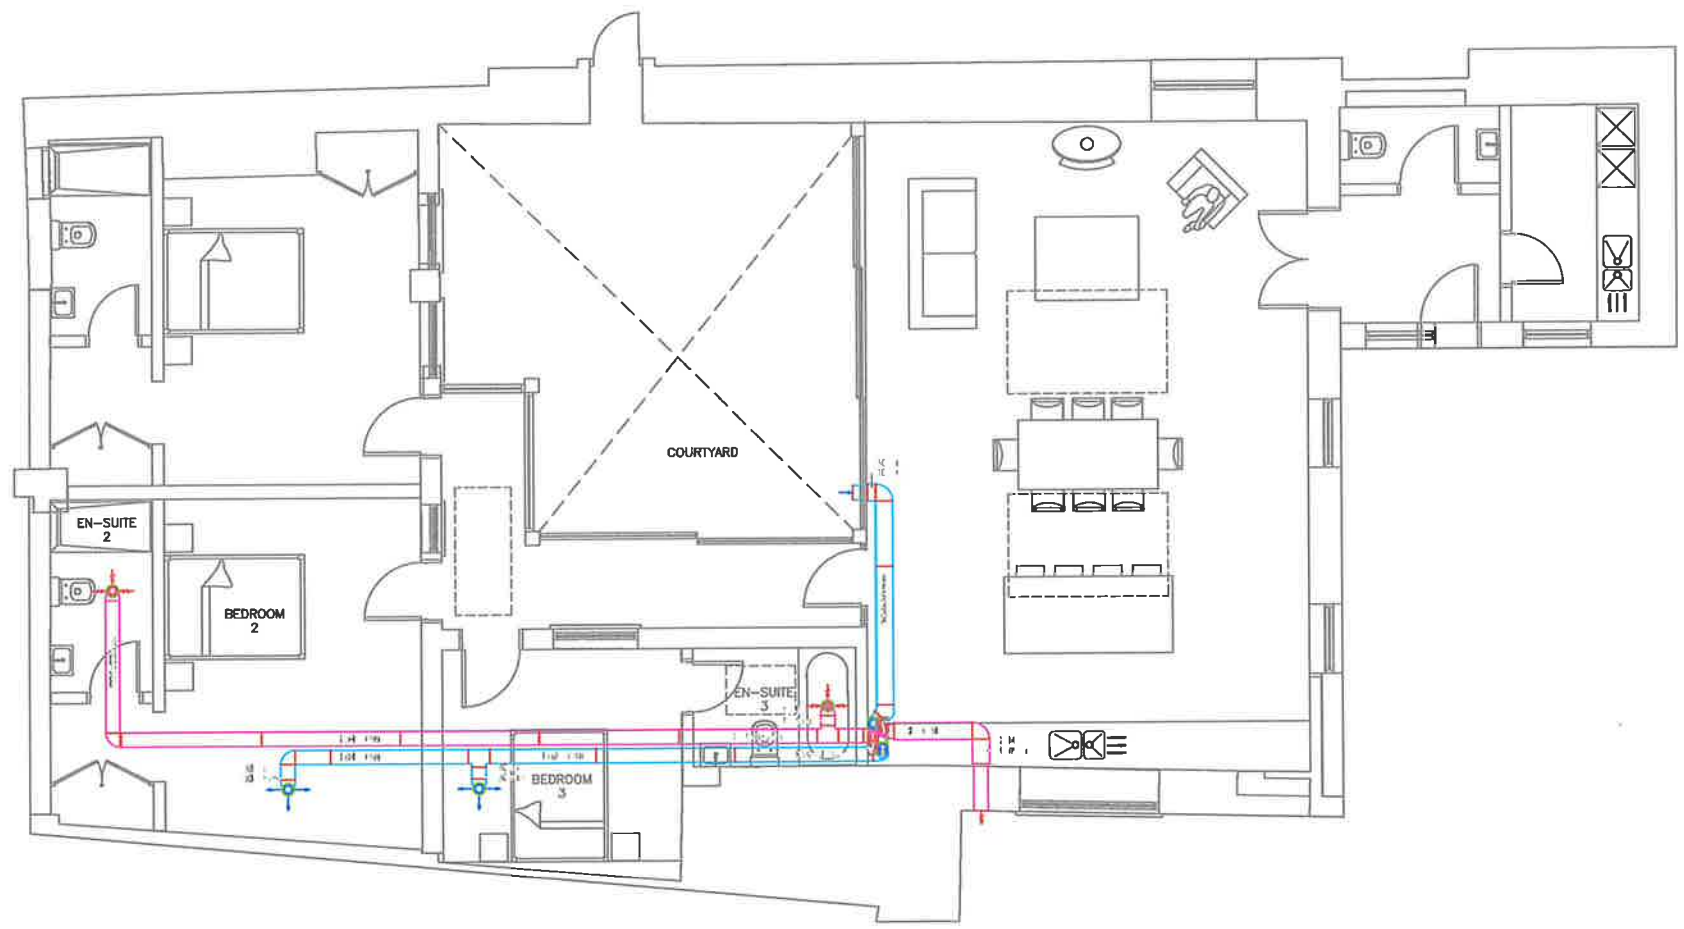

SERVICEVENT

Address: Street,
City: SP1 1DL

Project: Ventilation Layout

Prepared: 01/01/2024

Rev	Date	By
1	2024-01-01	DR
2	2024-01-01	DR
3	2024-01-01	DR