


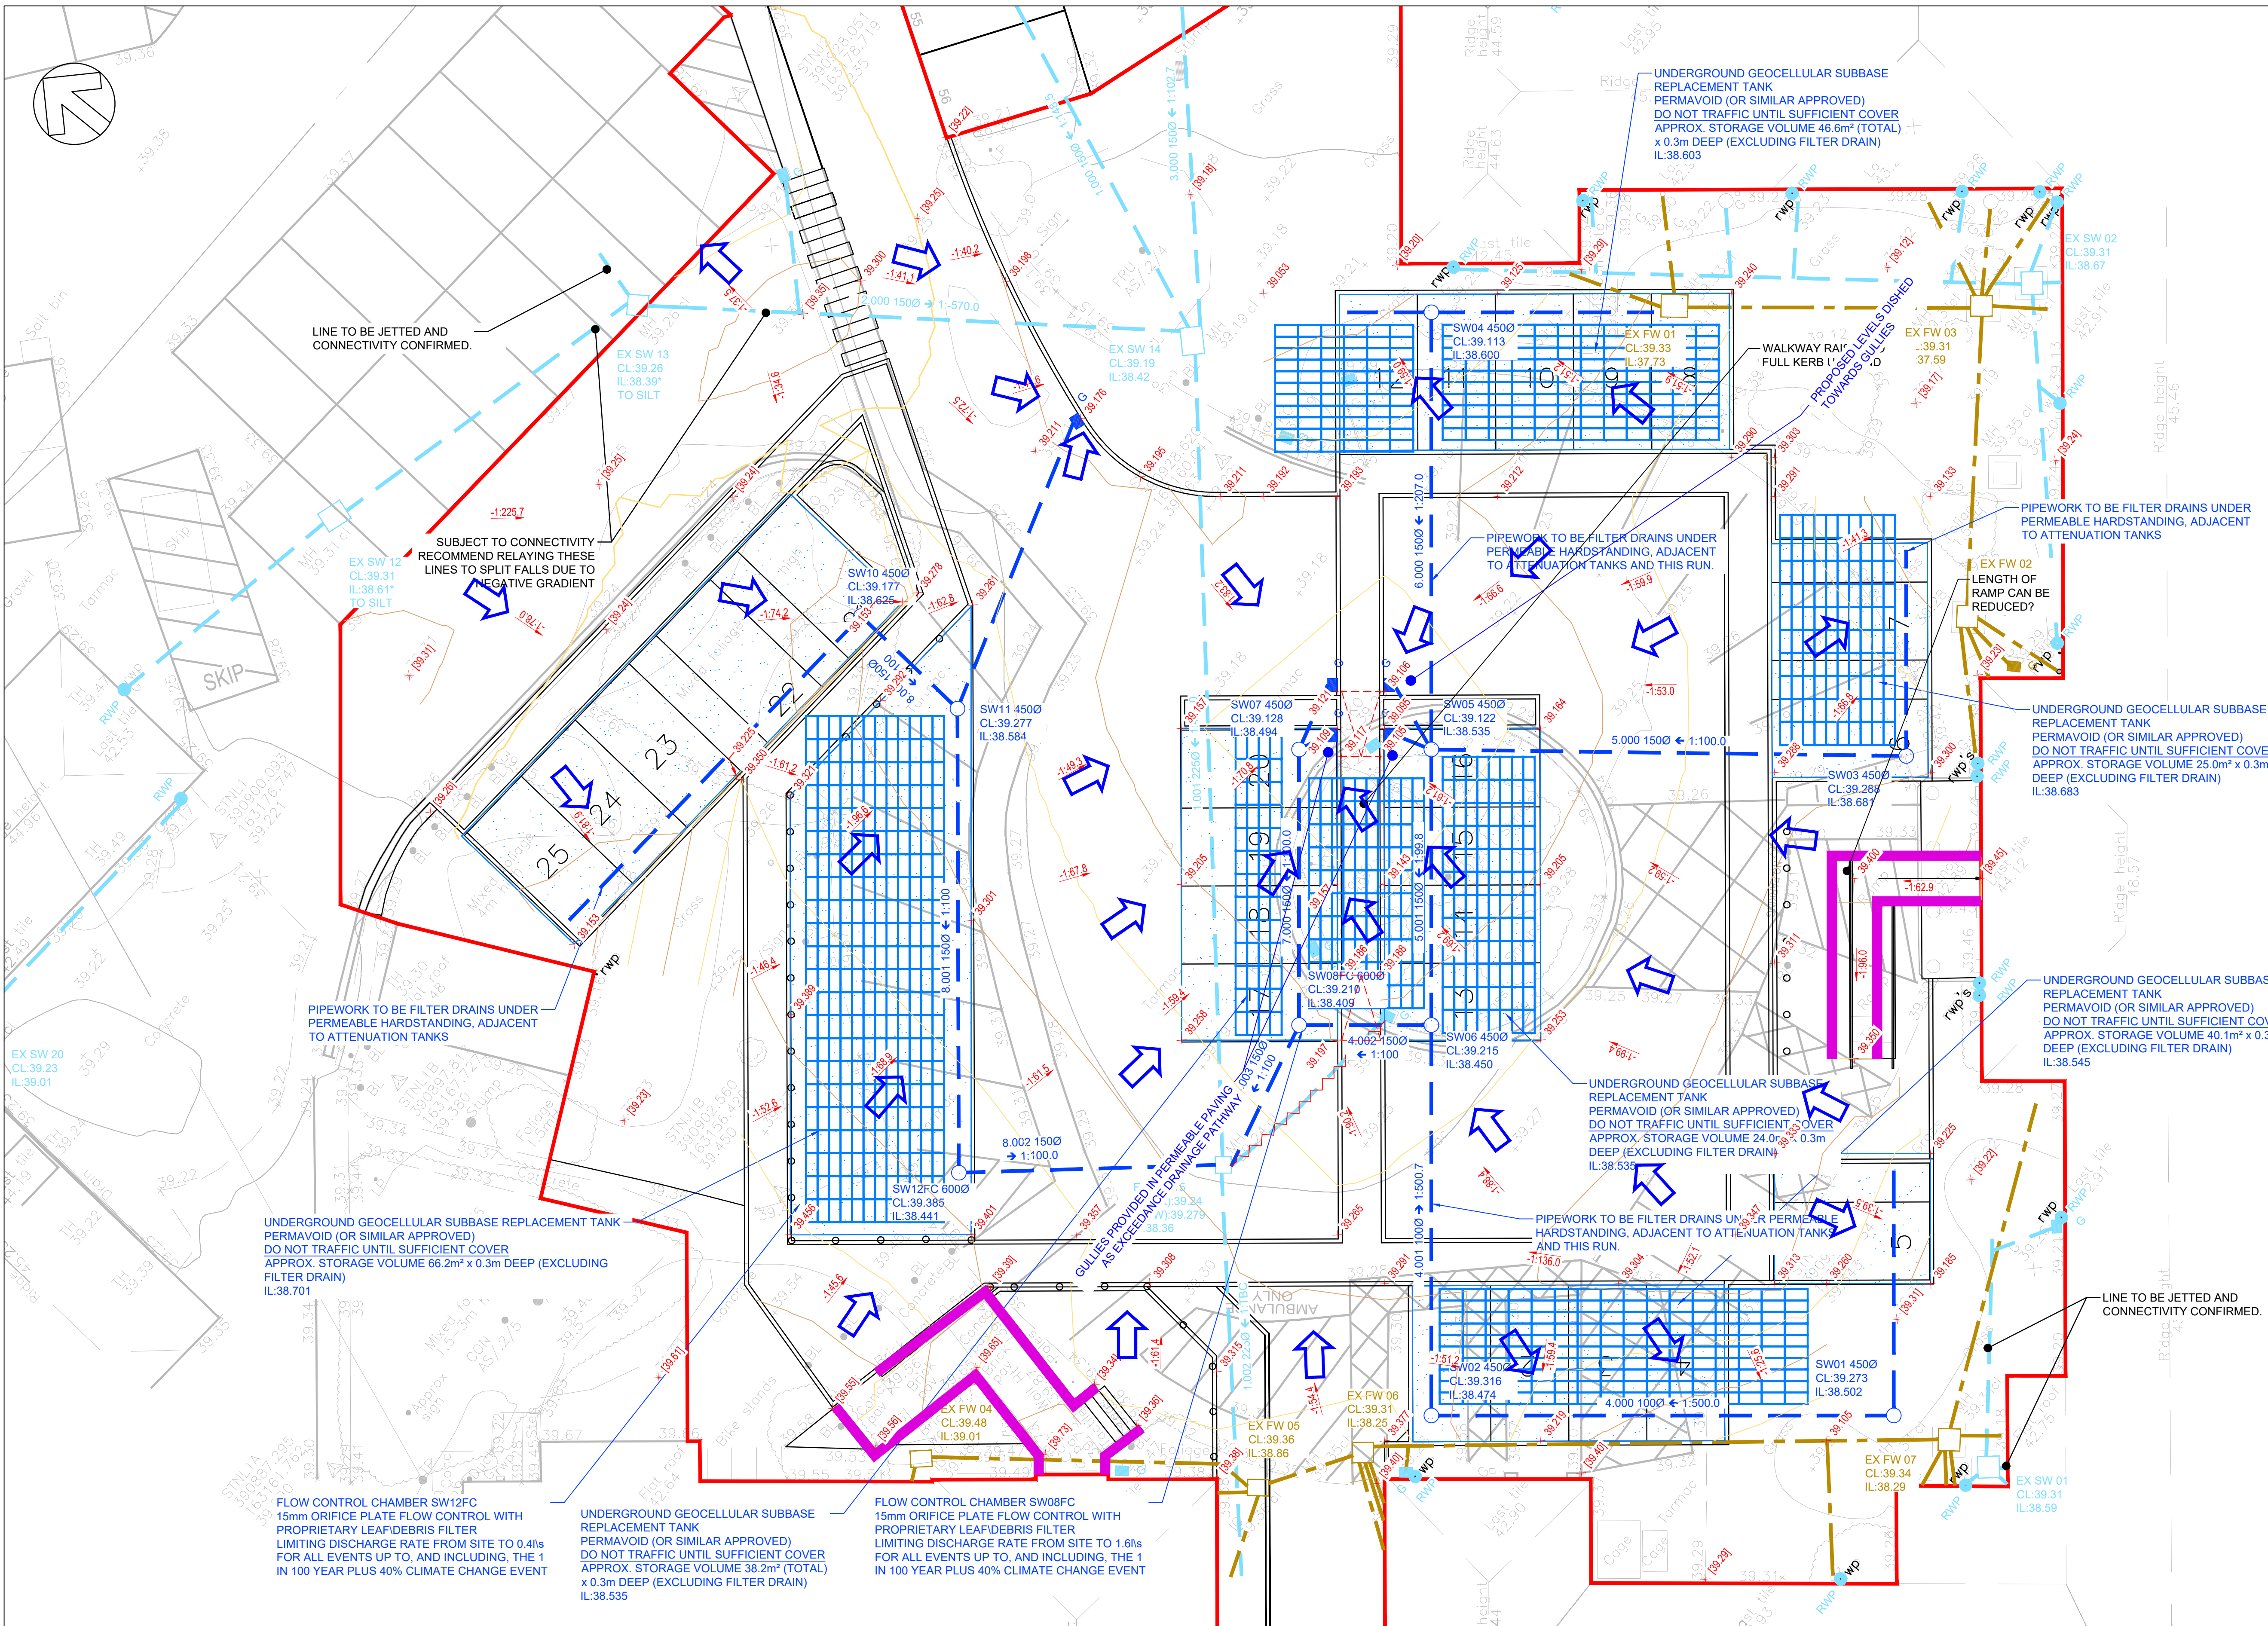

- LEGEND**
- 46.600m x PROPOSED SPOT LEVEL
 - x[46.41] EXISTING/TIE-IN LEVEL
 - 1.50.0 PROPOSED CROSSFALL
 - RETAINING WALL
 - BANK AT MAX 1 IN 3 WITH 0.5m BERM TOP AND BOTTOM

- LEGEND**
- SITE BOUNDARY
 - EXISTING ADOPTED FOUL WATER SEWER & MANHOLE
 - EXISTING PRIVATE SURFACE WATER SEWER & MANHOLE
 - PROPOSED PRIVATE SURFACE WATER SEWER (100mmØ UNLESS NOTED OTHERWISE)
 - PROPOSED SUBBASE REPLACEMENT GEOCELLULAR ATTENUATION TANK
 - PROPOSED PERMEABLE PAVING WITH MIN. 350mm AGGREGATE TO BS7533
 - PROPOSED ROAD GULLY WITH HEEL SAFE GRATING
 - EXCEEDANCE ROUTING

- NOTES:**
- DO NOT SCALE FROM DRAWING
 - LOCAL TOPOGRAPHICAL SURVEY TO LOCAL GRID AND NOT OS DATUM
 - DRAWING TO BE READ IN CONJUNCTION WITH ALL RELEVANT DRAWINGS, DETAILS AND SPECIFICATIONS.
 - EXISTING DRAINAGE INFORMATION BASED ON THAMES WATER ASSET PLANS AND TOPOGRAPHICAL SURVEY
 - CHECK ALL EXISTING DRAINAGE INVERTS AND PIPE SIZES AND REPORT FINDINGS TO ENGINEER PRIOR TO COMMENCING DRAINAGE CONSTRUCTION WORKS
 - FOUL DRAIN MINIMUM GRADIENTS (WHERE NOT SHOWN):
 - 6.1. NO W/C 1:40
 - 6.2. 1-4 W/C 1:80
 - SURFACE WATER MINIMUM GRADIENTS (WHERE NOT SHOWN):
 - 7.1. 100mm @ 1:80
 - 7.2. 150mm @ 1:100
 - PLASTIC PIPES TO HAVE A JETTING RESISTANCE OF 4000psi
 - ALL ADOPTED WORKS TO BE IN ACCORDANCE WITH THE DCG AND TO THAMES WATER'S APPROVAL
 - ALL PRIVATE WORKS TO BE IN ACCORDANCE WITH BUILDING REGULATIONS PART H
- PLASTIC PIPES ARE TO BE IN ACCORDANCE WITH THE DCG:

- E2.21 THERMOPLASTICS SOLID WALL PIPES AND FITTINGS FOR GRAVITY SEWERS
- THERMOPLASTICS PIPES, JOINTS AND FITTINGS FOR GRAVITY SEWERS SHALL COMPLY WITH THE RELEVANT PROVISIONS OF BS EN 1401-1 (PVC-U), BS EN 1852-1 (PP), OR BS EN 12666-1 (PE) AS APPROPRIATE.
 - ANCILLARY DRAINAGE FITTINGS SHALL COMPLY WITH BS EN 13598-1 OR BS 4660, AS APPROPRIATE.
- E2.22 THERMOPLASTICS STRUCTURED WALL PIPE
- THERMOPLASTICS STRUCTURED WALL SEWER PIPE SHALL COMPLY WITH THE RELEVANT PROVISIONS OF BS EN 13476-1 AND WIS 4-35-01 AND BS EN 13476-2 OR BS EN 13476-3. PIPES SHALL BE BSI KITEMARKED OR HAVE EQUIVALENT THIRD PARTY CERTIFICATION.
 - PIPES LESS THAN OR EQUAL TO 500 mm IN DIAMETER SHALL HAVE NOMINAL SHORT-TERM RING STIFFNESS NOT LESS THAN 8 kN PER M2 (SN8) OR BE SUBJECT TO A QUALITY SYSTEM FOR STORAGE AND EMBEDMENT.
 - NOMINAL SHORT-TERM RING STIFFNESS OF 2 kN PER M2 (SN2) IS ACCEPTABLE FOR PIPES GREATER THAN 500 mm IN DIAMETER, SUBJECT TO STRUCTURAL DESIGN LOAD CALCULATIONS IN ACCORDANCE WITH BS 9295:2019 WHICH SHALL BE PROVIDED TO SUPPORT THIS.
 - MAXIMUM LENGTH OF PIPE FOR LAYING IS 3 m OR 10 x DN, WHICHEVER IS THE GREATER.

- General Notes**
- TO BE READ WITH ALL OTHER JDL CONSULTANTS LTD DRAWINGS AND SPECIFICATIONS.
 - DO NOT SCALE THIS DRAWING.
 - CONTRACTOR TO VERIFY LOCATION OF ALL EXISTING SERVICES PRIOR TO COMMENCEMENT.
 - ALL WORKS TO BE UNDERTAKEN IN ACCORDANCE WITH JDL SPECIFICATION.

Rev	Date	Revision Description	By	Chk
P01	17.03.26	FIRST ISSUE	TN	NB

Rev	Date	Revision Description	By	Chk

JDL CONSULTANTS LTD
CIVIL AND STRUCTURAL CONSULTING ENGINEERS

27A Osprey Court, Hawkfield Way, Hawkfield Business Park, Bristol, BS14 0BB. Tel - 01275 372154
E-mail - jdl@jdlconsultants.co.uk

1st Floor, 200 Tower Bridge Road, London. SE1 2UN.
Tel - 0203 7275 380 E-mail - jdl@jdlconsultants.co.uk

Drawing Title
Exceedance Routing

Author
Kendall Kingscott Ltd

Drawn By	Checked By	Approved By	Date Drawn	Project No.	Scale
TN	NB	NB	17/03/26	24390	1 : 100
Project	Drawn	Checked	Approved	Issue	Rev
24390	JDL	XX	XX	DR	E 02 P01