

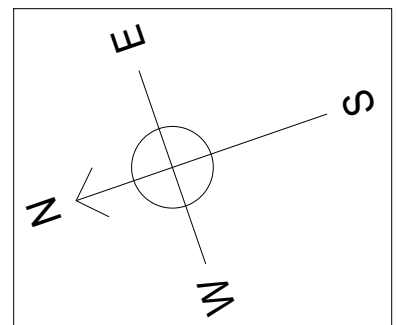


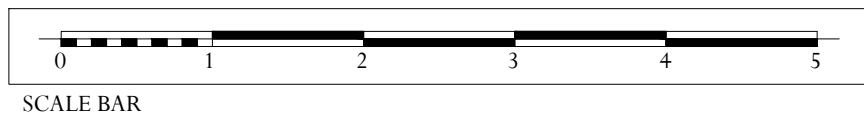

- LEGEND**
- RCWS — BOOSTED RAW COLD WATER SUPPLY
 - SCWS — BOOSTED SOFTENED COLD WATER SUPPLY
 - CWS — CHILLED WATER FLOW AND RETURN (DRY AIR COOLER)
 - HTG-VT — LPHW HEATING F&R PIPEWORK (SPACE HEATING)
 - HWSP — DOMESTIC HOT WATER PIPEWORK (SUPPLY)
 - HWSR — DOMESTIC HOT WATER PIPEWORK (RETURN)
 - FBRE — 1000 DUCT FOR FIBRE / IT INFRASTRUCTURE
 - CATS — CAT 5 WATER SUPPLY. SIZE AS NOTED
 - ELEC — ELECTRICAL SUBMAIN CABLES BURIED DIRECT
 - IRR — IRRIGATION PIPEWORK AND DUCTS CONTROL CABLEING (REFER TO HYDREAU) FOR FURTHER INFORMATION
 - 1000 — 1000 DUCT FOR LOCAL POWER AND LIGHTING CABLEING
 - 1000 — 1000 DUCT FOR AV AND LIGHTING CONTROL CABLEING (TBC BY CONTRACTOR TO SUIT LIGHTING DESIGN)
 - LGT — SURFACE WATER GULLY (SEE STRUCTURAL ENGINEERS DRAWINGS FOR FURTHER DETAILS)
 - DP — 300x300mm DRAW PIT FOR LIGHTING / POWER / AV CABLEING
 - IRR — 450x450 DRAW PIT FOR FIBRE / IT INFRASTRUCTURE
 - IRR — IRRIGATION SYSTEM VALVE BOX (REFER TO HYDREAU) FOR FURTHER INFORMATION
 - LGT — 300(H) x 300(W) x 150(D) (APPROX) EXTERNAL WEATHROOF ENCLOSURE FOR EXTERNAL LIGHTING DRIVERS (TBC BY CONTRACTOR TO SUIT LIGHTING DESIGN)
 - IP65 — EXTERNAL IP RATED TWIN SOCKET OUTLET
 - IP65 — EXTERNAL IP RATED TWIN SOCKET OUTLET WITHIN IN-GROUND RAISE AND LOWER FRAME - PRECISE SPECIFICATION TBC
 - IP65 — TP+N ISOLATOR (PRECISE REQUIREMENT TBC WITH SPECIALIST)
 - SP — EXTERNAL IP RATED SPEAKER - REFER TO AV SPECIALISTS INFORMATION FOR FURTHER DETAILS
 - SUB — EXTERNAL IP RATED SUBWOOFER - REFER TO AV SPECIALISTS INFORMATION FOR FURTHER DETAILS
 - — LIGHTNING PROTECTION TAPE / CABLE ROUTE BELOWGROUND (REFER TO PTSG FOR FURTHER DETAILS)
 - E-MAT — LIGHTNING PROTECTION 900 X 900mm COPPER LATTICE EARTH MAT BURIED WITH MINIMUM 300mm COVER (REFER TO PTSG FOR FURTHER DETAILS)

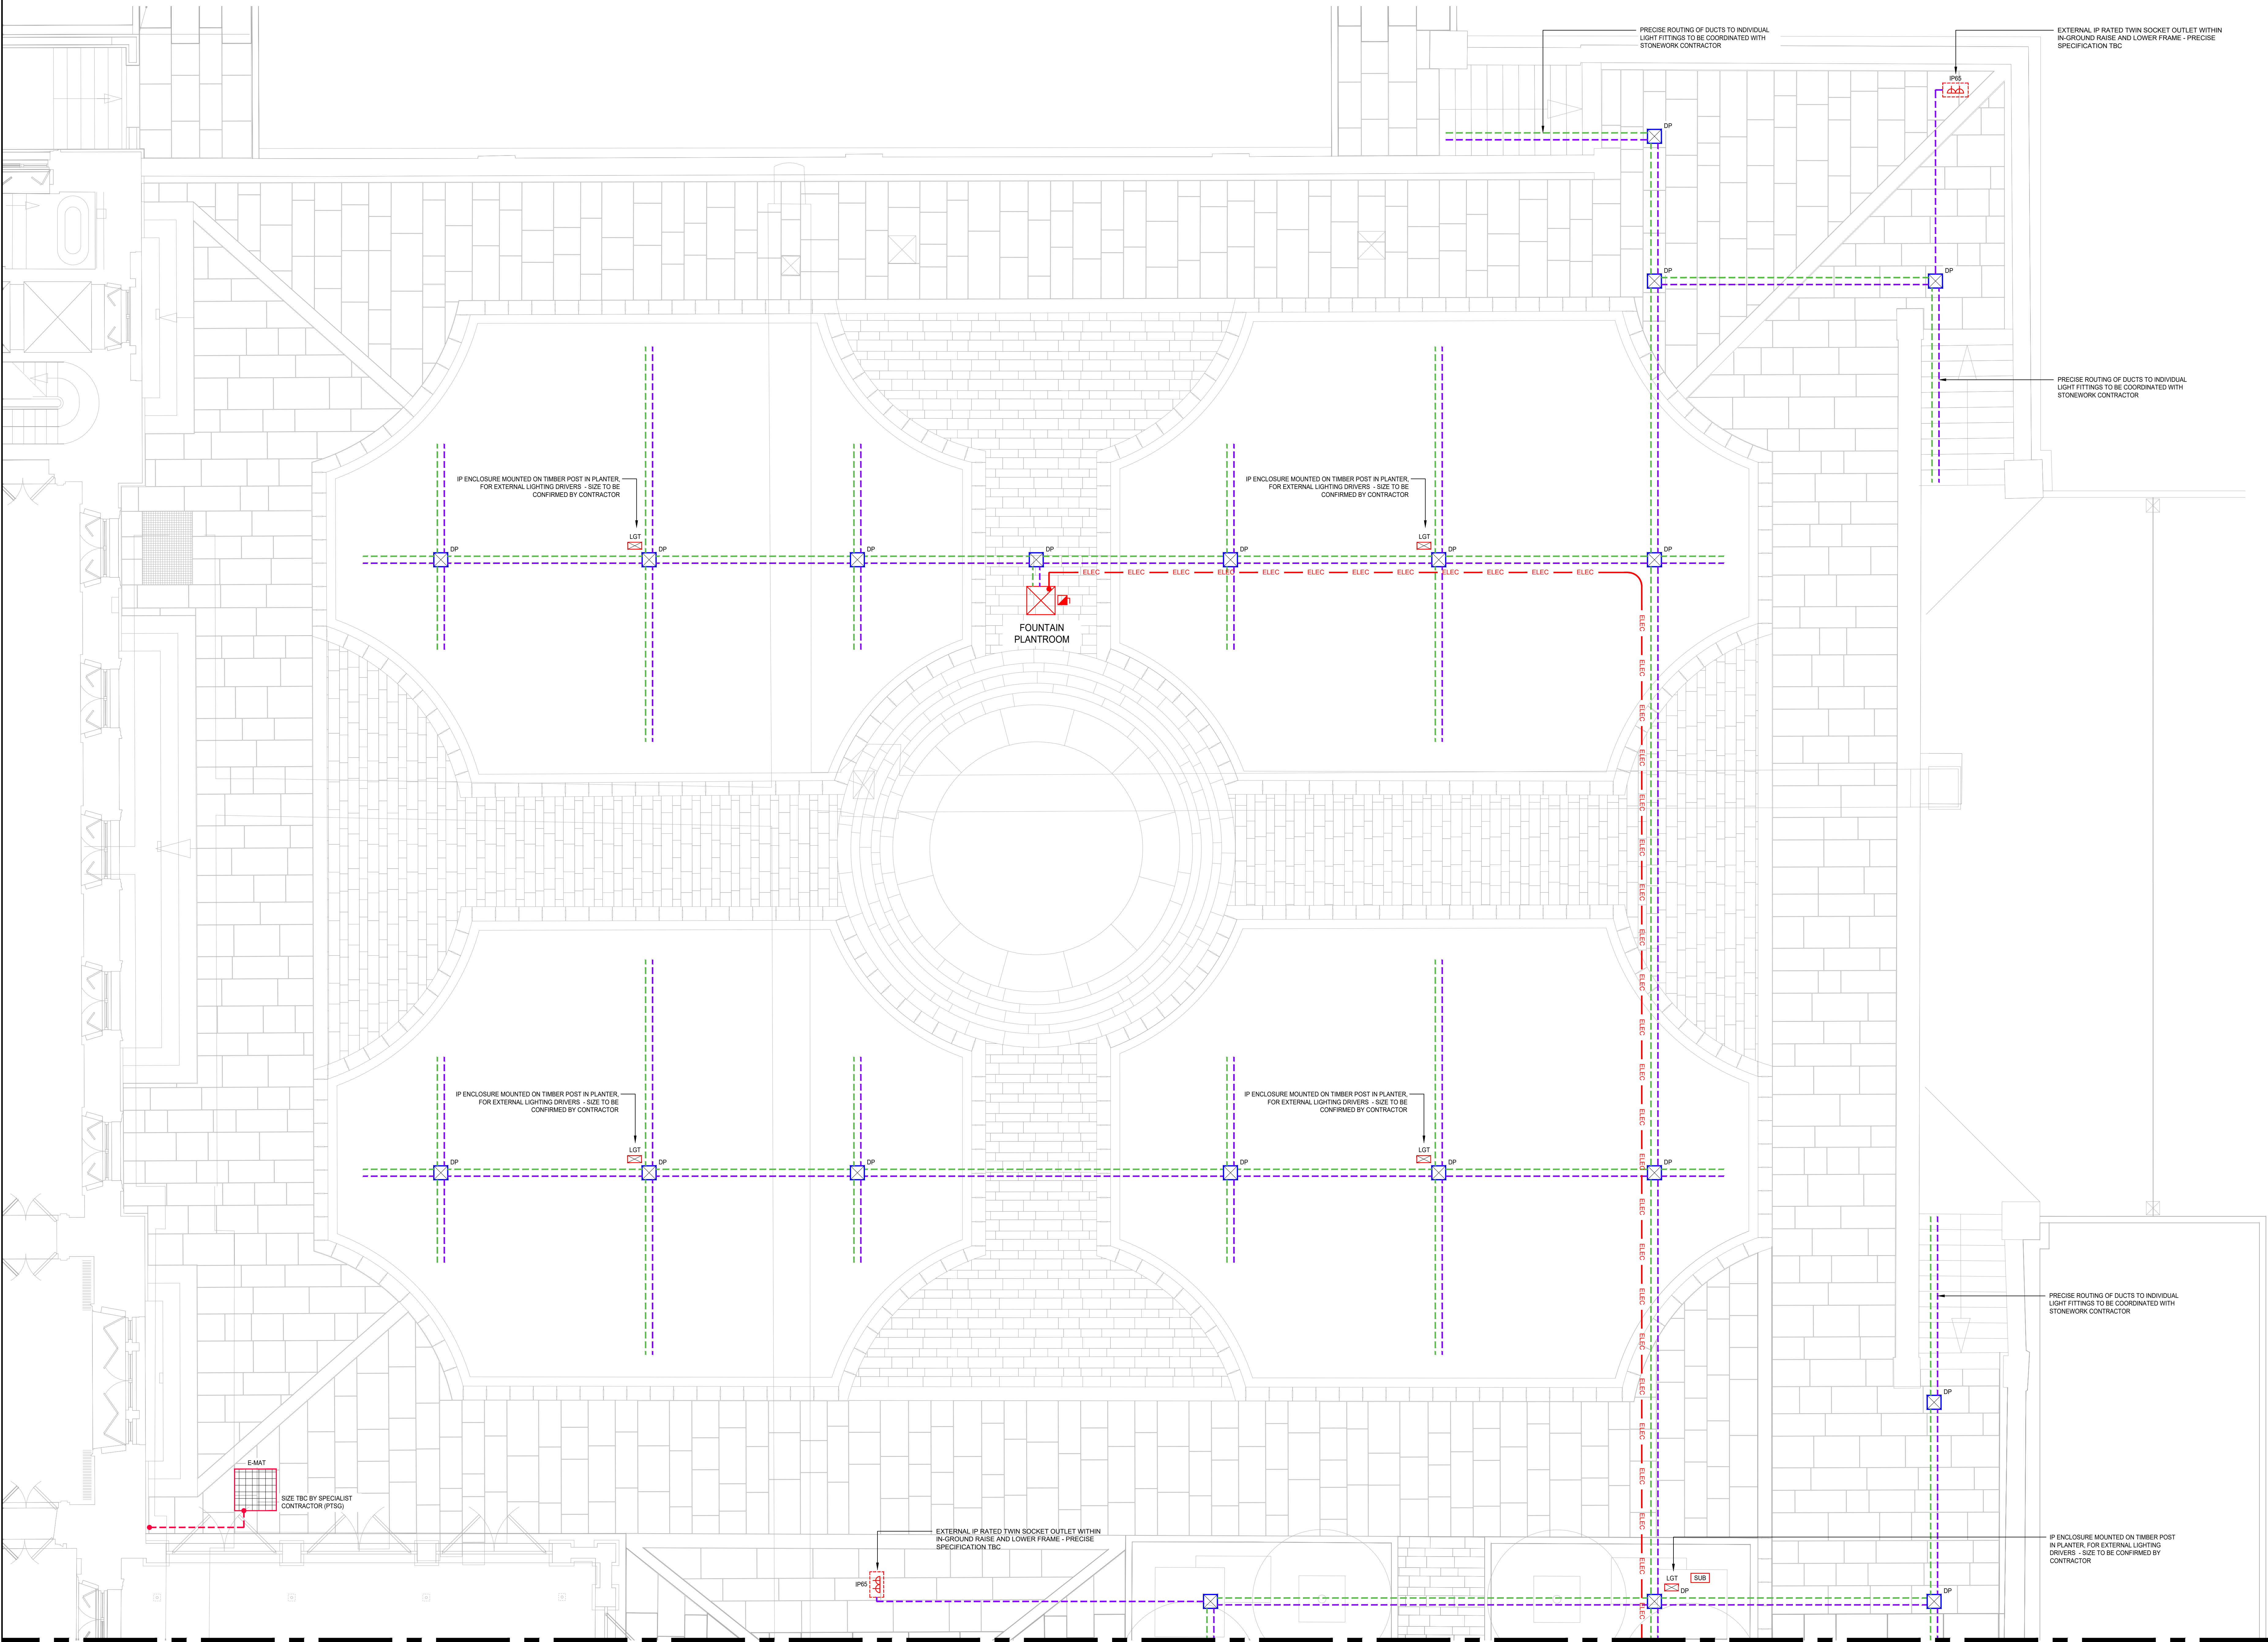


FOR CONTINUATION REFER TO DRAWING: THIF01-VEC-XX-00-DR-U-0014

DIMENSIONS
Figured dimensions are to be taken in preference to scaled dimensions.
All dimensions are to be verified on site prior to work commencing.

DISCREPANCIES
Any discrepancy is to be referred to the consultant before proceeding.

COPYRIGHT
This drawing is the property of VECTOR DESIGN and copyright is reserved by them.
This drawing is issued on the condition that it is not copied or disclosed to any other unauthorised person without the prior consent of VECTOR DESIGN.

RELATED DOCUMENTS
This drawing shall be read in conjunction with the written specification where appropriate.

								Private				Mechanical & Electrical Services Main House South Parterre External Services Layout (1 of 3)				 vector design BUILDING SERVICES CONSULTANTS Church Farm Barns, Copson Lane, Stachampton, OX44 7TZ Tel: 01845 892000 www.vector-design.co.uk					
P2				MINOR UPDATES TO SUIT COMMENTS ISSUED FOR PLANNING				SJF		CJ		09/01/2026									
P1				PRELIMINARY ISSUE FOR COMMENT AND COORDINATION				SJF		CJ		23/12/2025									
								REVISIONS		REVISED BY		DATE		REVISED BY		DATE					
								ADAM ARCHITECTURE				Tottenham House Wiltshire				THIF01-VEC-XX-00-DR-U-0013					
								DESIGN		DESIGNED		CHECKED BY		ISSUED							
								SJF		CJ		1:50		P2							