
	Luminaire A	Luminaire E	Luminaire F
Type	AXIA 3.1 C2.0 - 27K 8 OSLON SQUARE GIANT 540mA WW Inte...	JET 4	GINO 4
Lamp(s)	8 OSLON SQUARE GIANT 540m A WW 2700K	1 LED 3000K	2x4 LED 3000K
Lamp Flux (klm)	2.01	0.55	1.14
Maintenance Factor	1.00	1.00	1.00
No. in Project	4	17	17

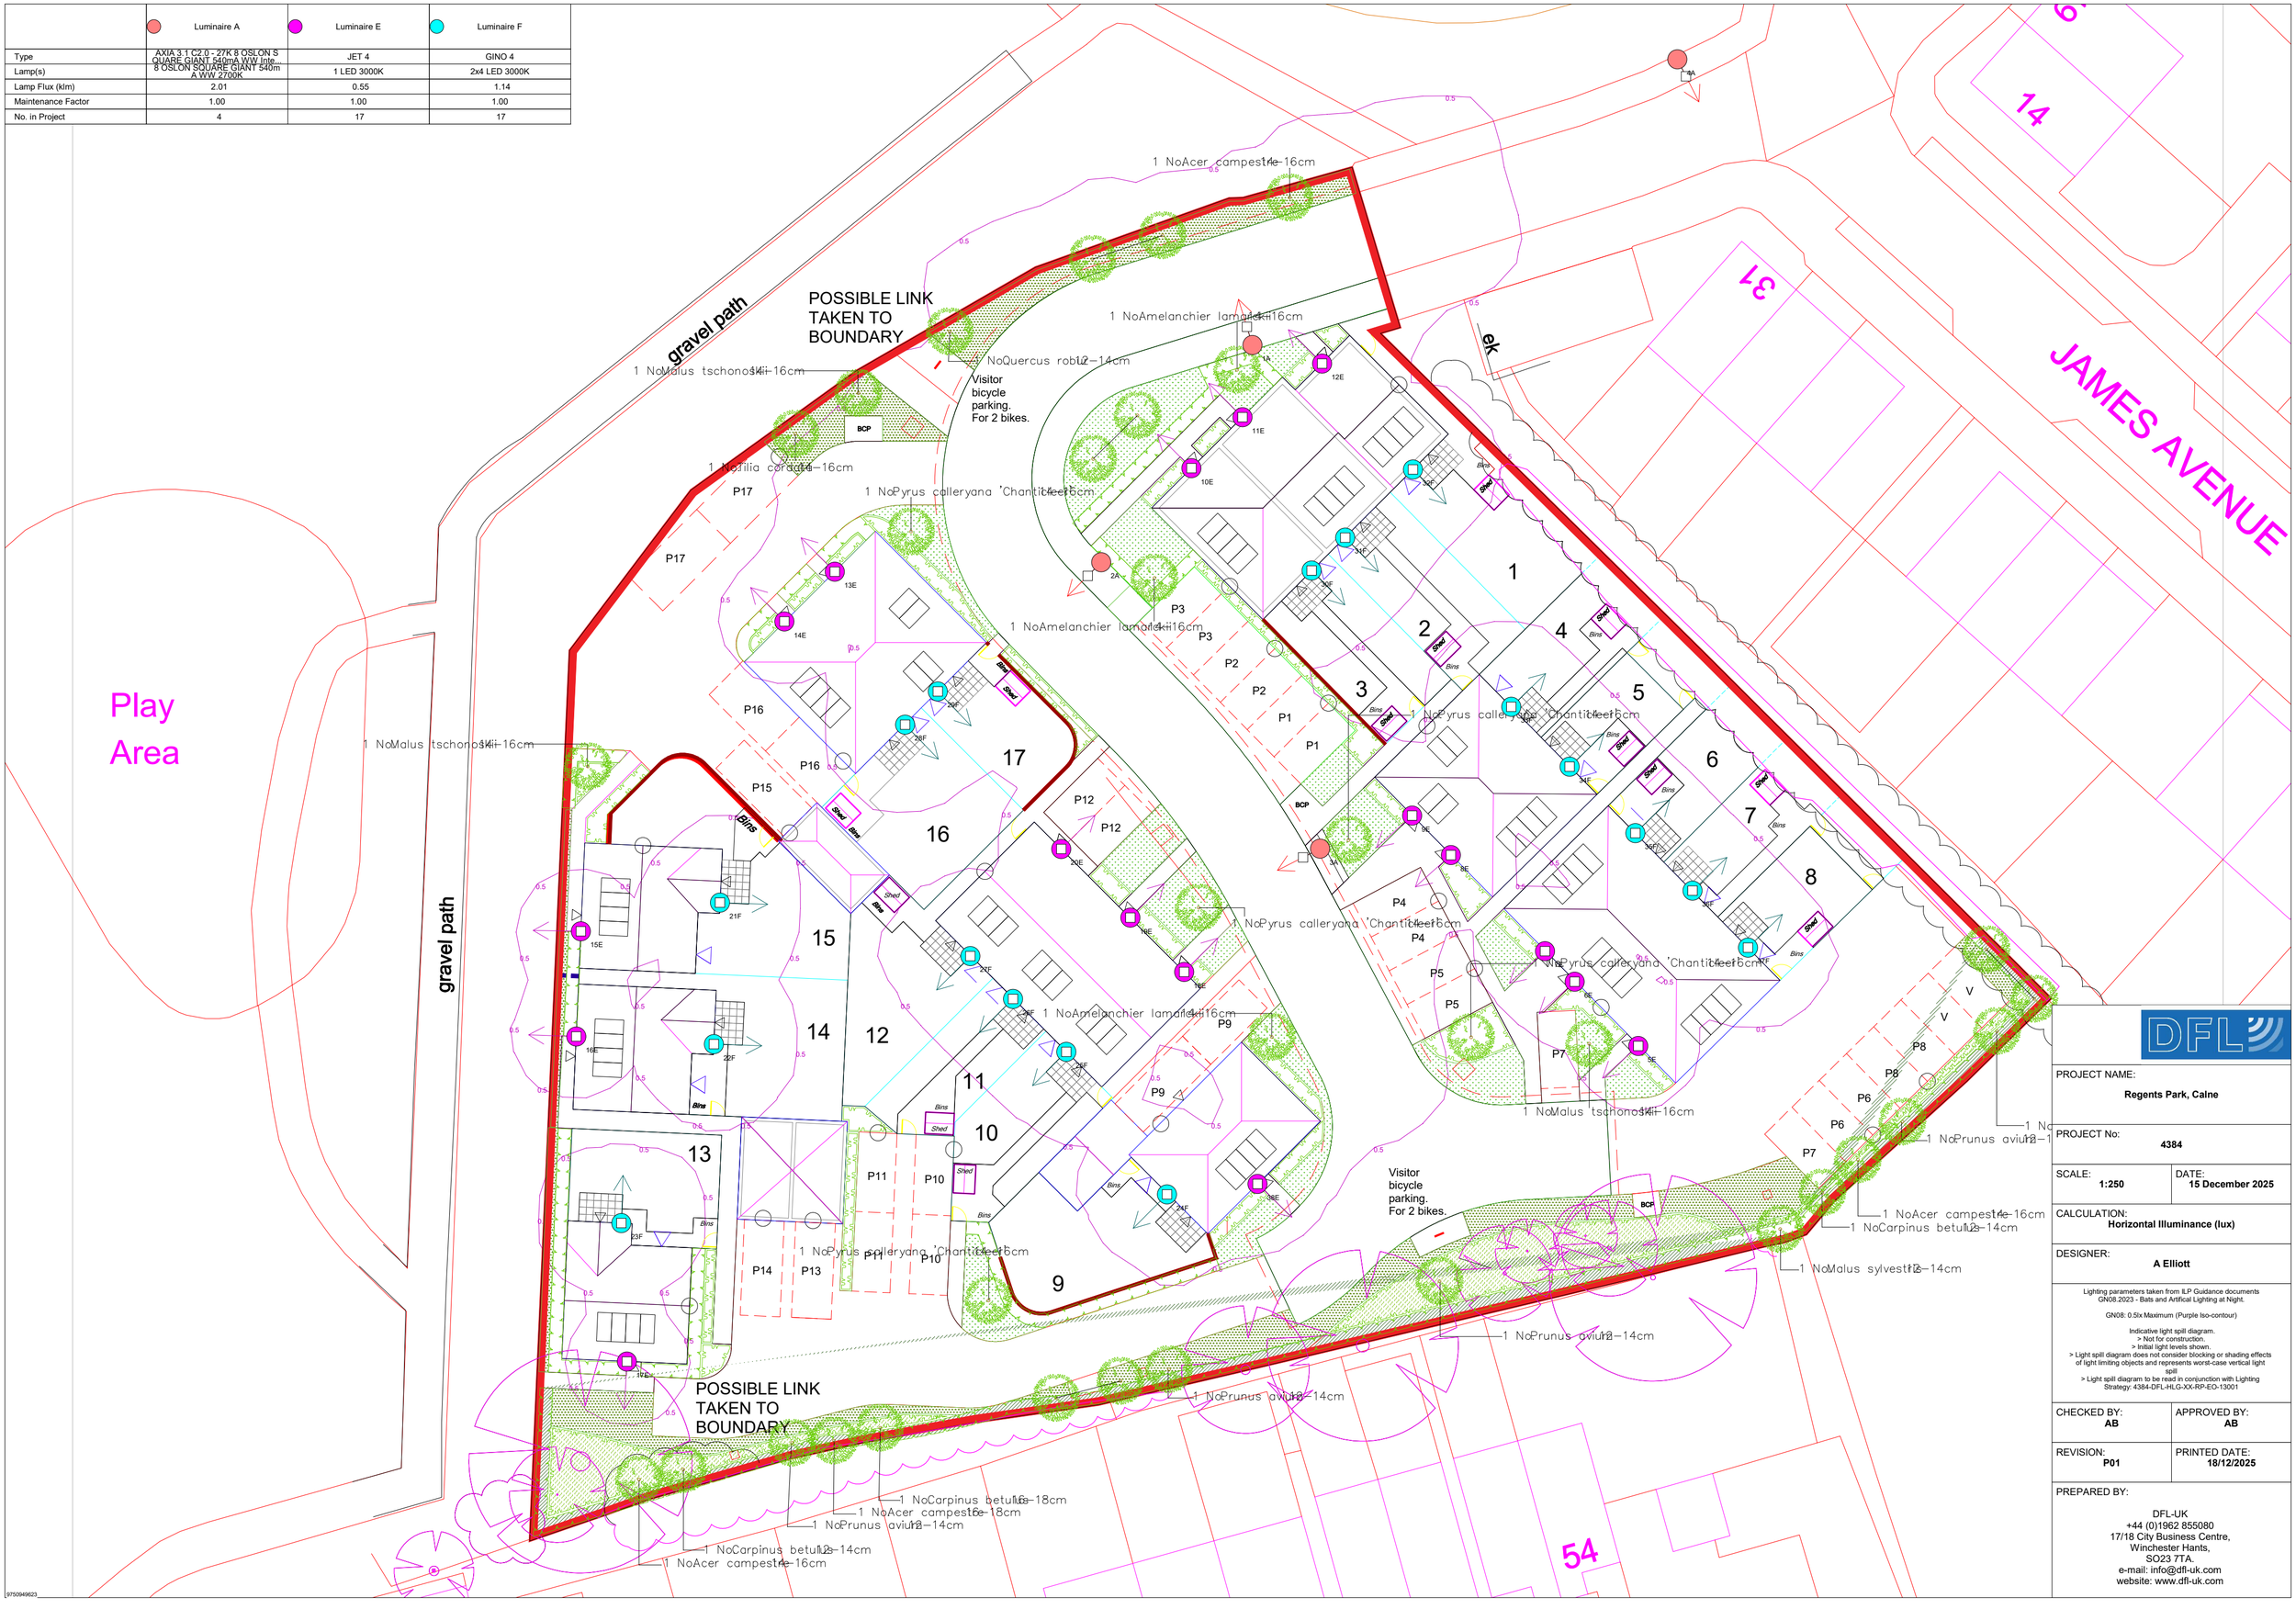

PROJECT NAME:	Regents Park, Calne
PROJECT No:	4384
SCALE: 1:250	DATE: 15 December 2025
CALCULATION:	Horizontal Illuminance (lux)
DESIGNER:	A Elliott

Lighting parameters taken from ILP Guidance documents GN08:2023 - Bats and Artificial Lighting at Night.

GN08: 0.5lx Maximum (Purple Iso-contour)

Indicative light spill diagram.
> Not for construction.
> Initial light levels shown.
> Light spill diagram does not consider blocking or shading effects of light limiting objects and represents worst-case vertical light spill
> Light spill diagram to be read in conjunction with Lighting Strategy: 4384-DFL-HLG-XX-RP-EO-13001

CHECKED BY: AB	APPROVED BY: AB
REVISION: P01	PRINTED DATE: 18/12/2025

PREPARED BY:

DFL-UK
+44 (0)1962 855080
17/18 City Business Centre,
Winchester Hants,
SO23 7TA.
e-mail: info@dfl-uk.com
website: www.dfl-uk.com

9750949623