



Section of existing roof with roof timbers and stone slates still in place. However, it appears that the roof timbers are starting to show signs of collapse.

Structural recommendation to remove stone slates to reduce weight load on existing timbers and prevent further damage in preparation for further structural review of existing structure.

Stone slates to be removed carefully and salvaged for reuse later on. Stone slates are to be store on site in a location to be agreed.



Significant amount of debris within the building, which appears to be roof structure material that has fallen in on the first floor. The build up of debris that is leaning on the external walls are starting to push the walls out with the first floor then eventually collapsing.

Structural recommendation to remove debris to reduce the load impact on the existing external walls and first floor. Further structural survey of the building to then take place.

All existing broken timbers to be removed, along with stone slates and other debris. Stone slates, significant pieces of timber and timber paneling to be salvaged and stored in safe place.

Any first floor structure that is still in original place (and not rotten or damaged) to remain as is.




Significant amount of debris within the building on ground floor, which appears to be general stored materials.

Structural recommendation to remove debris to further structural survey of the building to take place.

Significant pieces of timber and timber paneling and any other historic fabric to be salvaged and stored in safe place.

Any floor and partition structure that is still in original place (and not rotten or damaged) to remain as is.

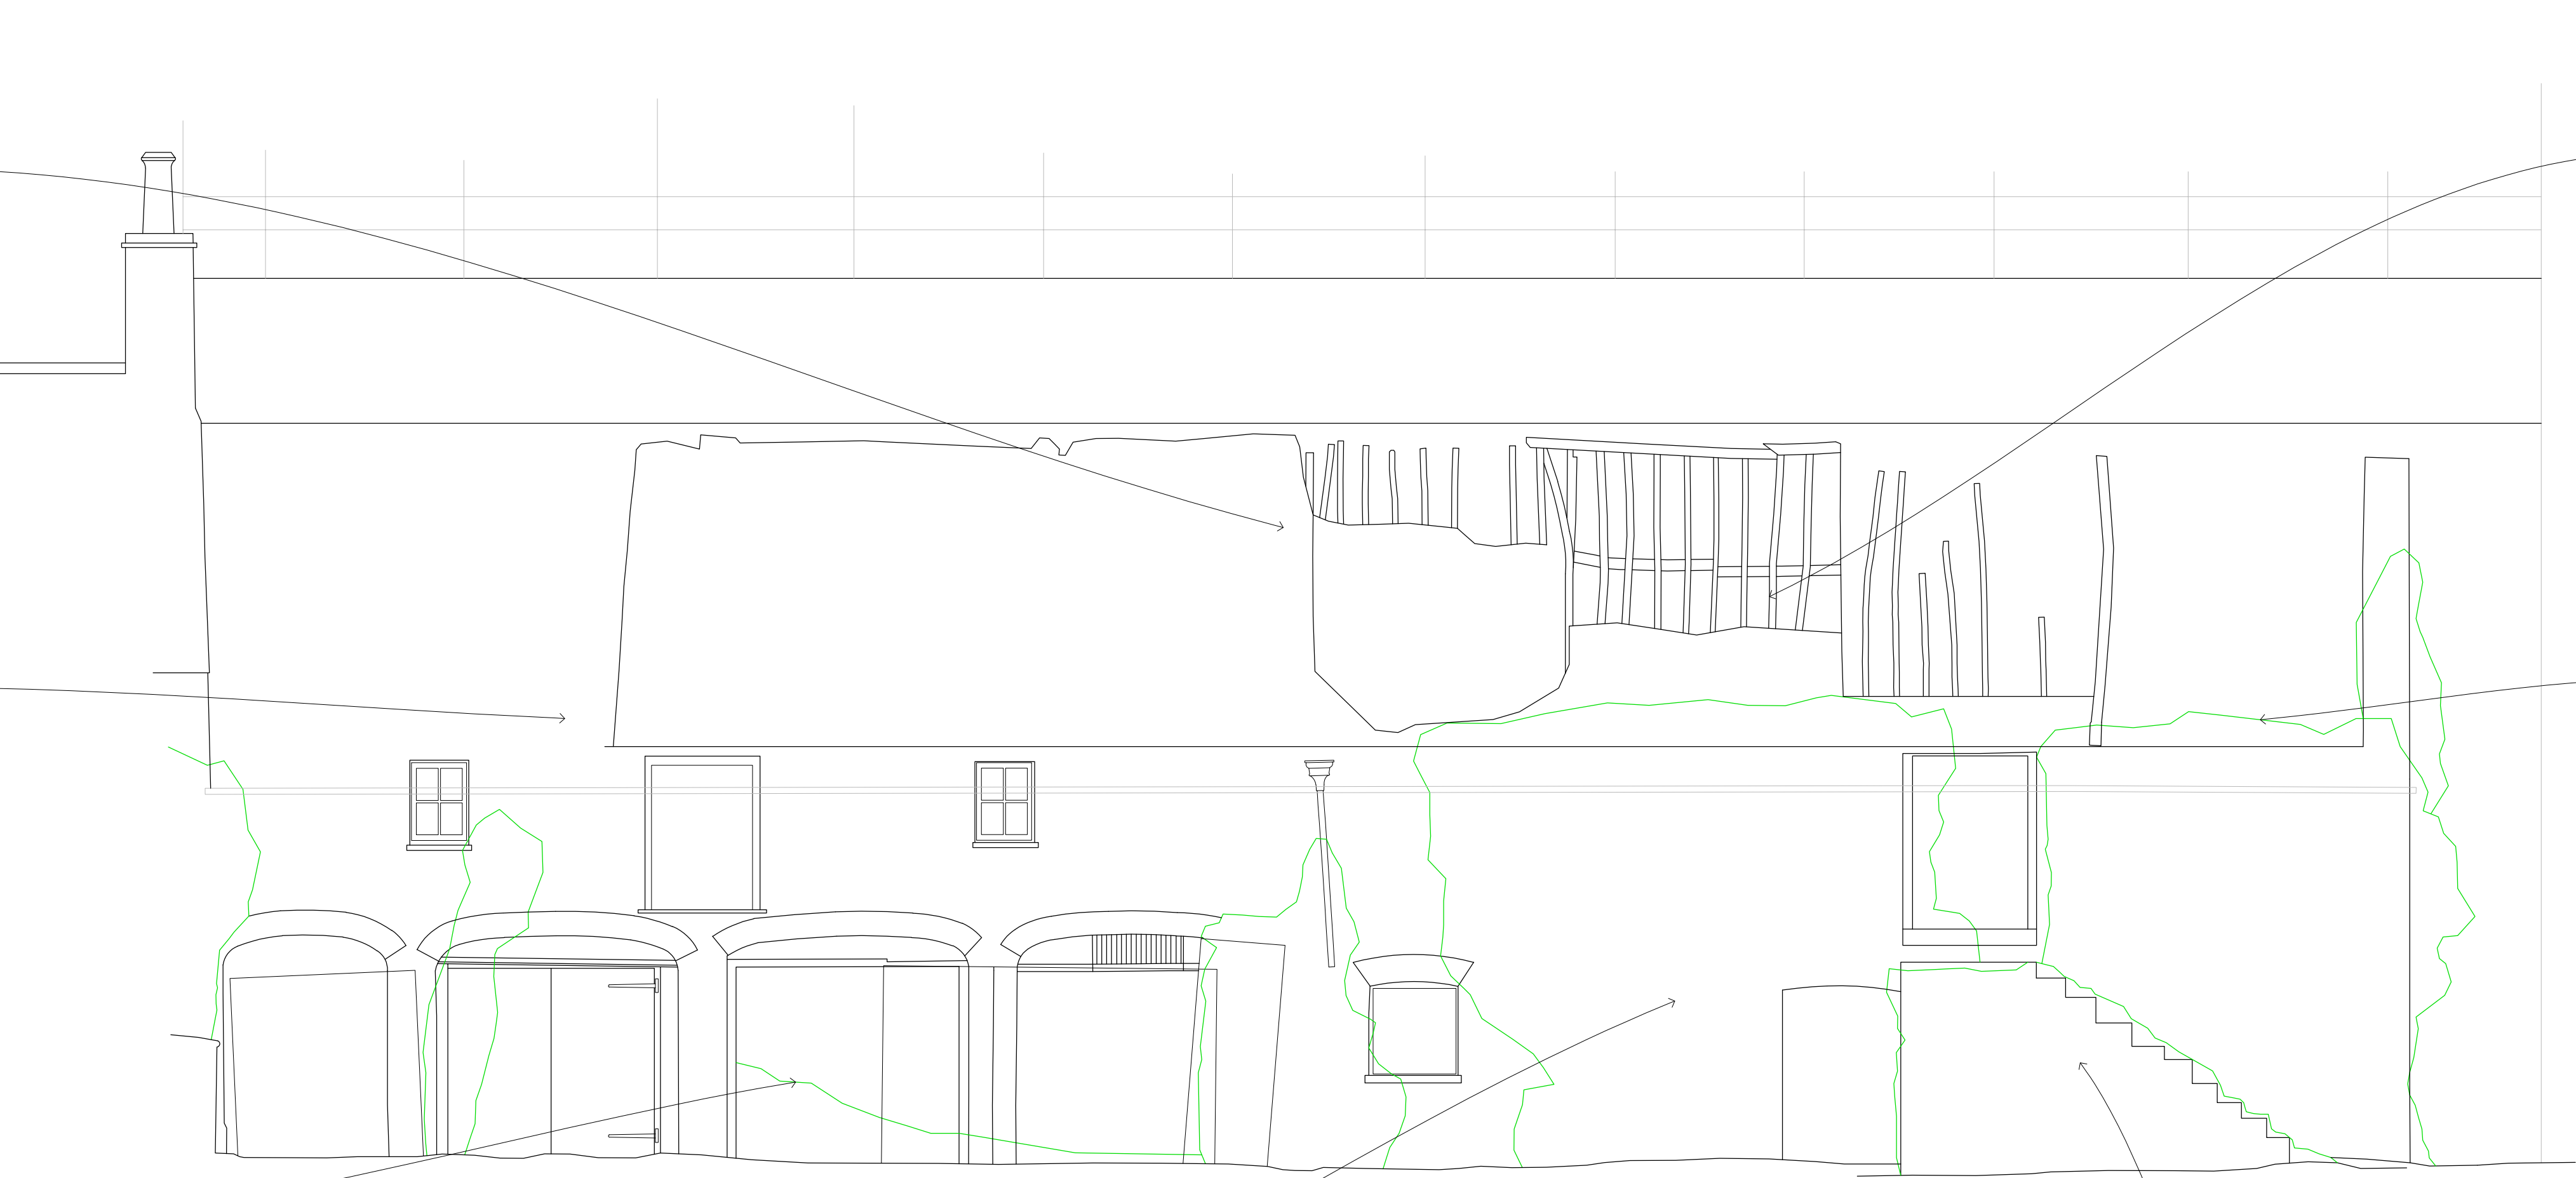

SOUTHEAST ELEVATION
Scale 1:50



Remove all foliage from external brickwork to expose existing stone structure to allow the building to be surveyed by a structural engineer.



Debris within the lean-to building, which appears to be general stored materials.

Structural recommendation to remove debris and any foliage to allow further structural survey of the building to take place.

If any significant pieces of timber and timber paneling and any other historic fabric to be salvaged and stored in safe place.

Any floor and partition structure that is still in original place (and not rotten or damaged) to remain as is.




Debris within the lean-to building, which appears to be general stored materials.


Structural recommendation to remove debris and any foliage to allow further structural survey of the building to take place.

If any significant pieces of timber and timber paneling and any other historic fabric to be salvaged and stored in safe place.

Any floor and partition structure that is still in original place (and not rotten or damaged) to remain as is.

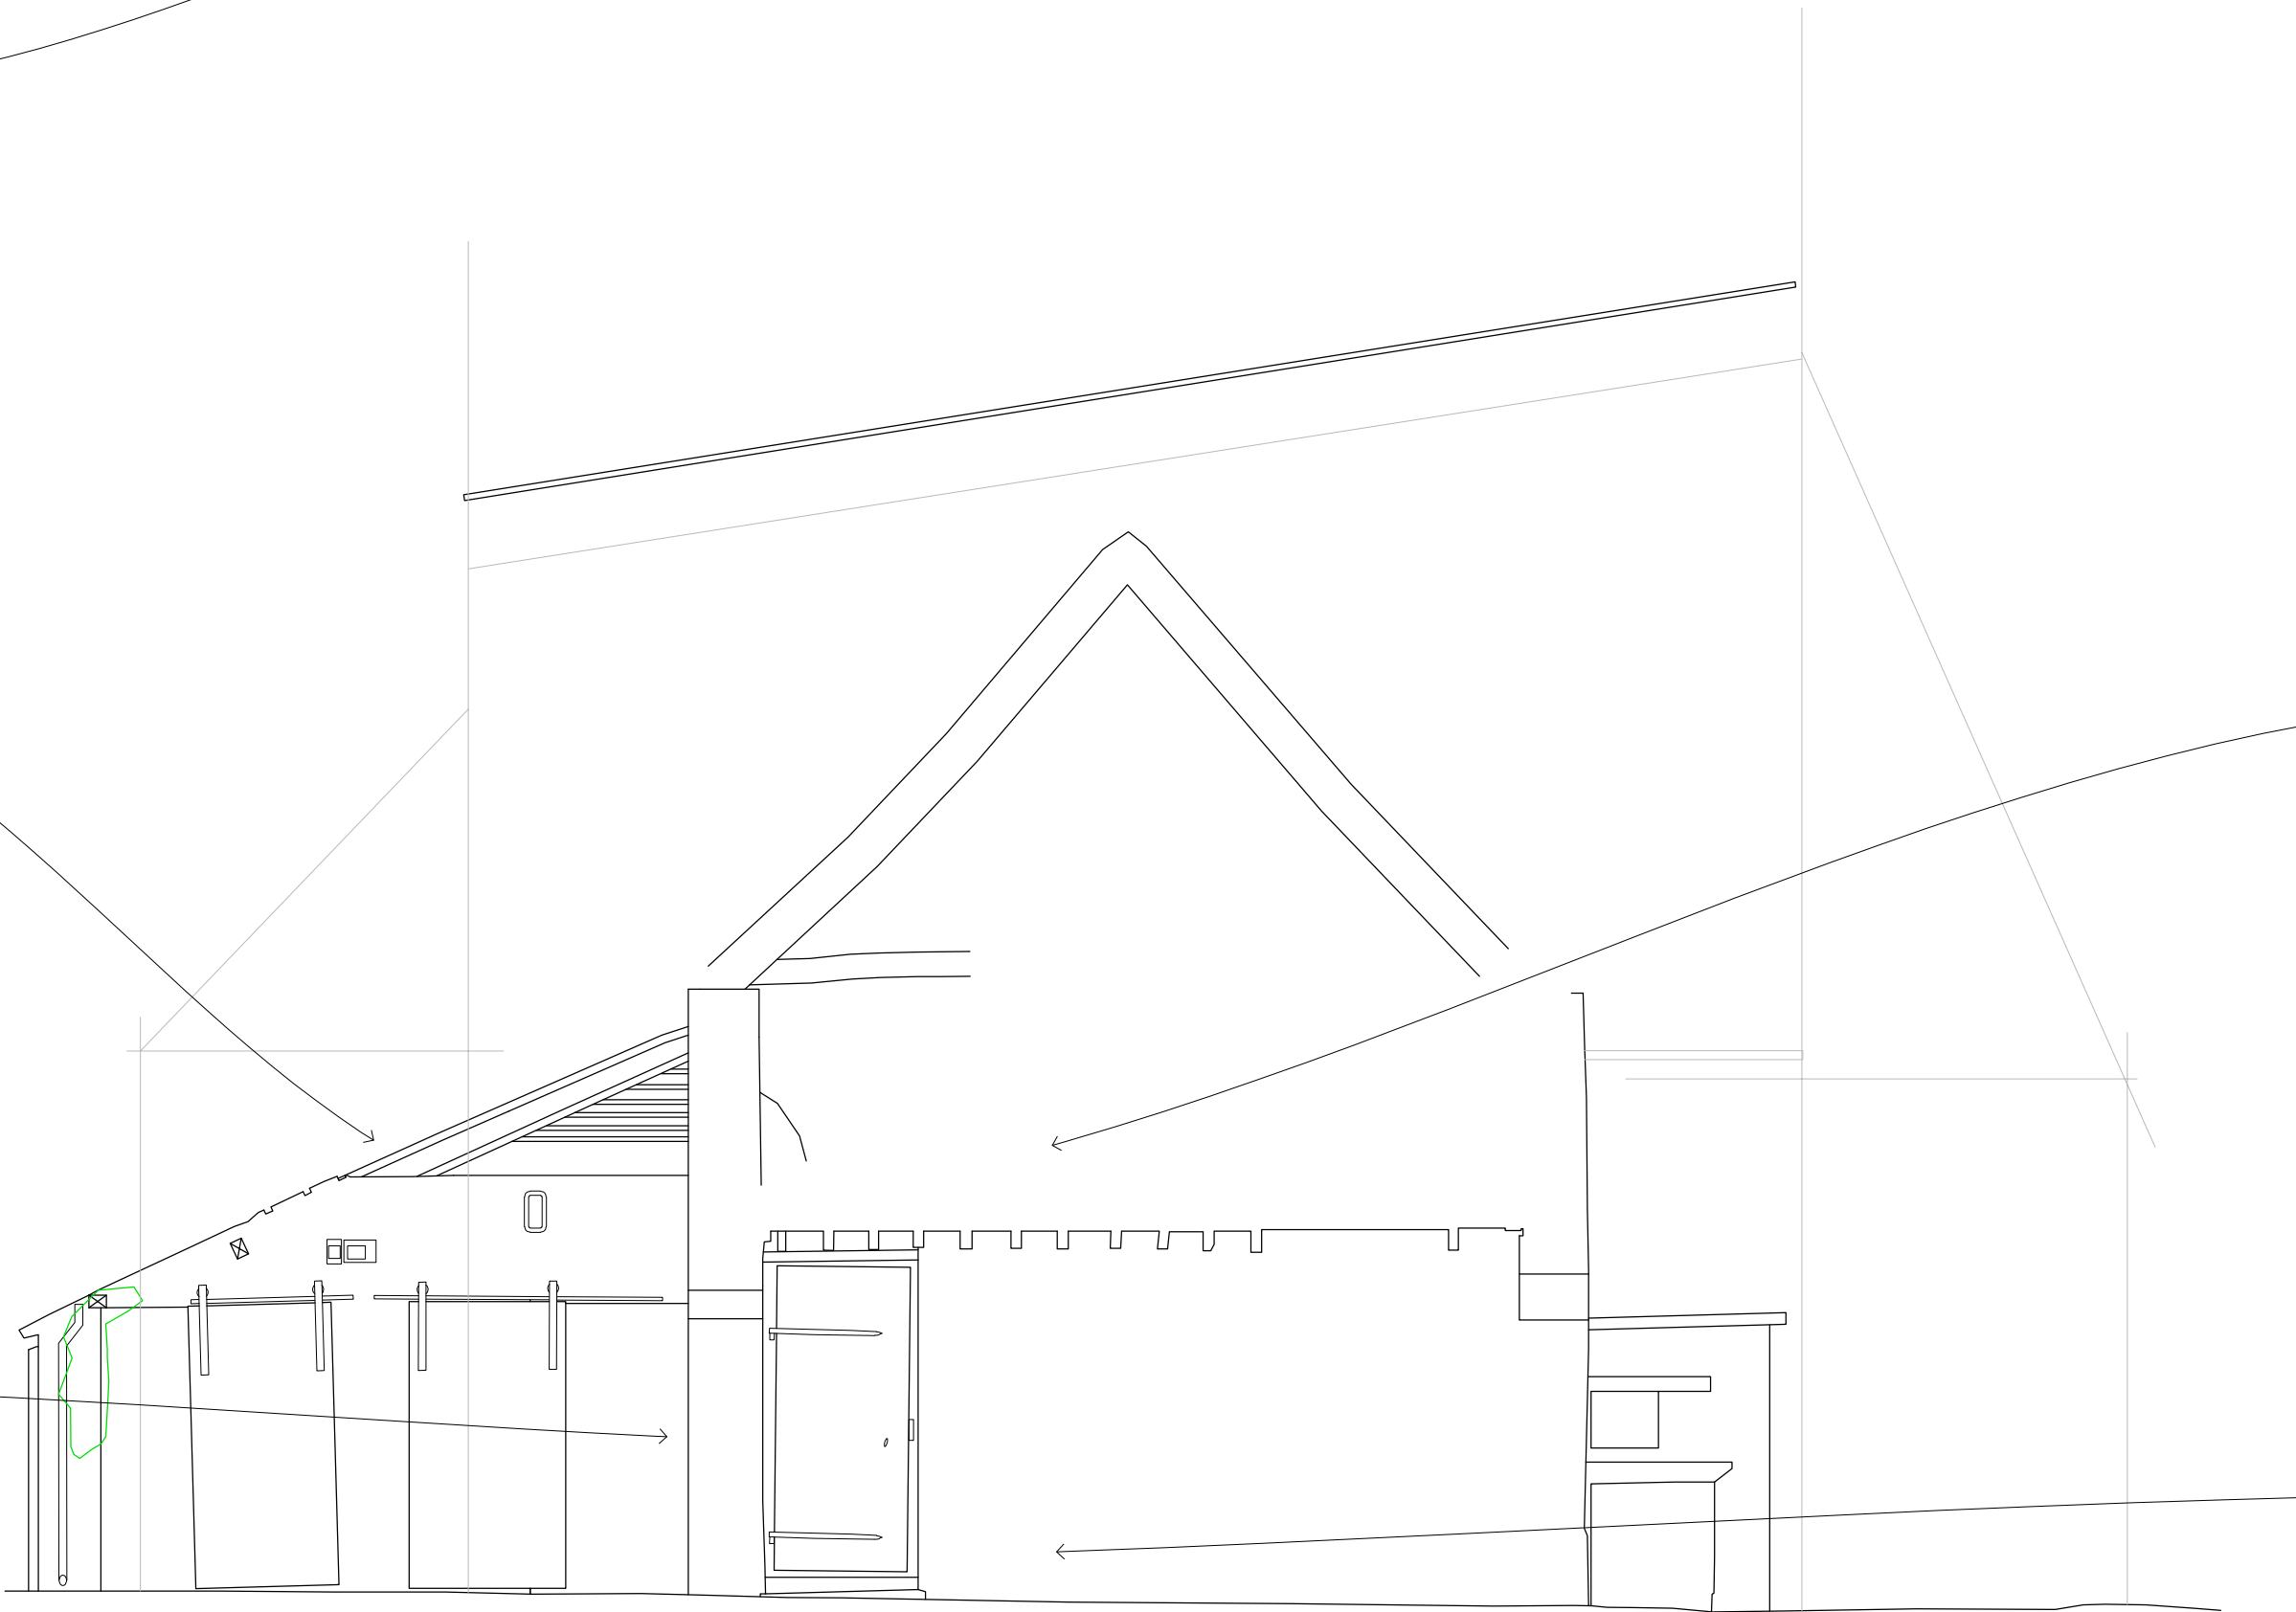

SOUTHWEST ELEVATION
Scale 1:50



Section of existing roof with roof timbers and rafters in place.

Structural recommendation to remove loose stone slates and foliage from stonework and timbers in preparation for full structure review of building.

Any loose timbers are to also be removed, with significant pieces to be stored in safe place.

Stone slates to be removed carefully and salvaged for reuse later on. Stone slates are to be store on site in a location to be agreed.



Significant amount of debris within the building, which appears to be roof structure material that has fallen in on the first floor that has further collapsed onto the ground floor. The build up of debris that is leaning on the external walls are starting to push the walls out.

Structural recommendation to remove debris and any foliage to reduce the load impact on the existing external walls. Further structural survey of the building to then take place.

All existing broken timbers to be removed, along with stone slates and other debris. Stone slates, significant pieces of timber and timber paneling to be salvaged and stored in safe place.



Remove all foliage from external stonework to expose existing structure to allow the building to be surveyed by a structural engineer.



Debris within the building above passageway.

Structural recommendation to remove debris and foliage to reduce the load impact on the existing external walls. Further structural survey of the building to then take place.

All existing broken timbers and general debris to be removed. Significant pieces of timber and timber paneling to be salvaged and stored in safe place.



General view of passageway under listed building


revisions	initial	date
-----------	---------	------

Contractors, Sub Contractors and Suppliers are to check all relevant dimensions and levels of site and buildings before commencing any shop drawings or building work.

This drawing is copyright and may not be reproduced in any part of form without the written consent of Fowler Architecture and Planning

project
WESTFIELD FARM
Latton, Wiltshire GL7 5QQ

drawing	Existing Elevations	scale	1:50 @A1	drawn by	-	date	March 26
drawing no	251017-102					rev	-

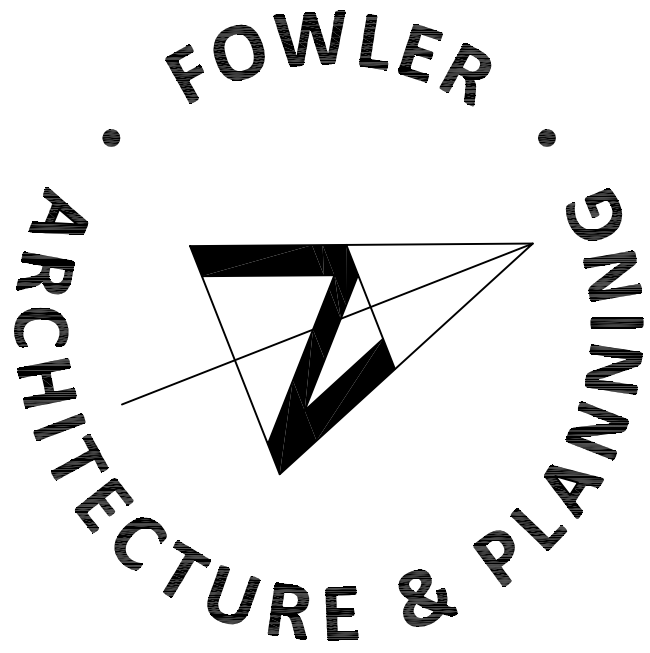

39 High Street
Pewsey
Wiltshire
SN9 5AF
tel (01672) 569444
fax (01672) 569488
enquiries@faap.co.uk