

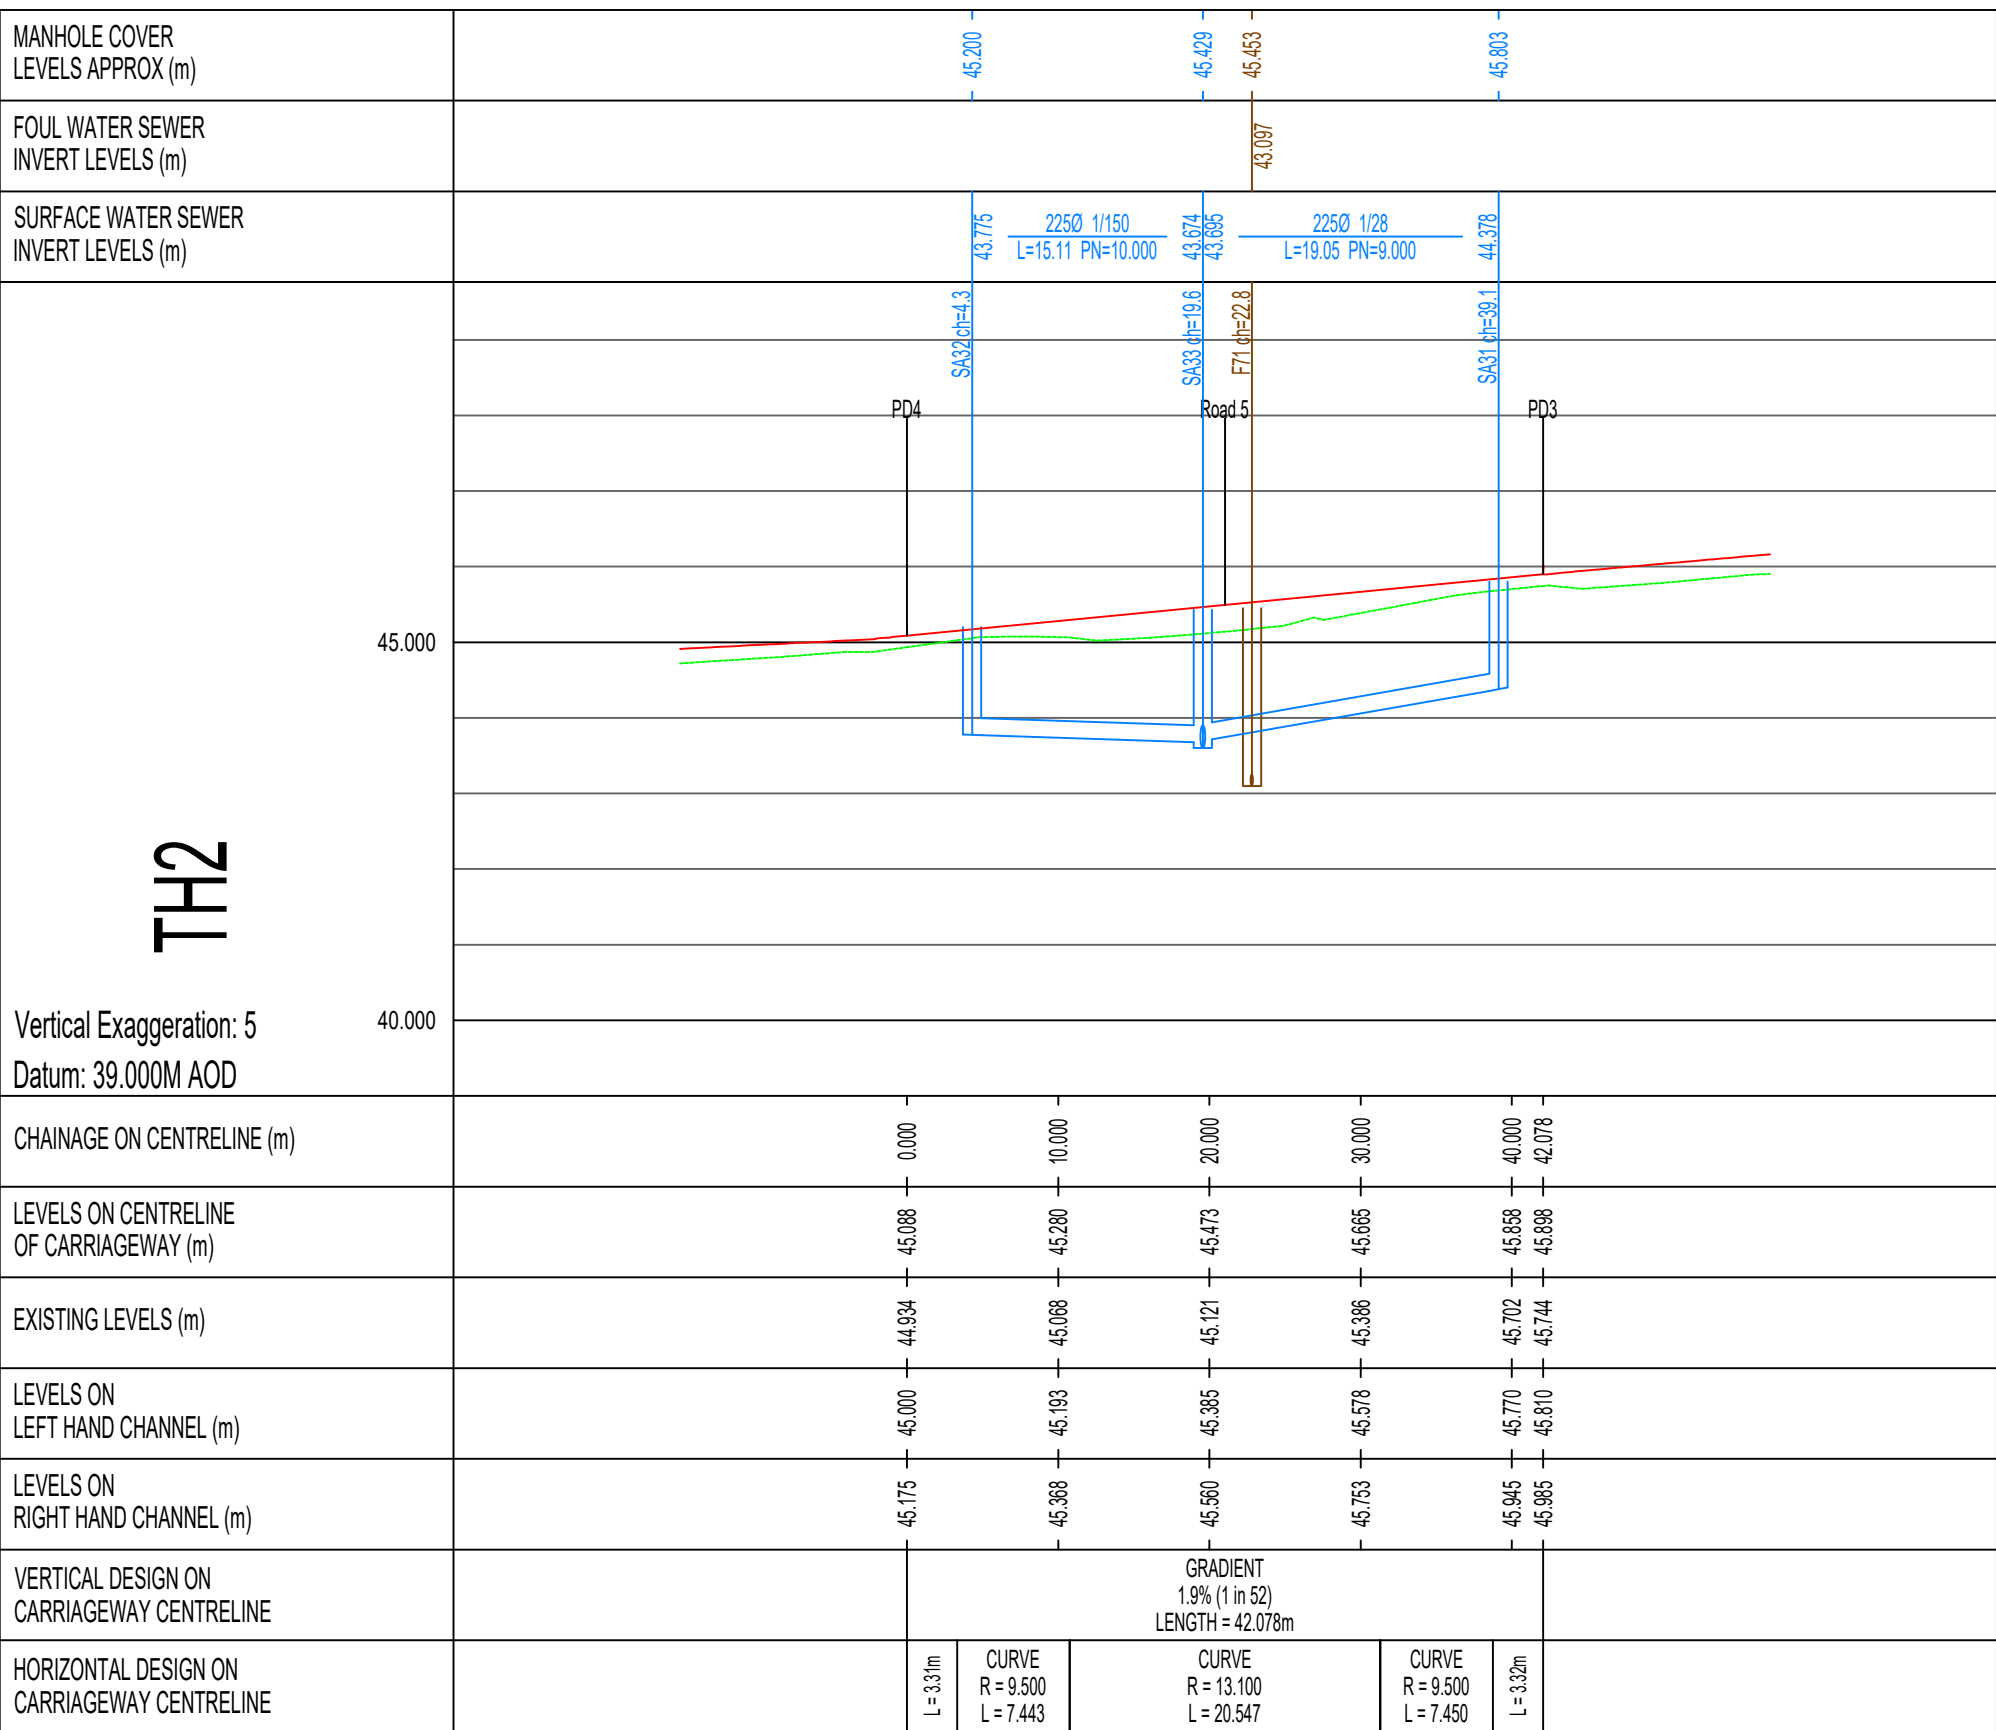
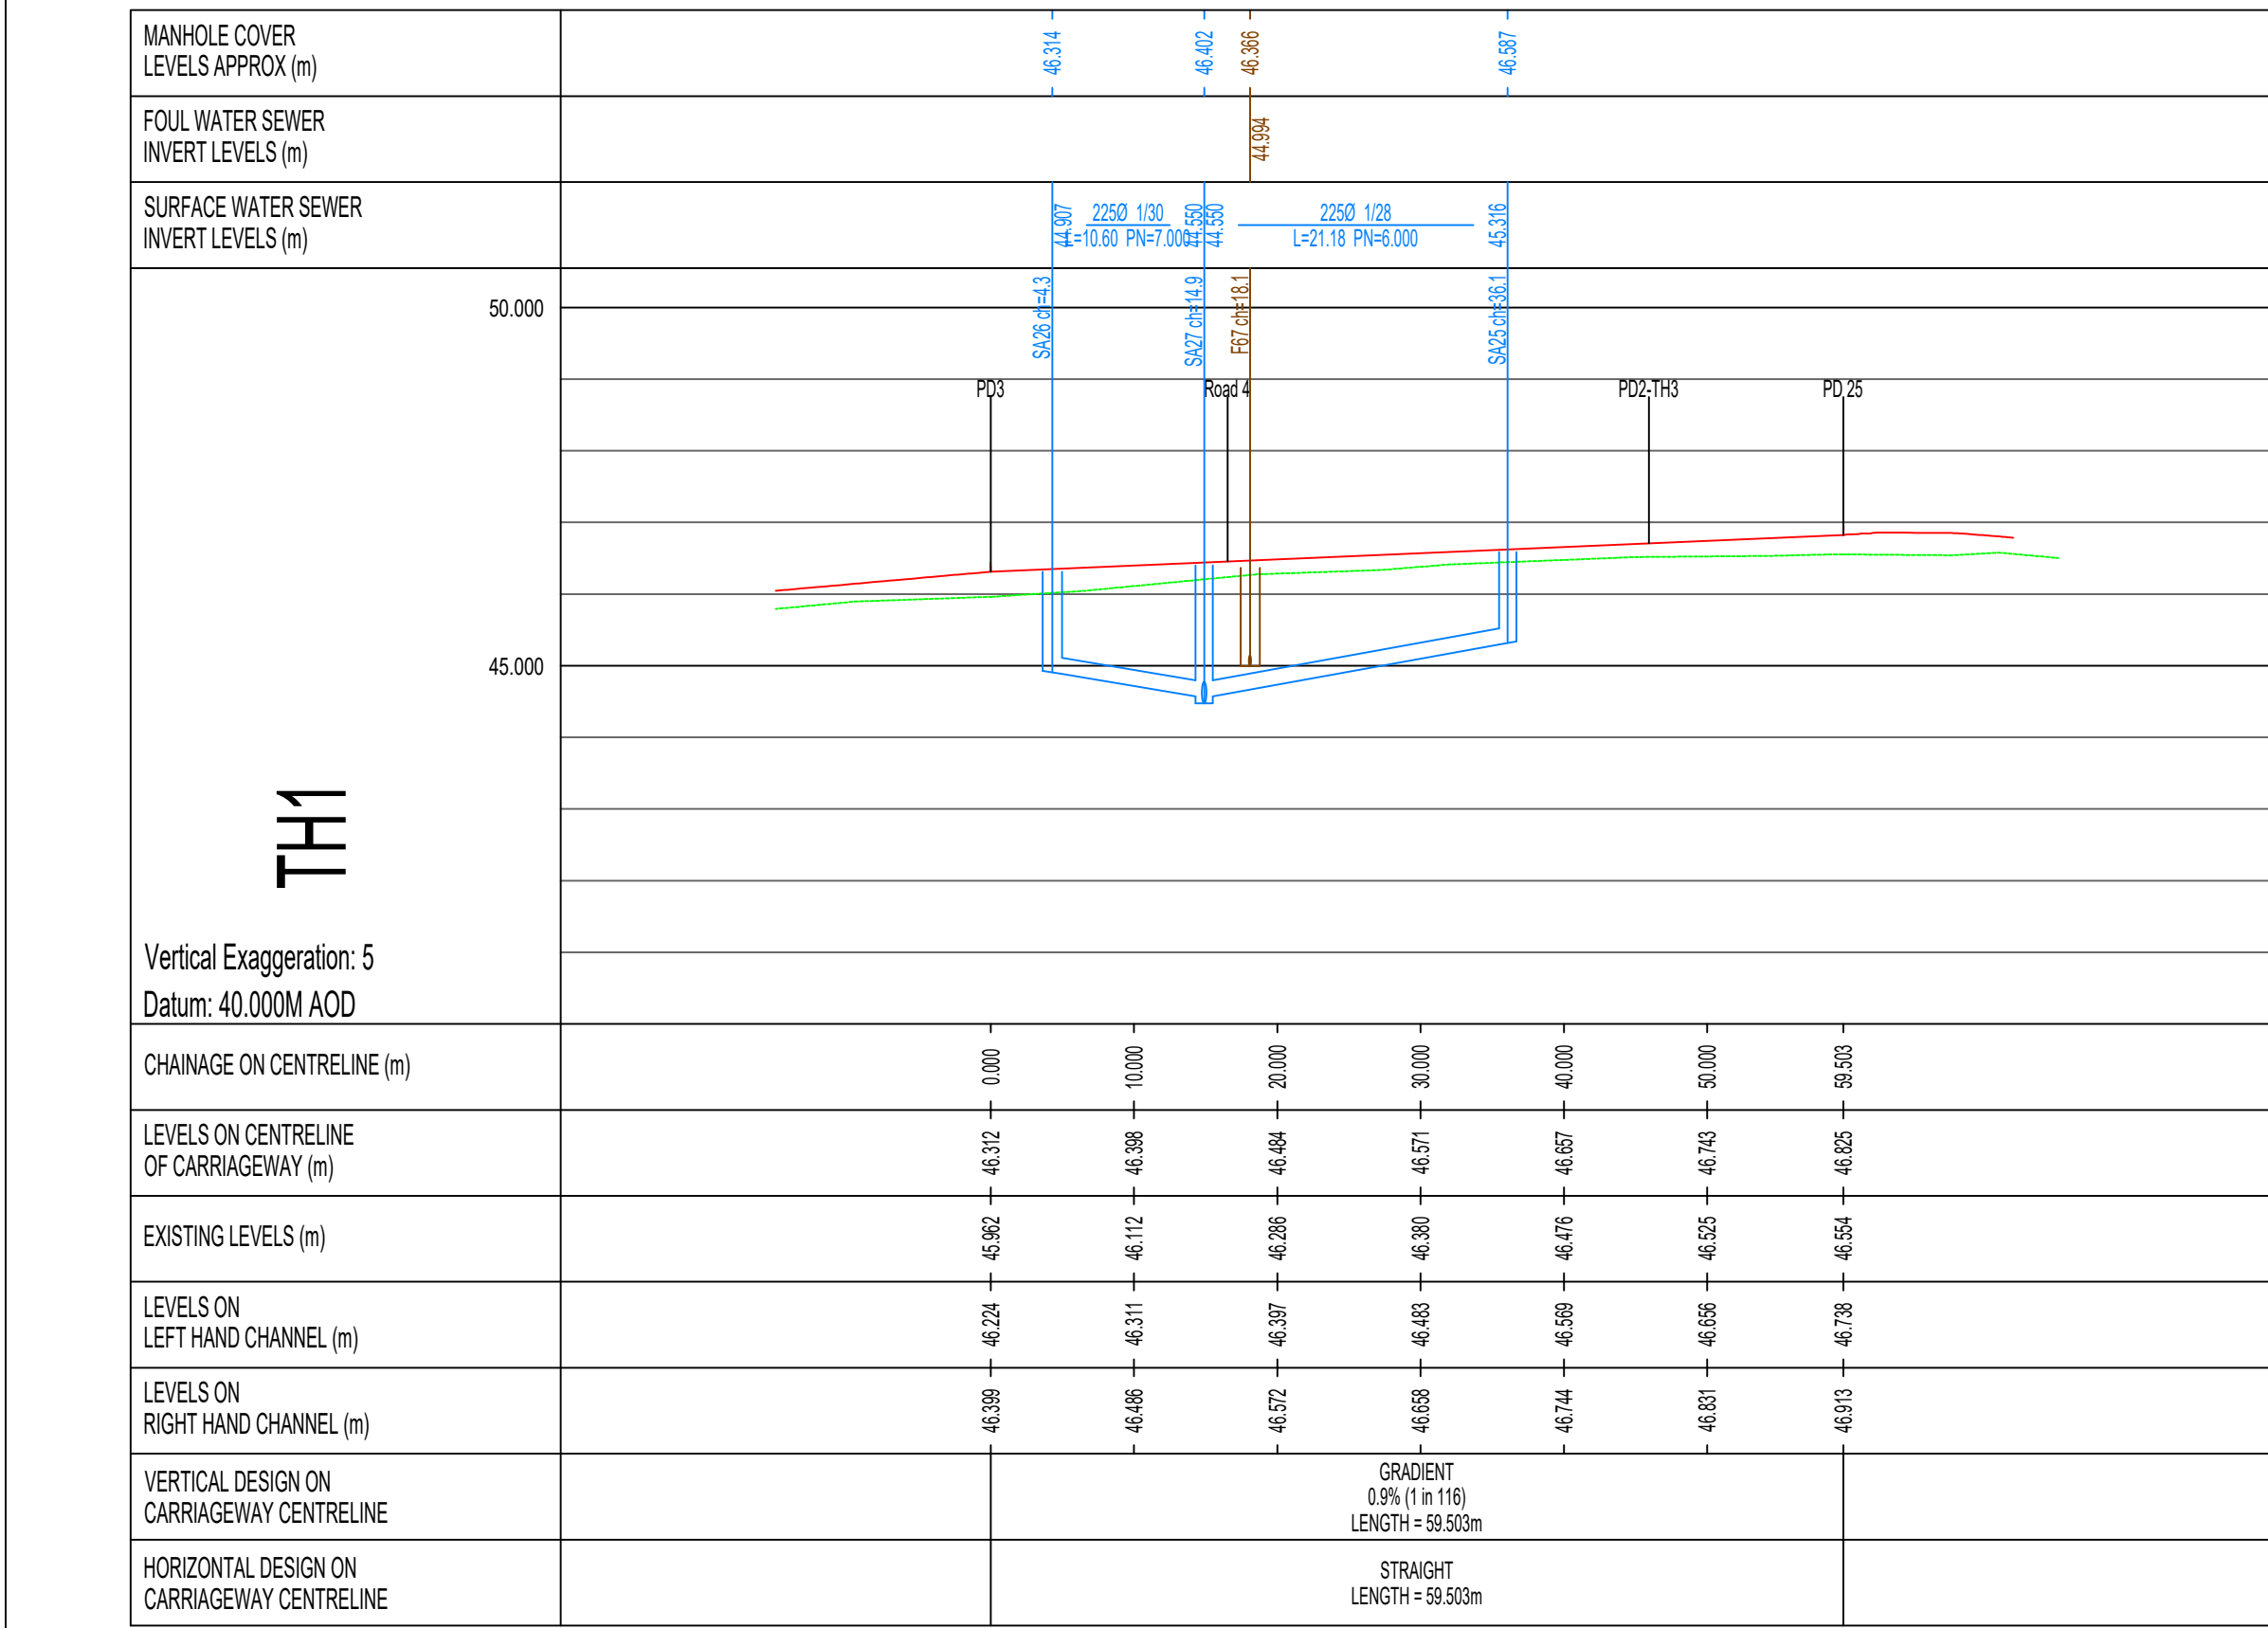
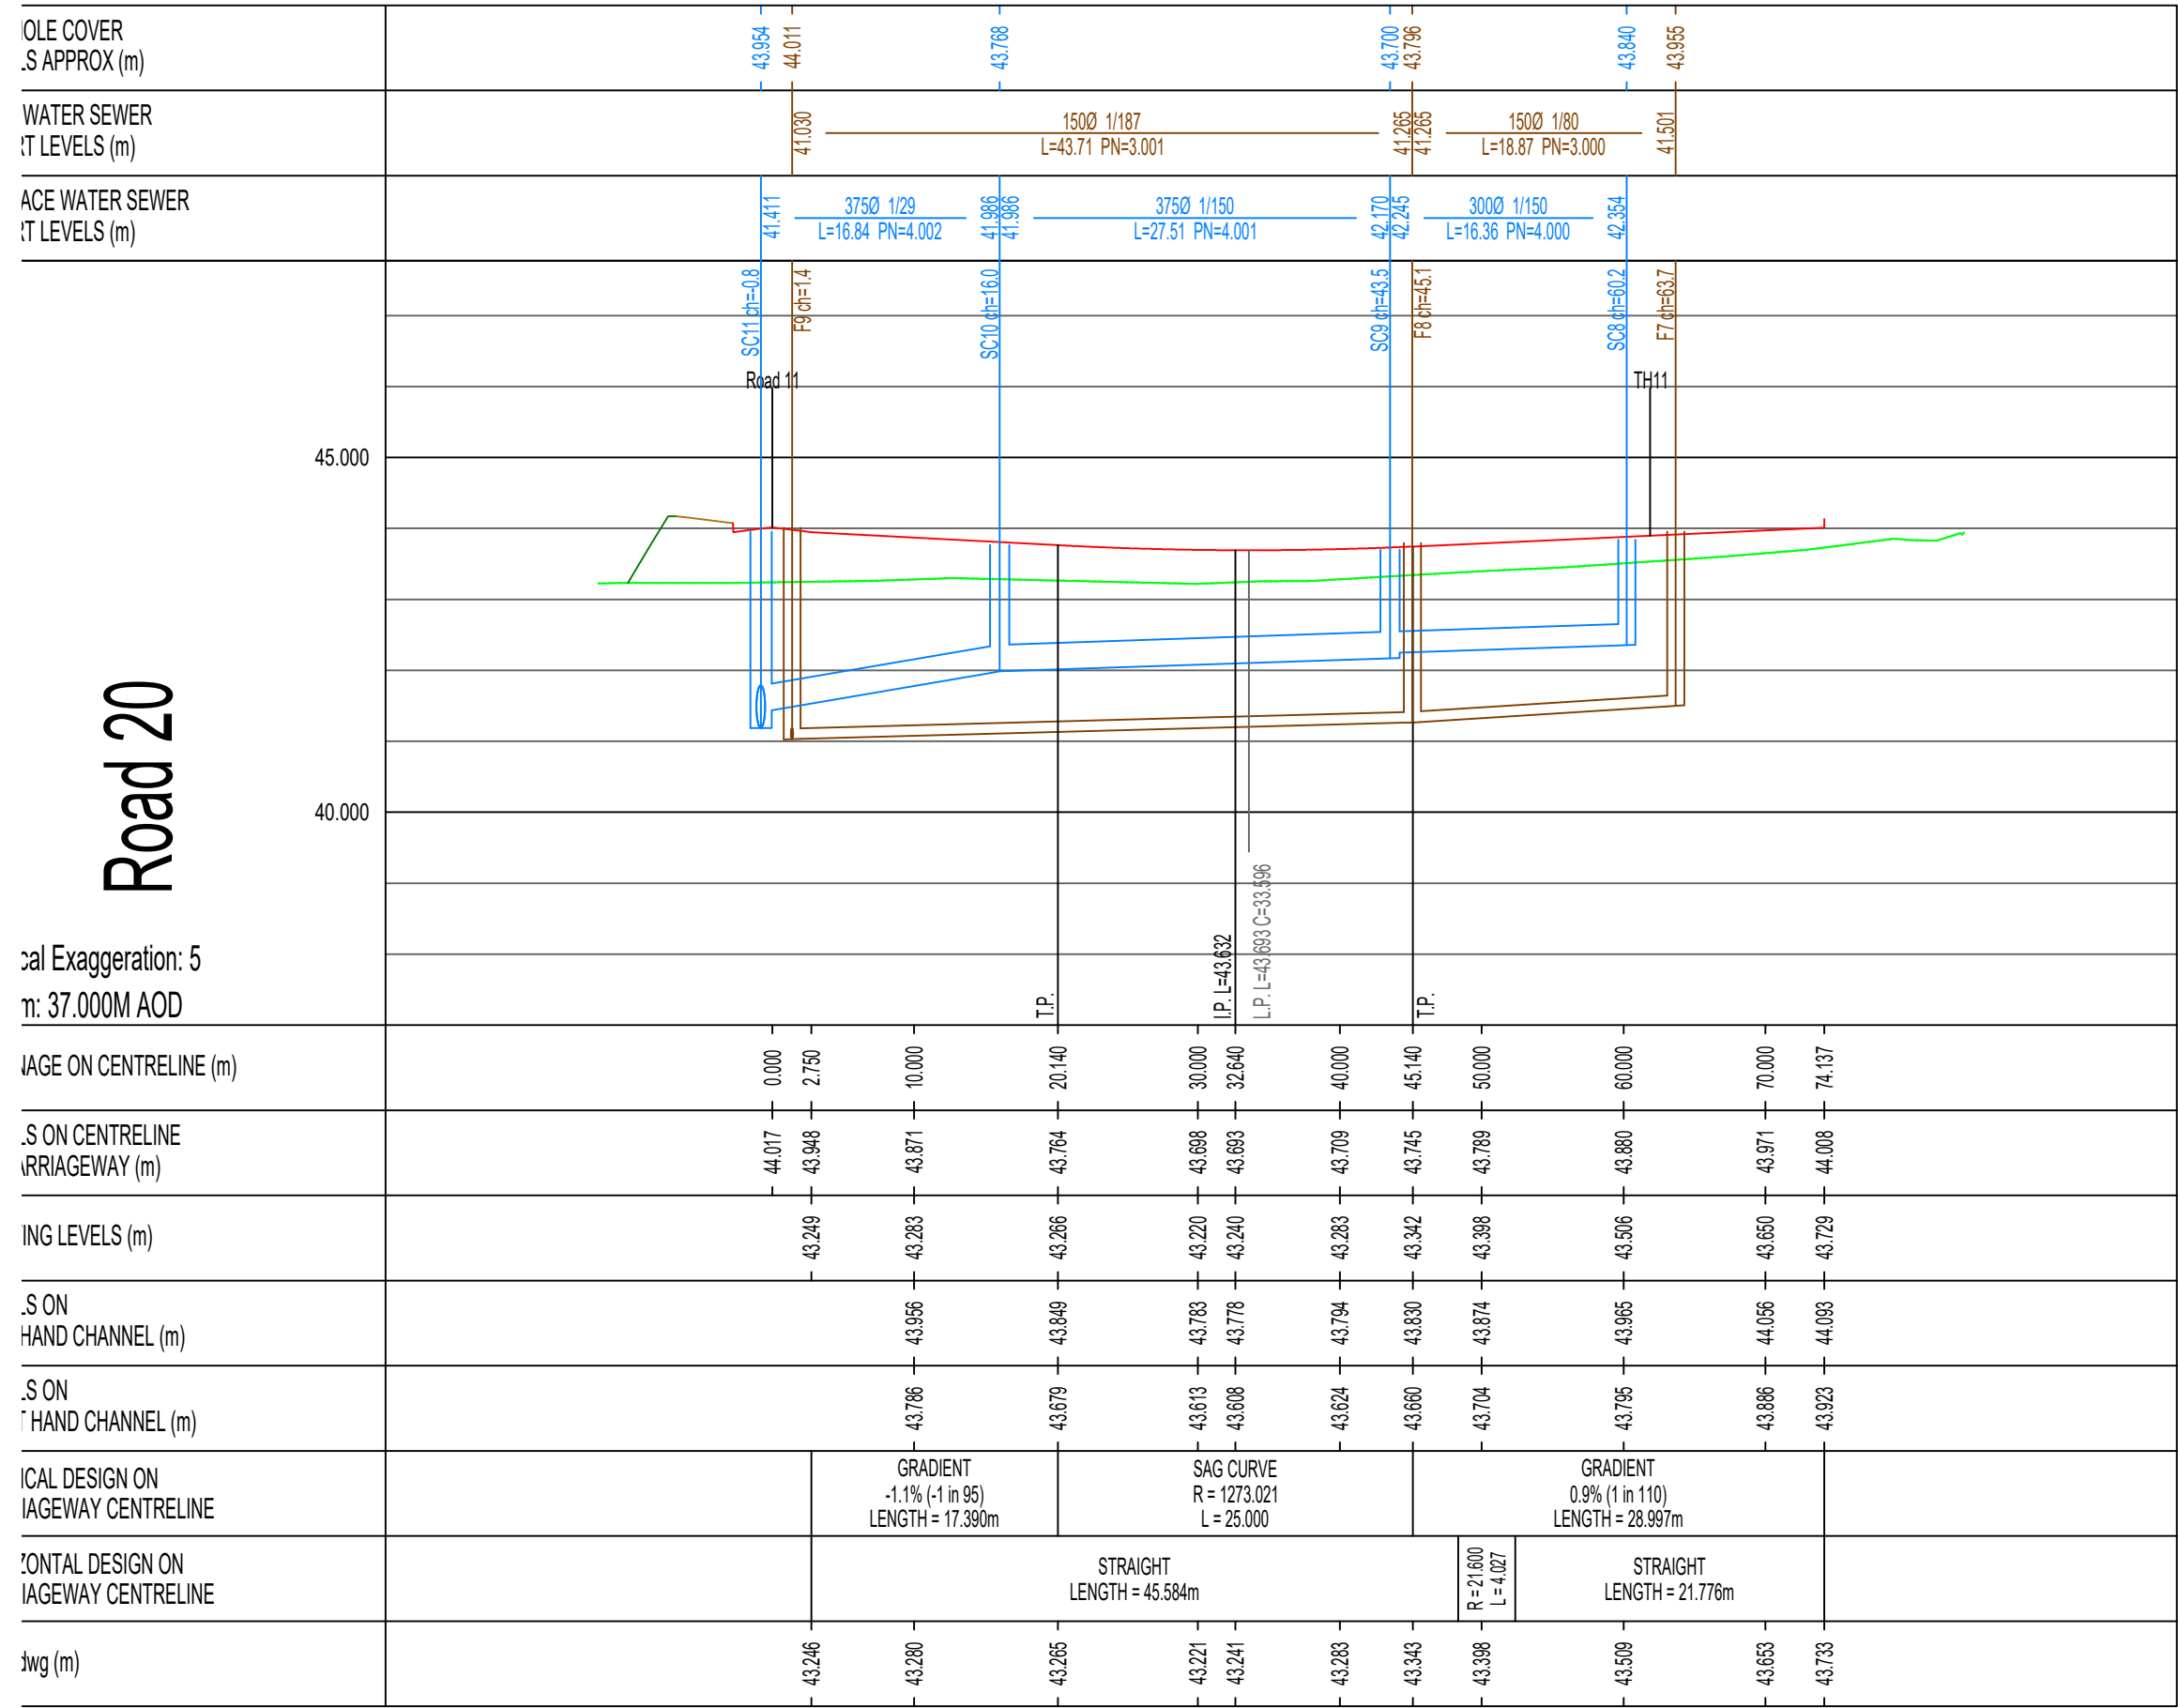
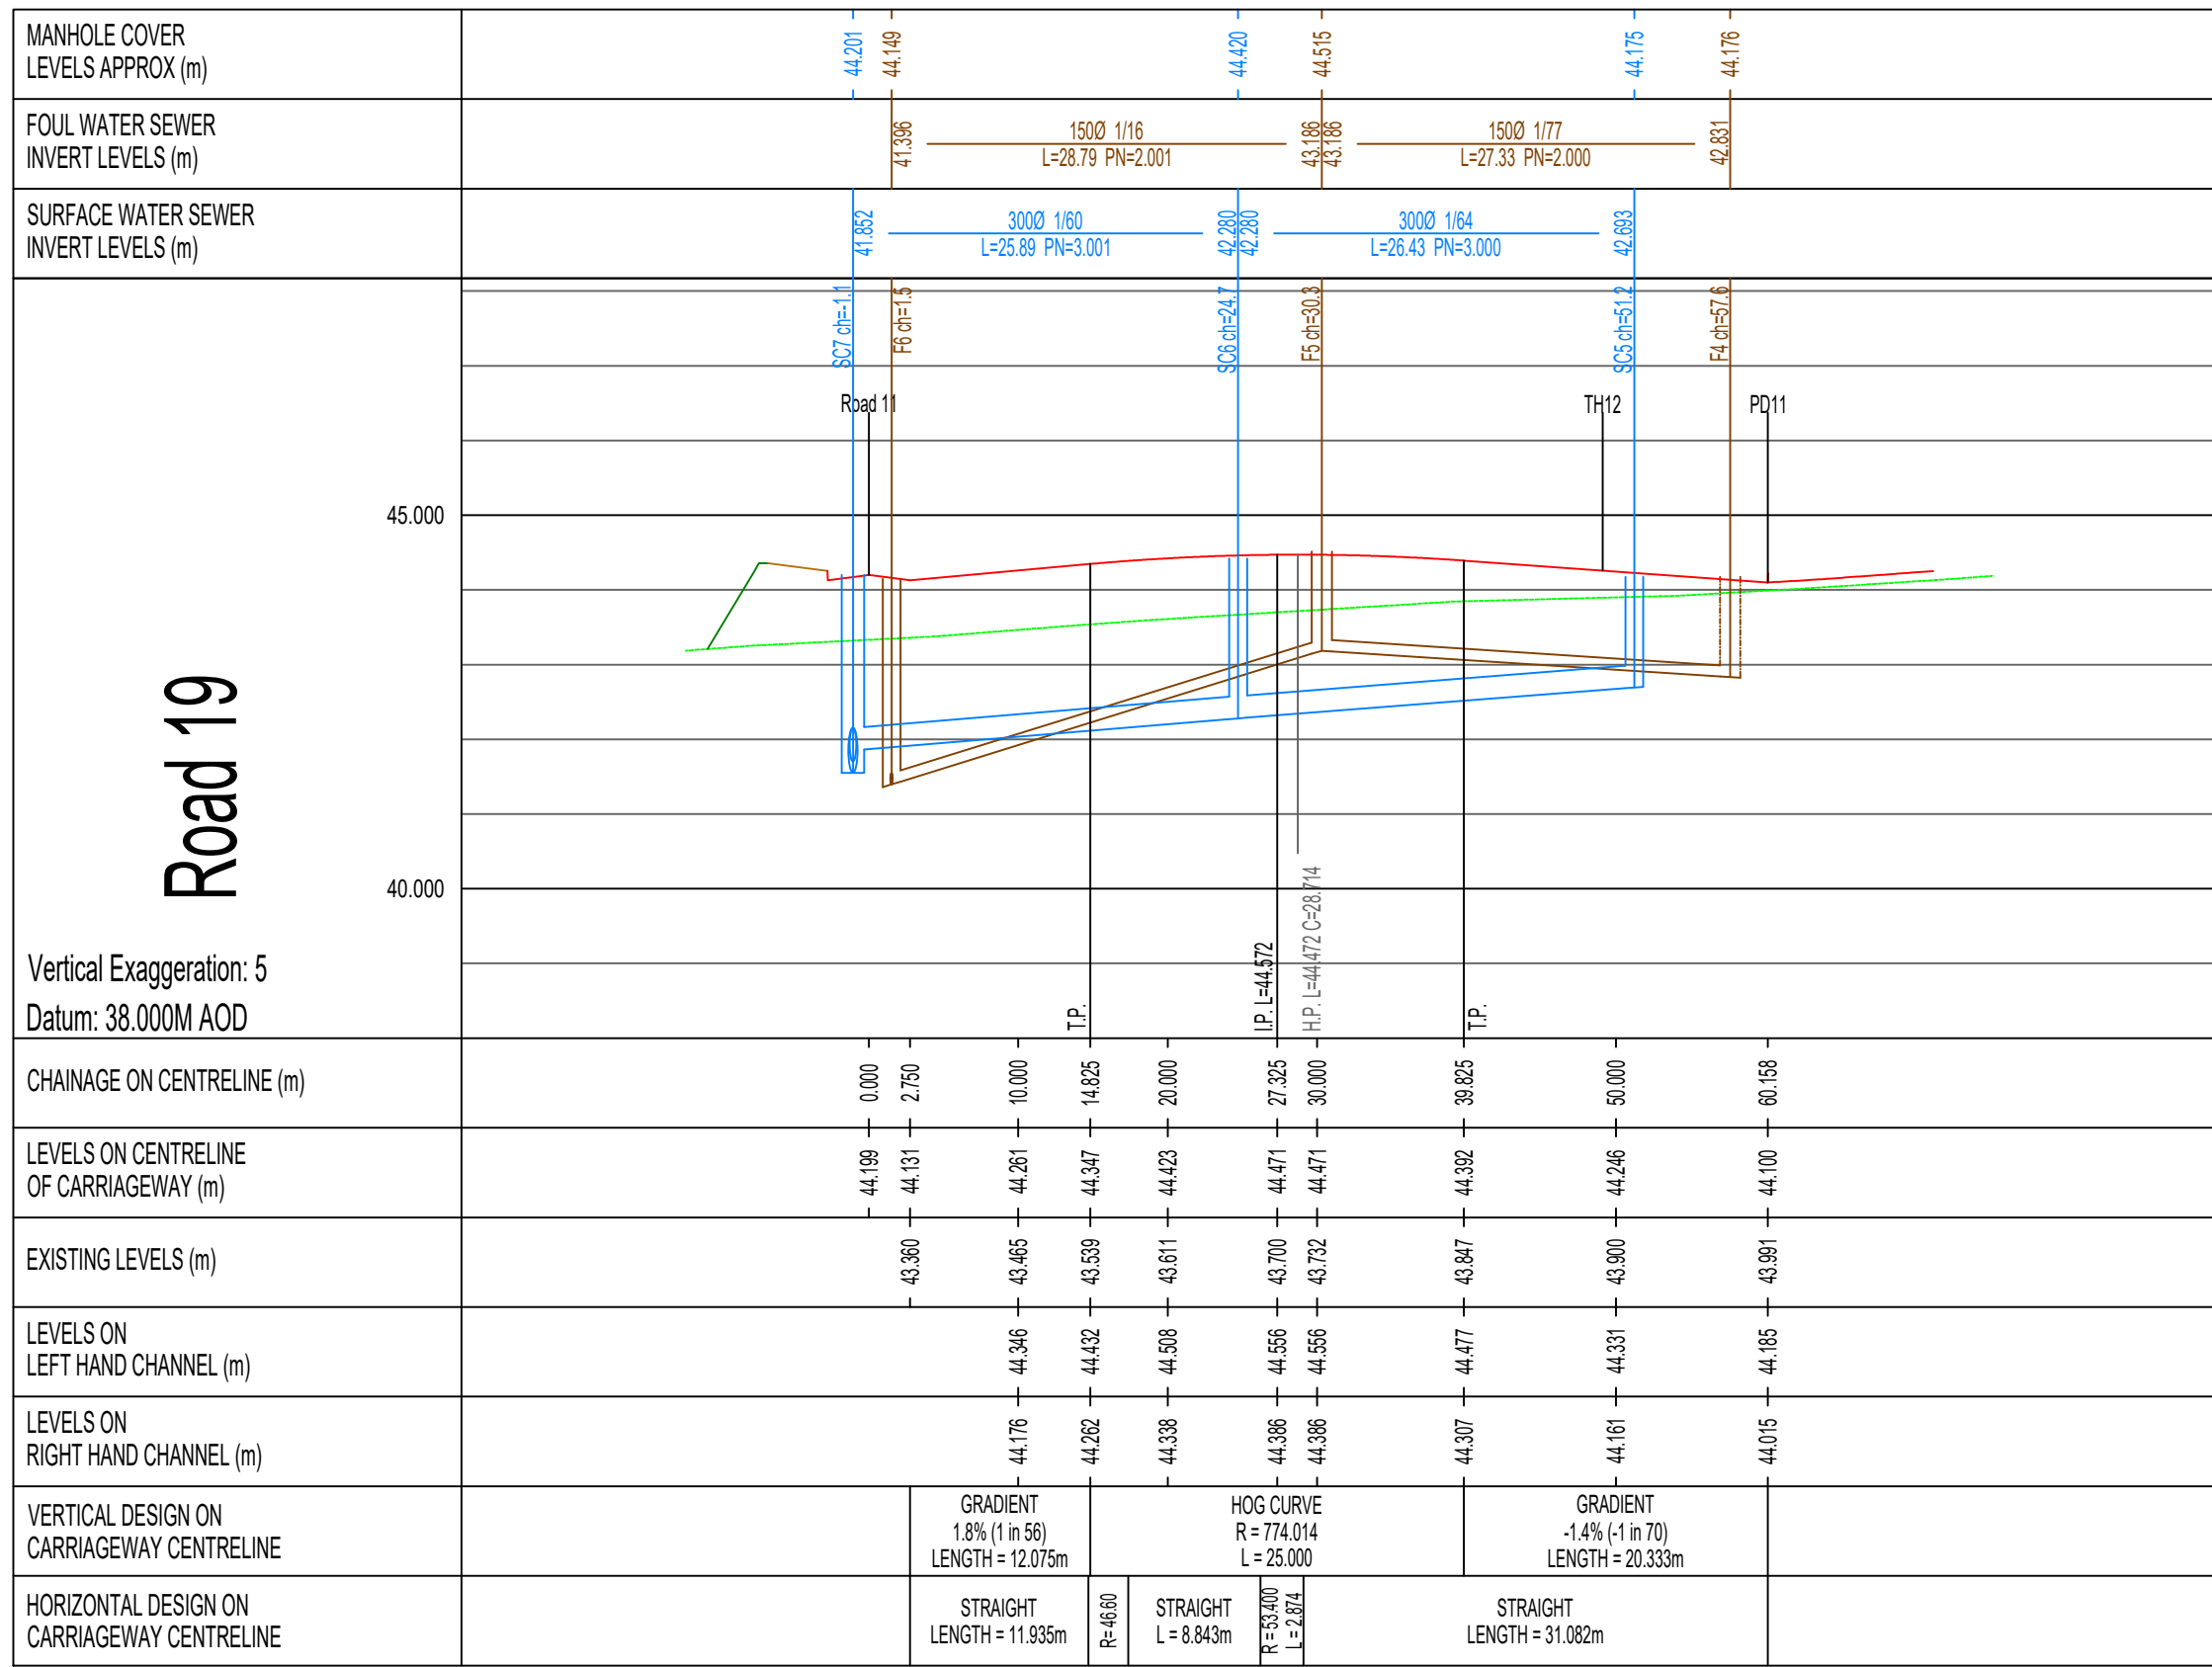


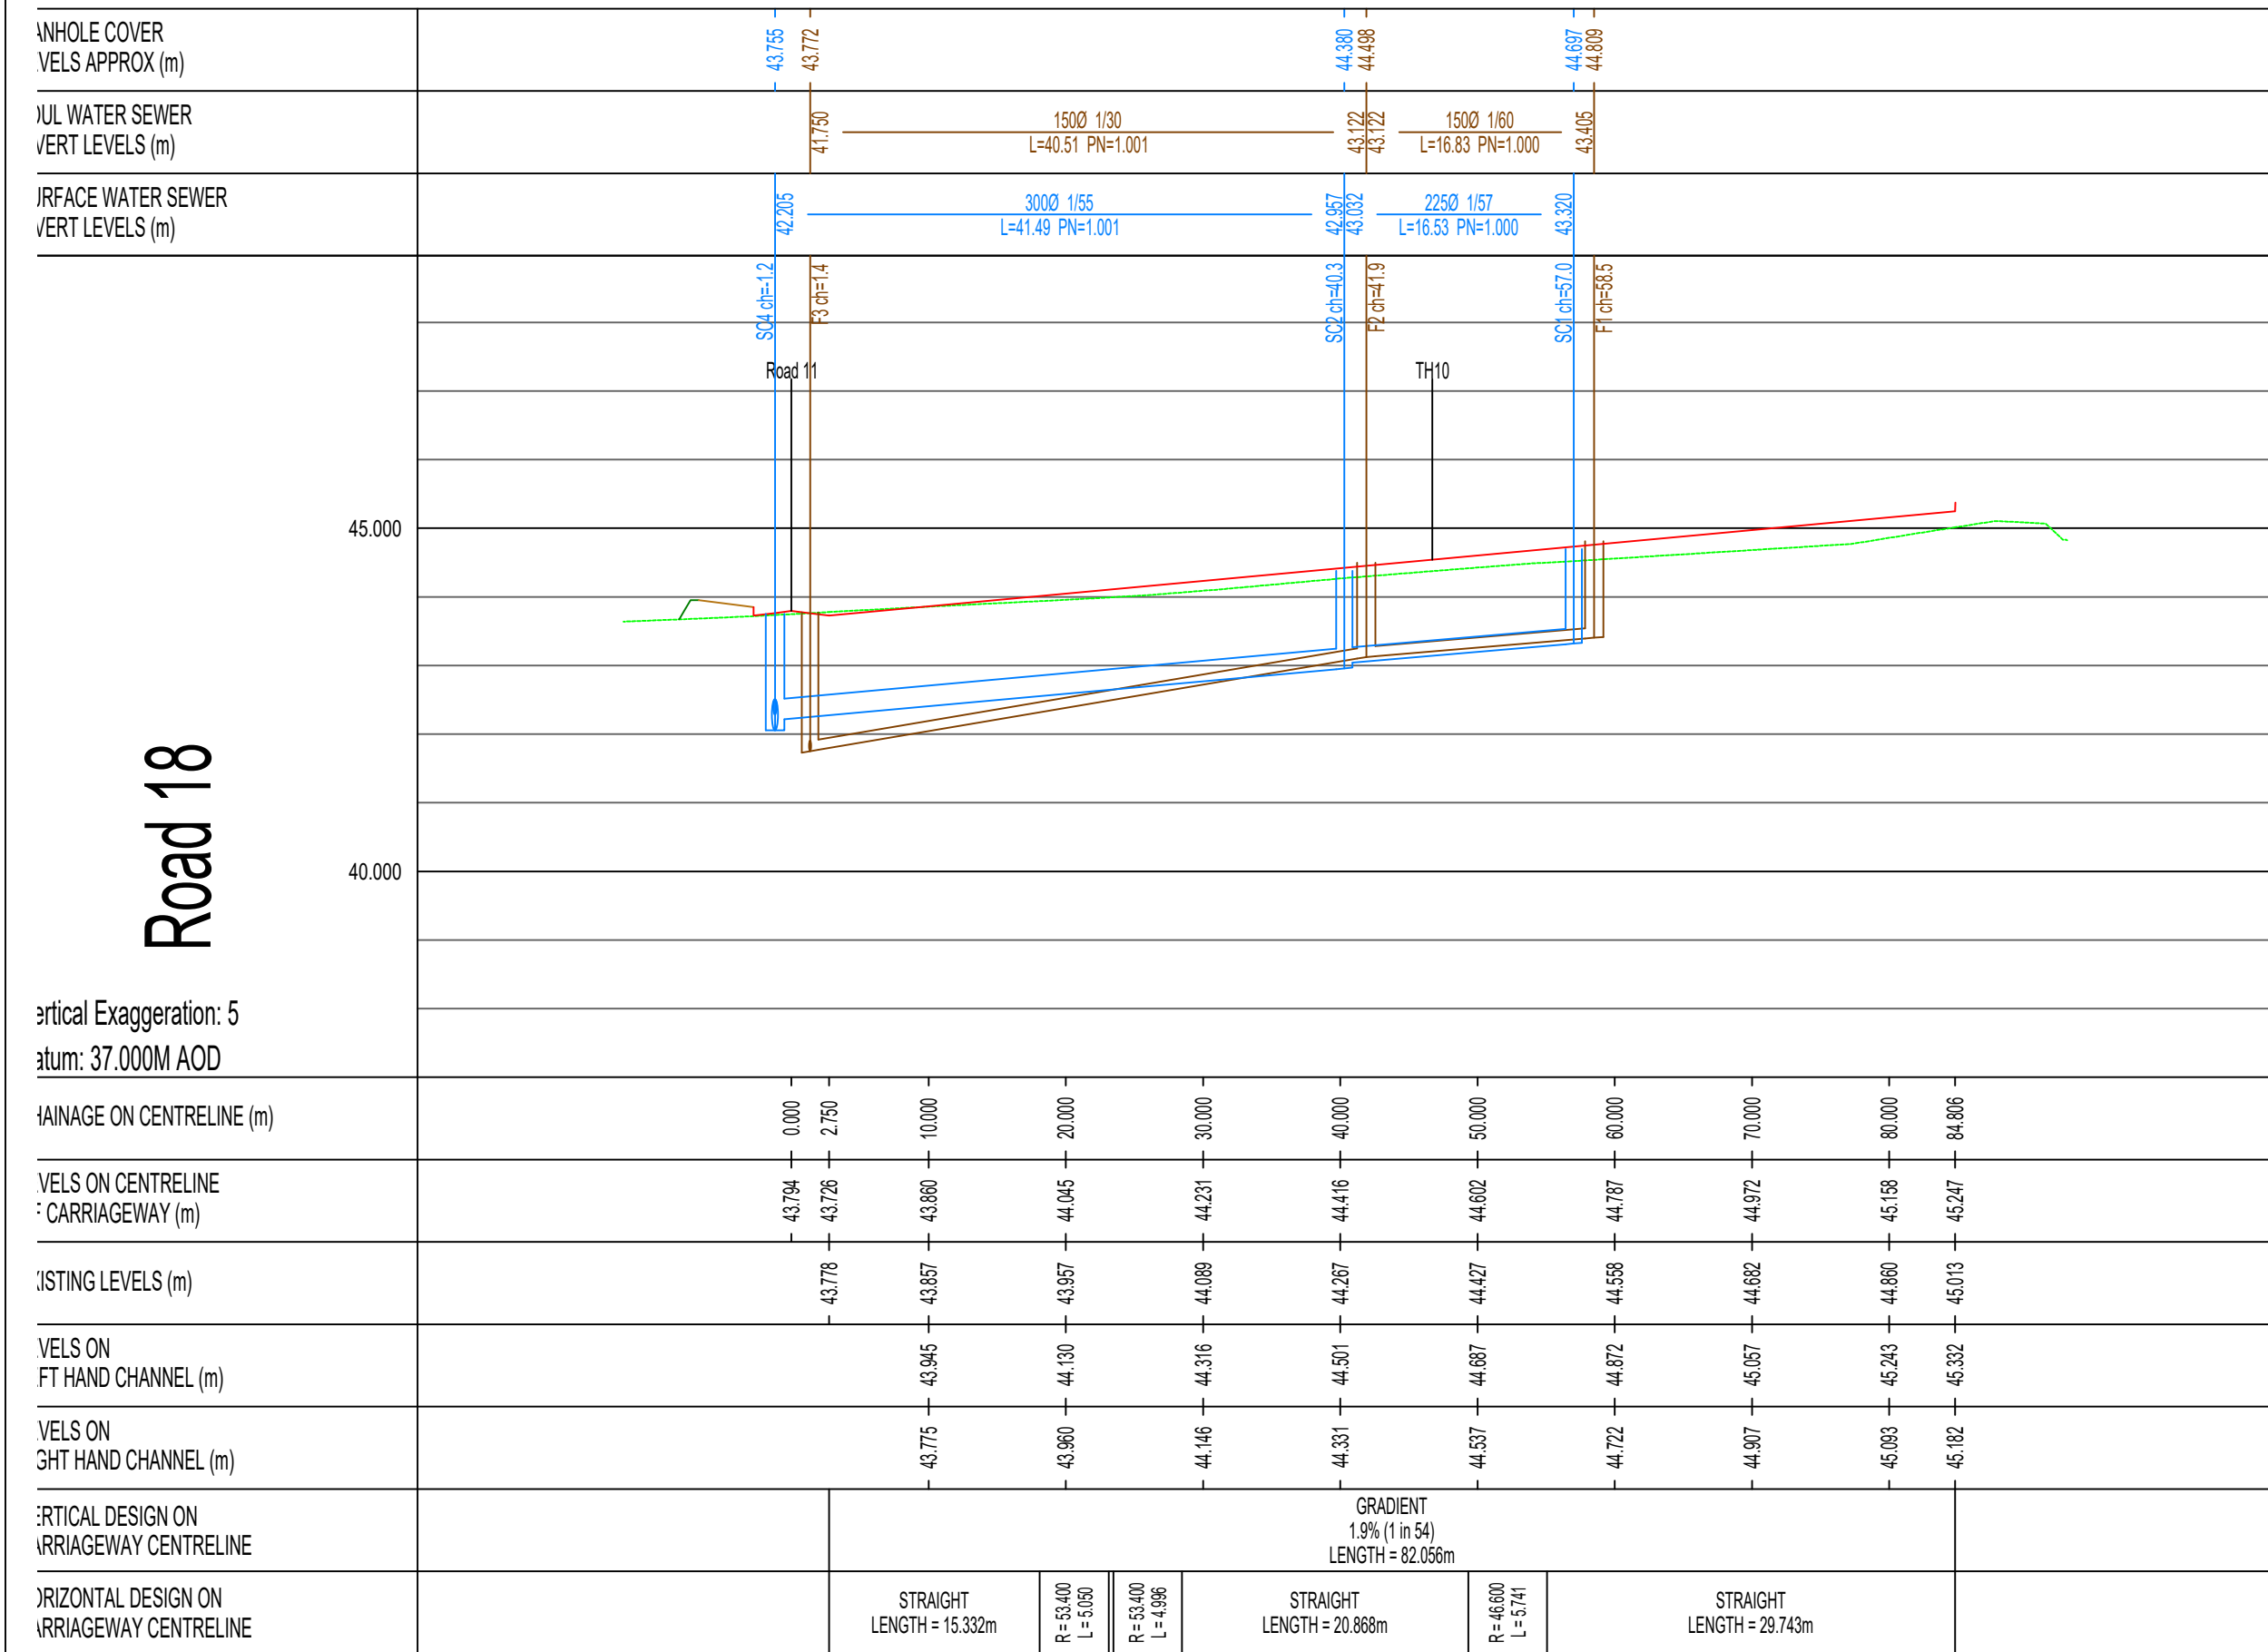

- NOTES
- All works to be adopted under a Section 154 Agreement shall be carried out in accordance with 'Sewers for Adoption' (19th Edition) & Water Meter's requirements.
 - All works to be adopted under a Section 154 Agreement shall be carried out in accordance with the Water Supply (Waterworks) Regulations 1989.
 - Do Not Scale
 - This drawing is to be used in conjunction with and checked against all other drawings. Engineering details, specification and any relevant, published or other specific document provided.
 - A 400 piped segment is to be 1m in 100m.
 - Left and right hand channels are on the left and right side respectively, when standing at Change Level and looking along the road.
 - Pipe runs are shown in red and blue lines in red and blue.
 - All pipes to have flexible joints with granular bed and surround (Class 5 having a min of 150mm granular bed and 150mm min above pipe) unless otherwise stated. Where cover under road or vehicle access areas is less than 1200mm a concrete surround should be used in accordance with Water Meter details.
 - All pipe runs connecting to existing sewers are to be 150mm to 200mm unless otherwise stated.
 - All pipe runs connecting to culverts are to be 150mm to 200mm unless otherwise stated.
 - All pipes to be either:
 - 400mm - 400mm / 150mm
 - 150mm - 400mm / 150mm
 - 200mm - 400mm / 150mm
 - 300mm - 200mm / 150mm
 - Concrete pipes to BS5911 Class 150.

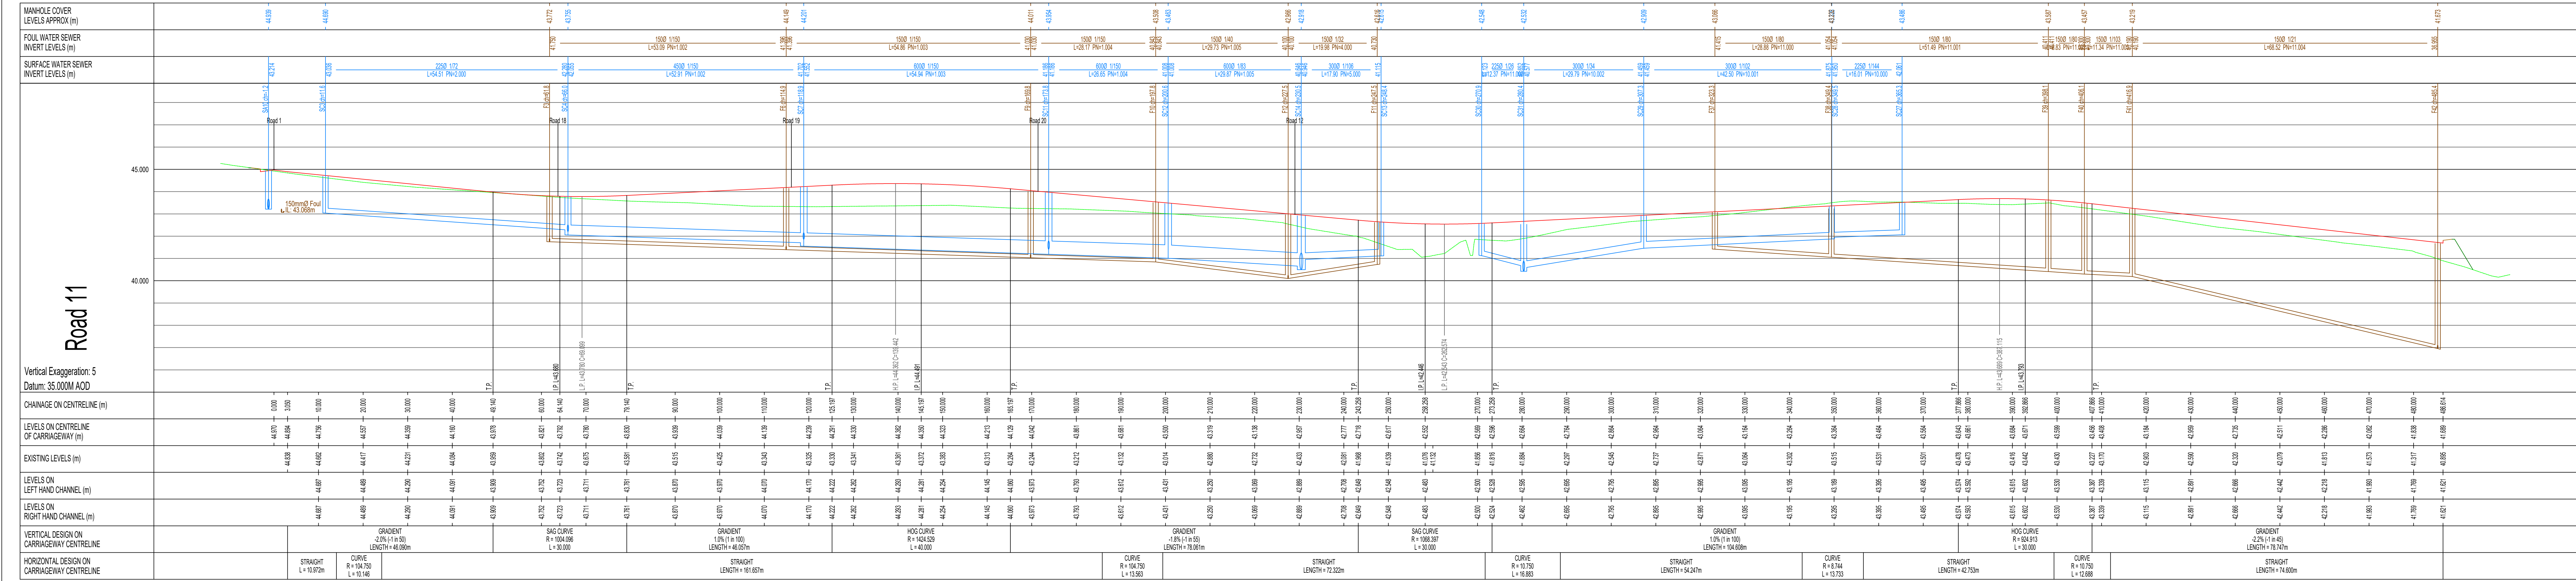