

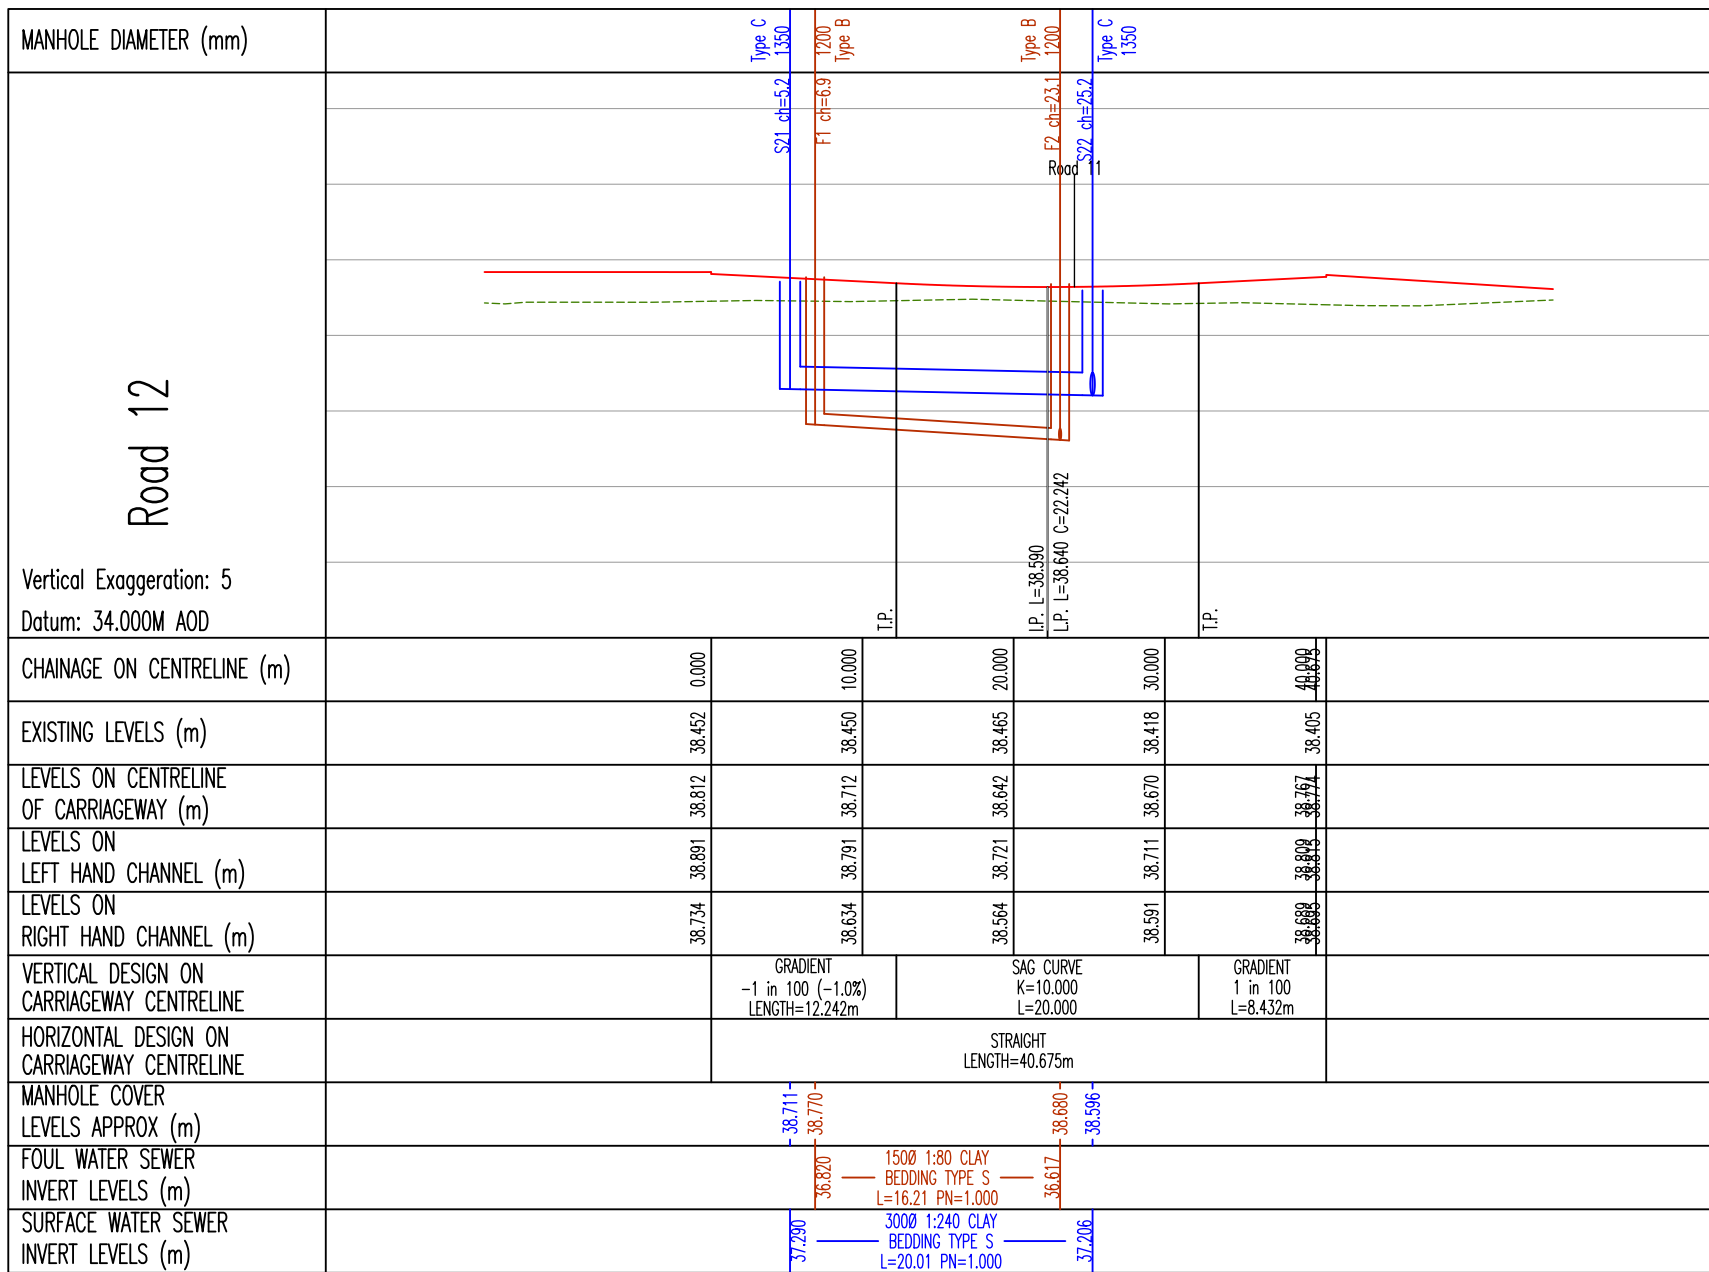
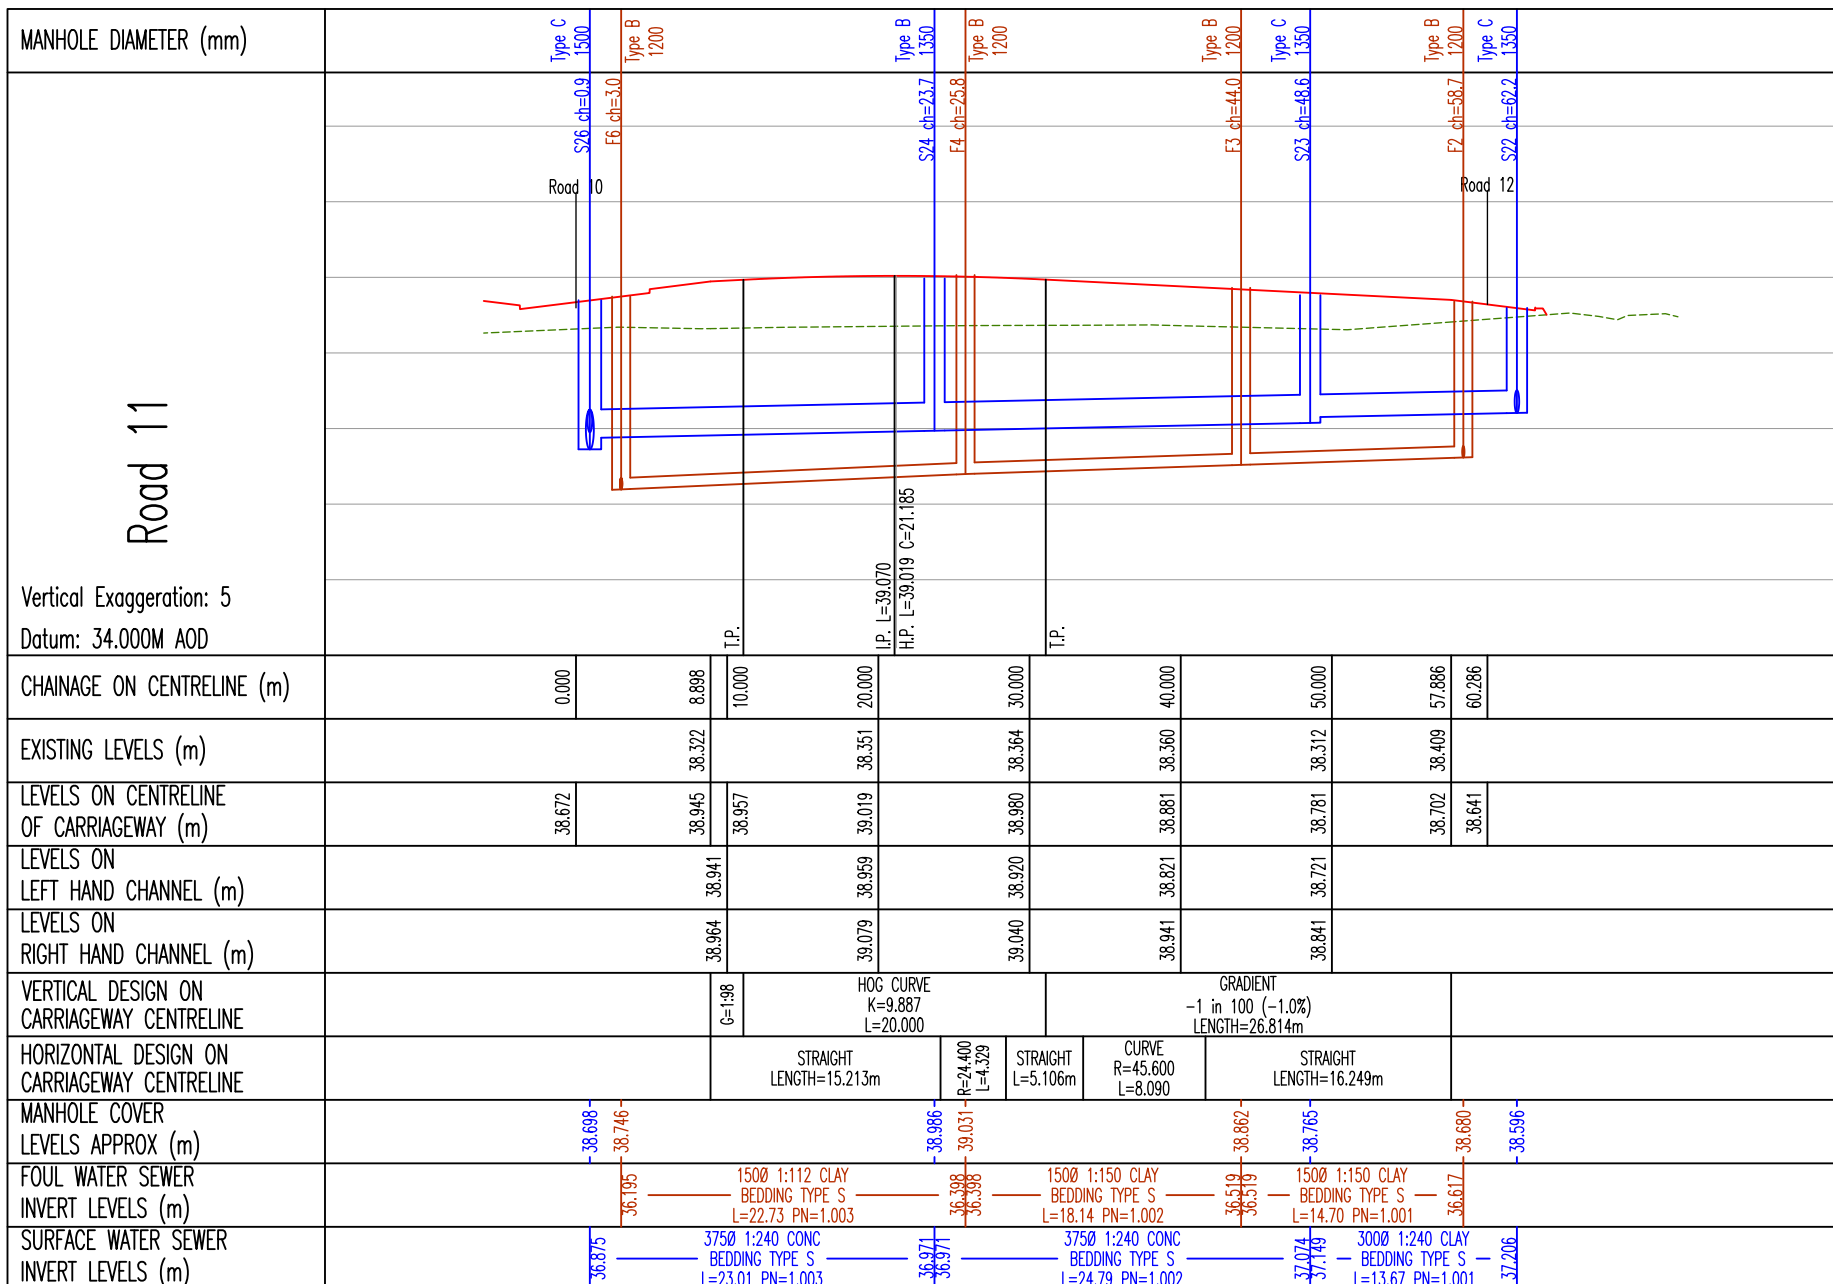
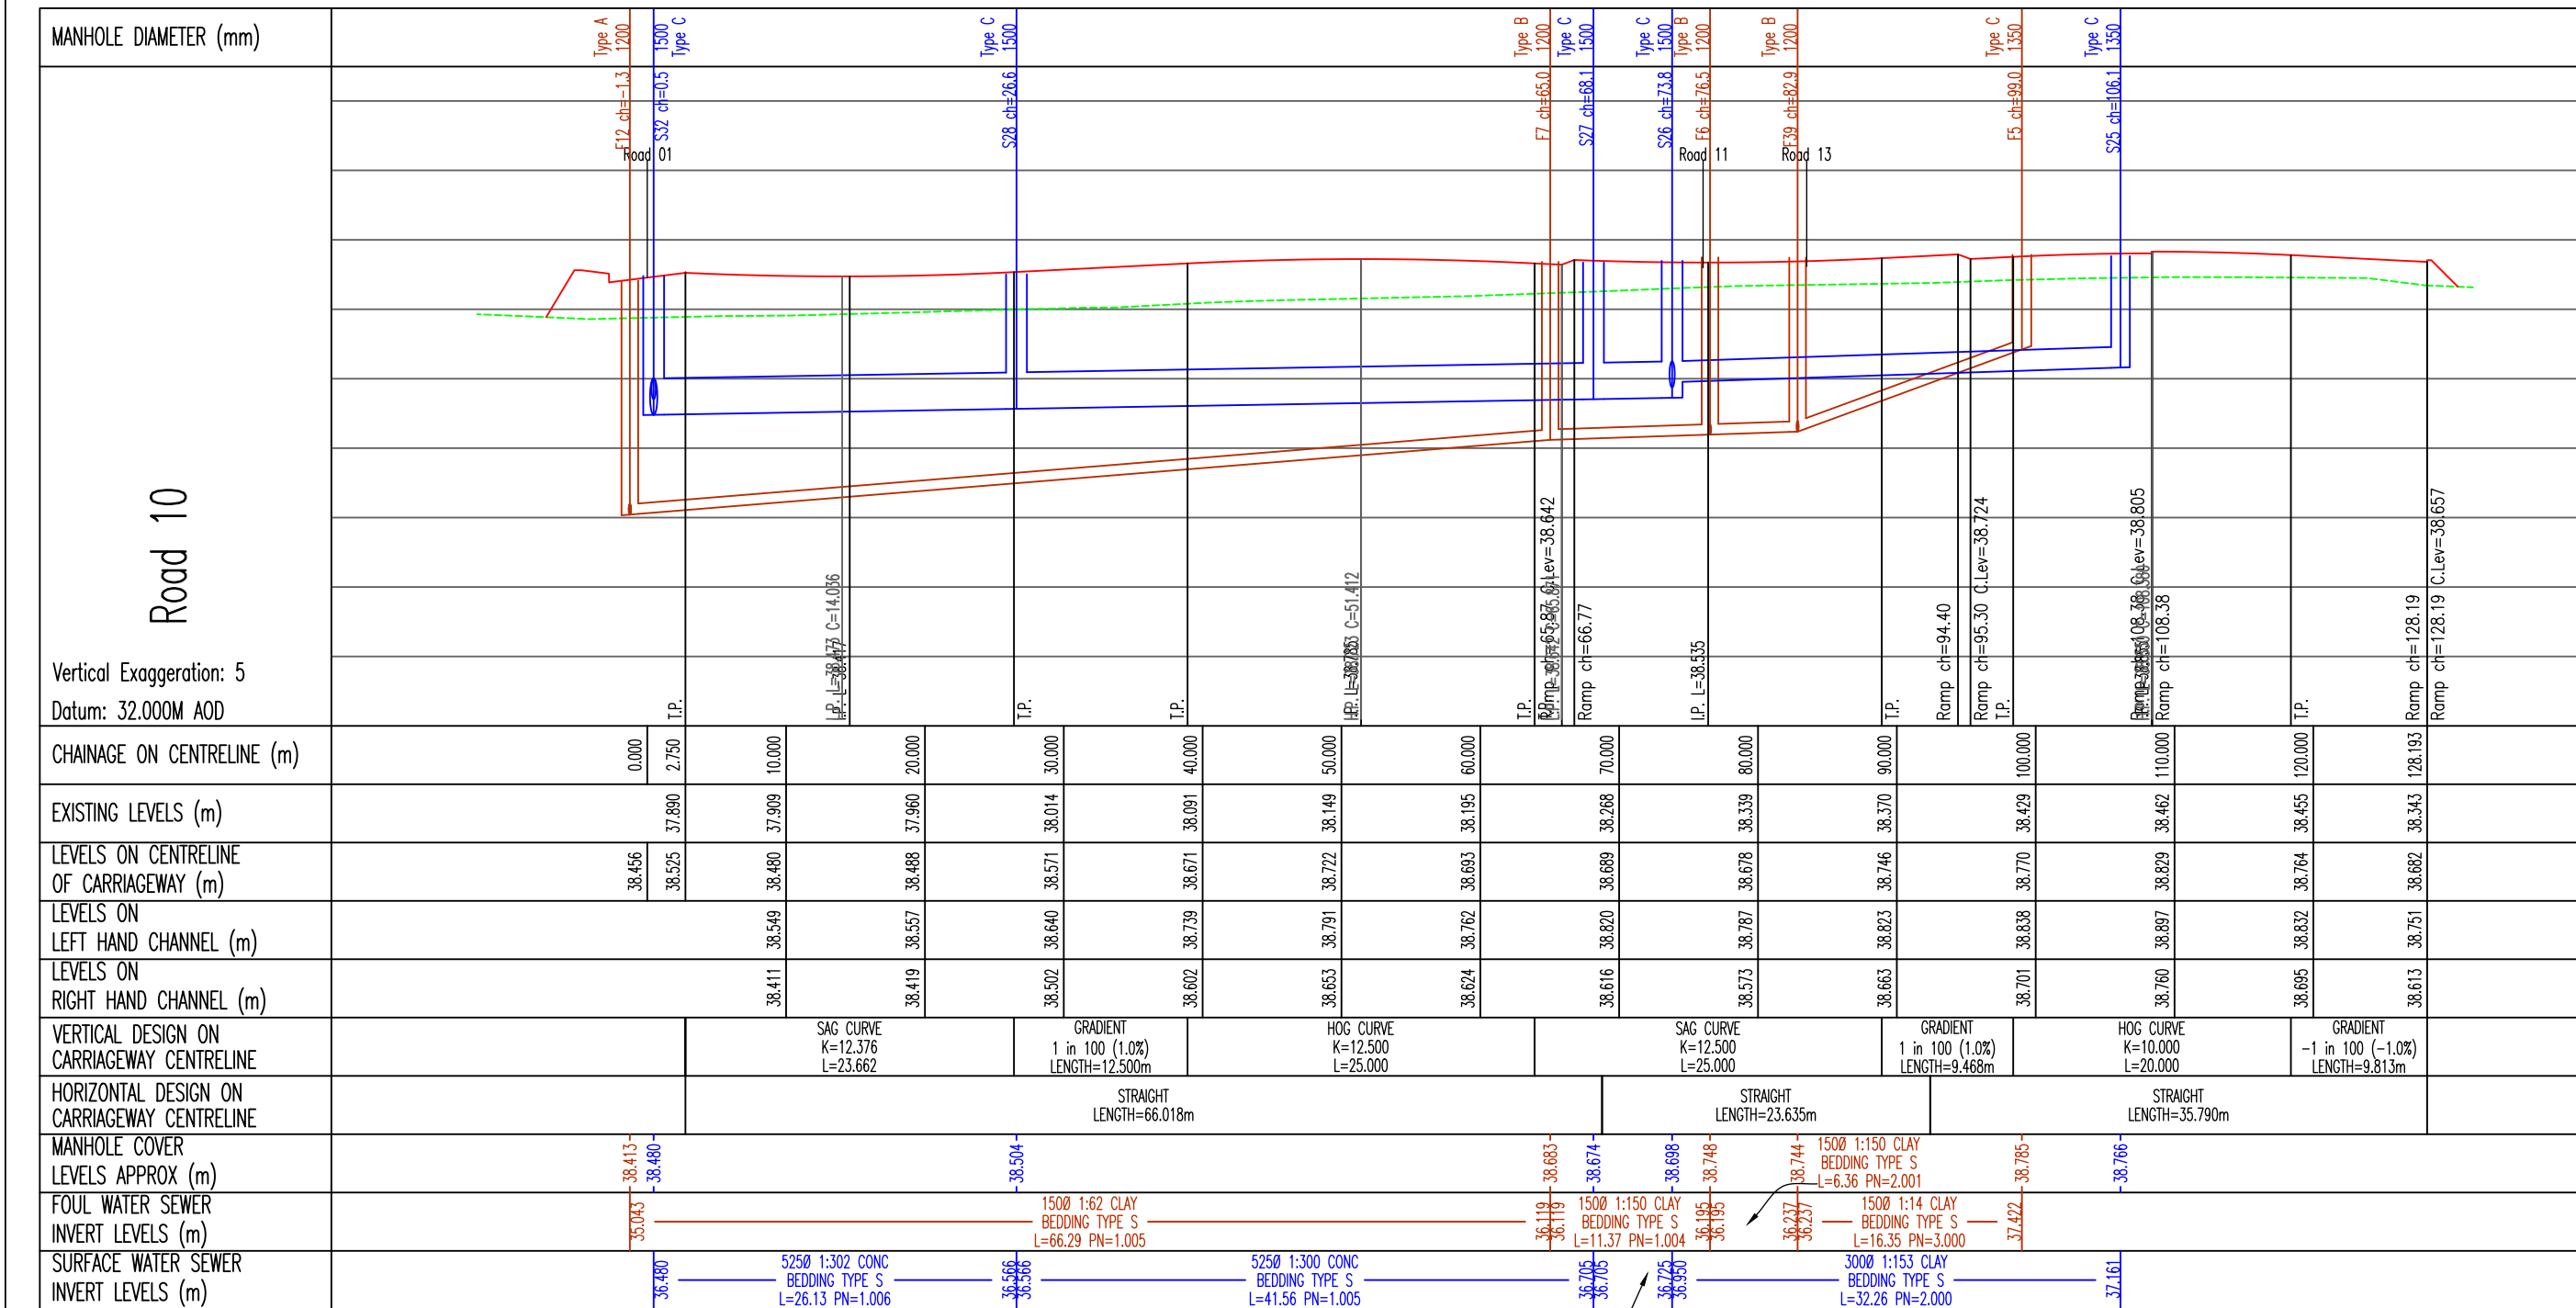
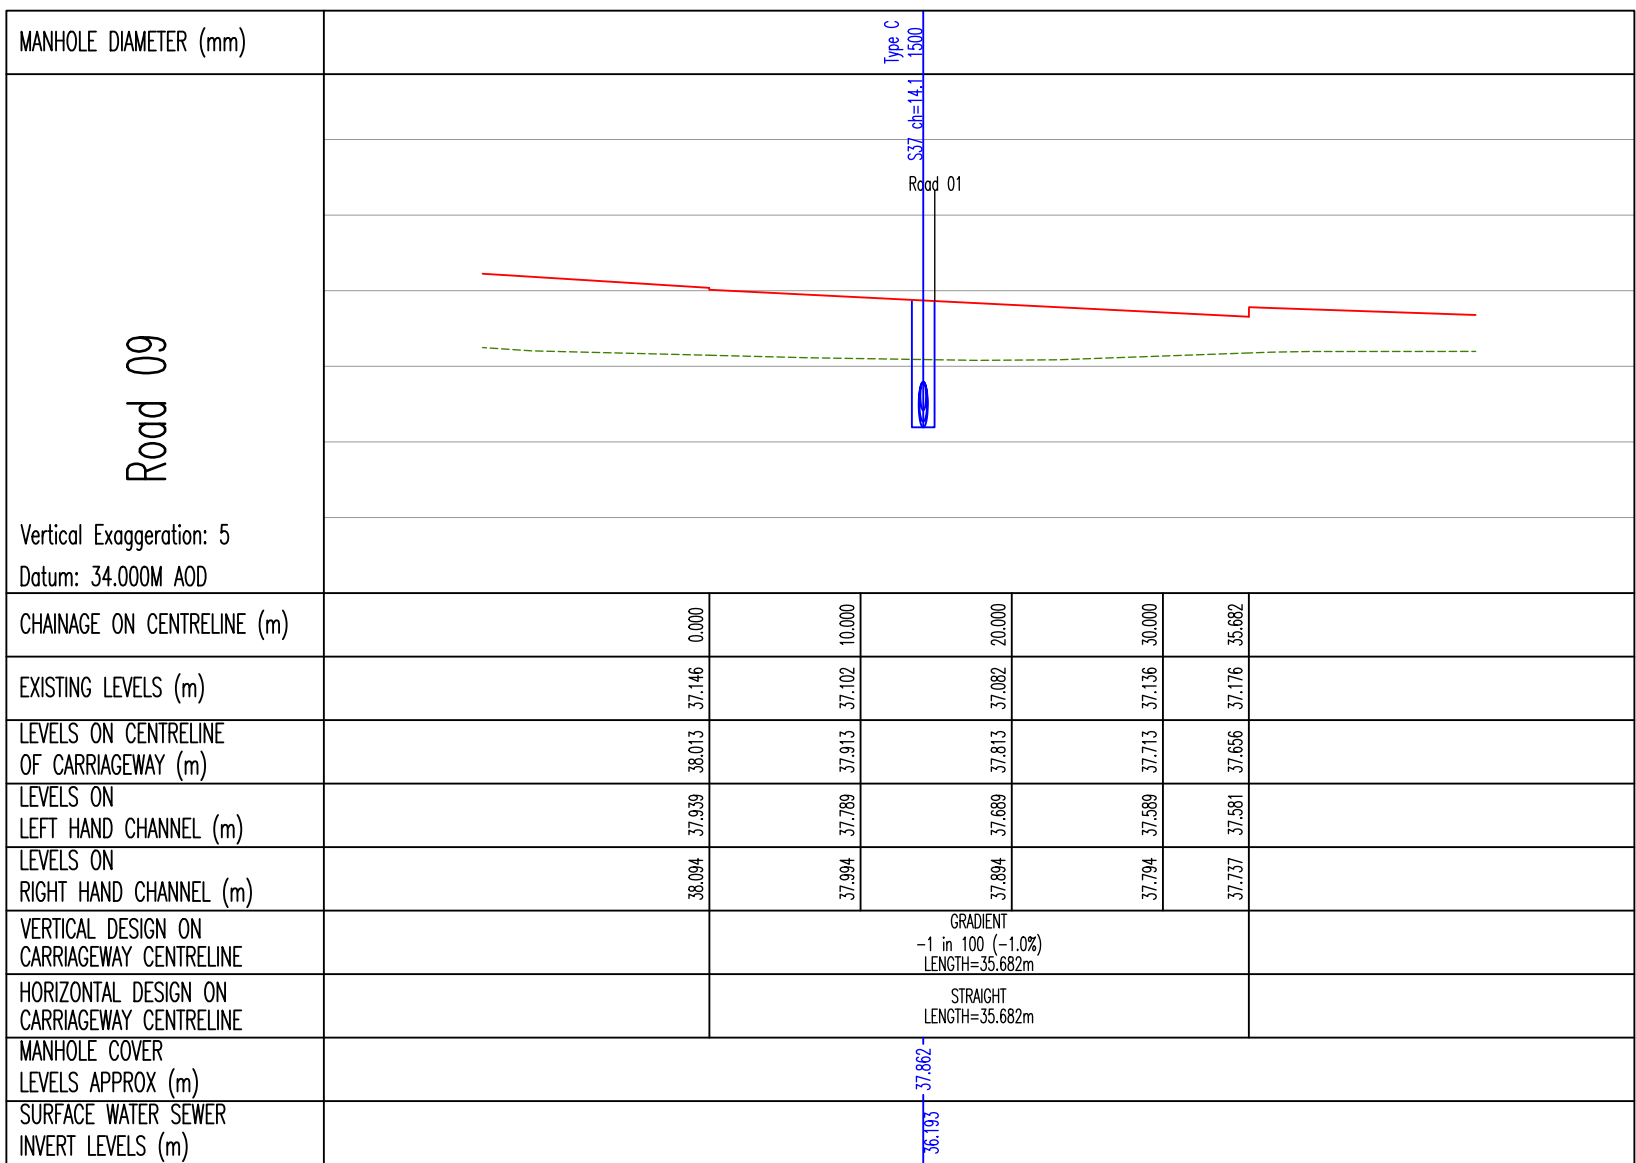
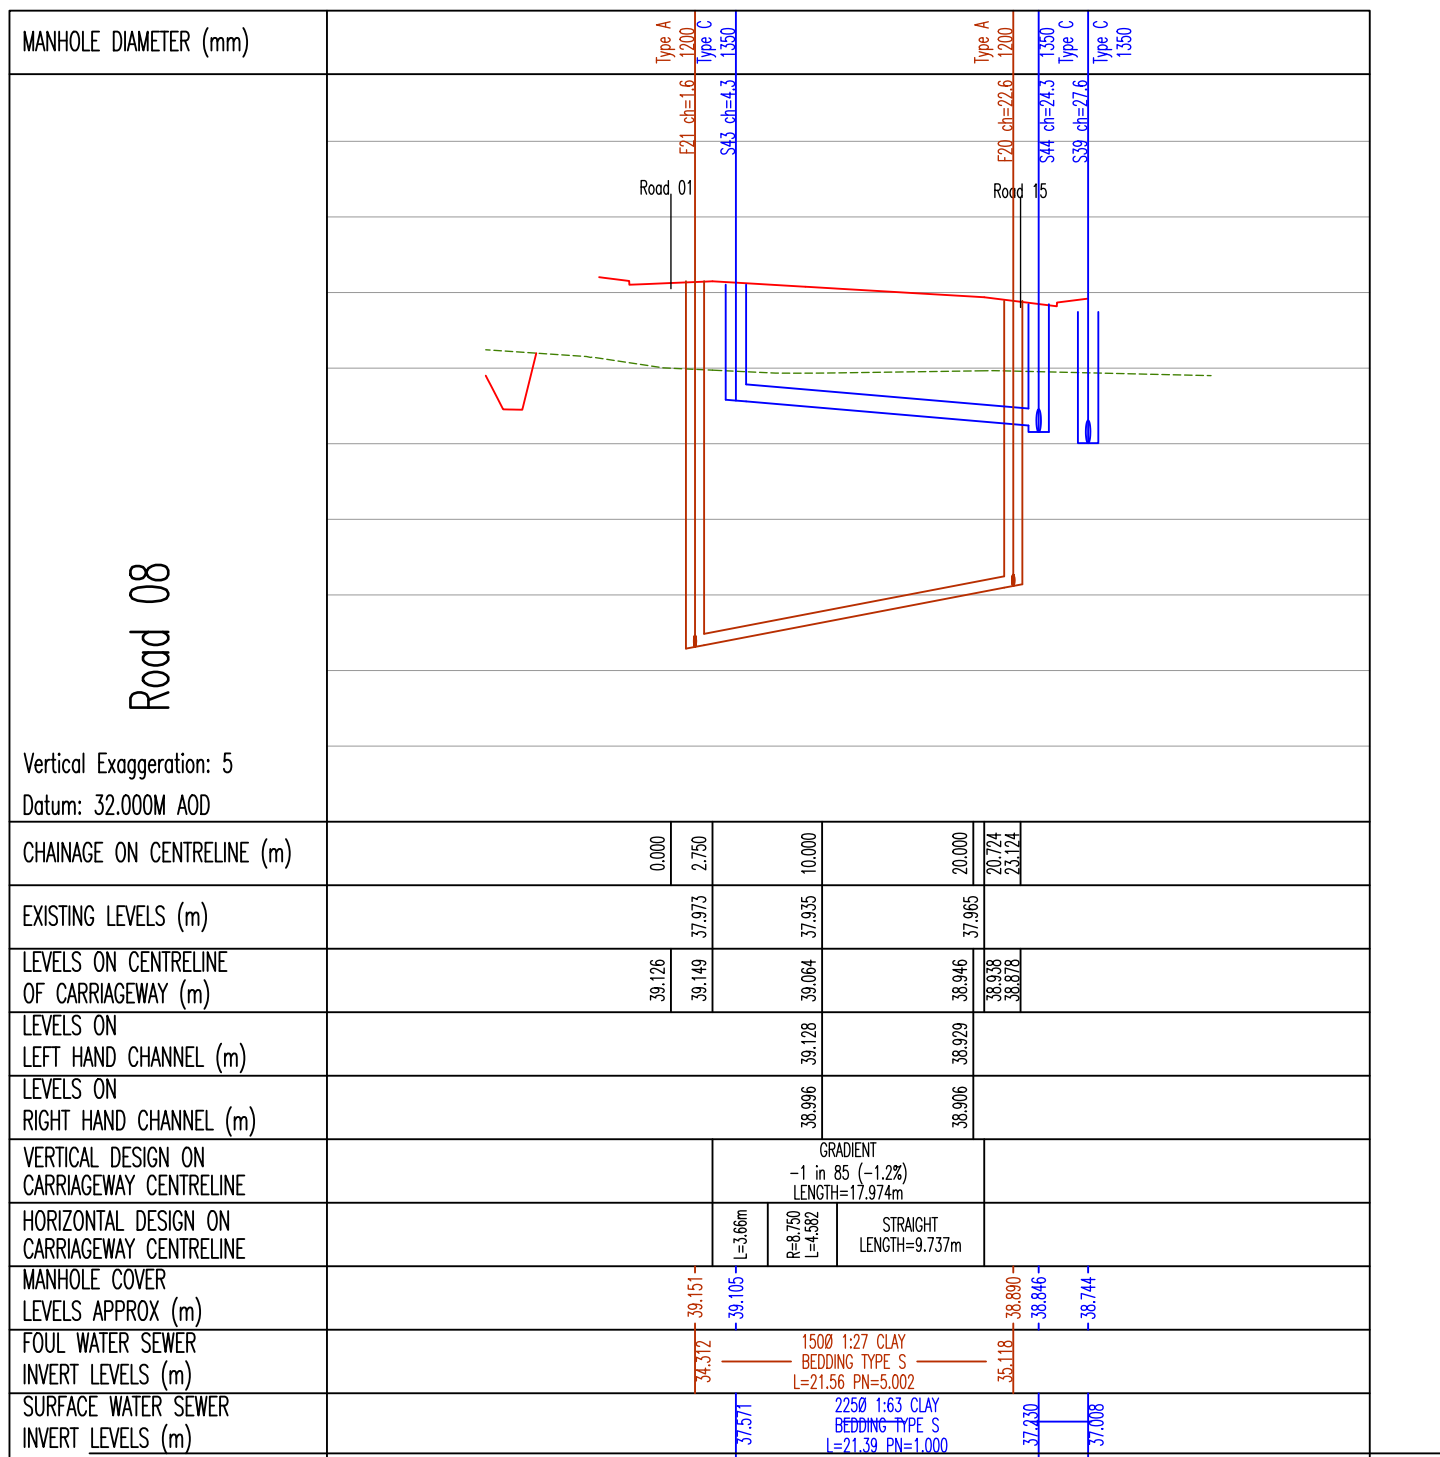
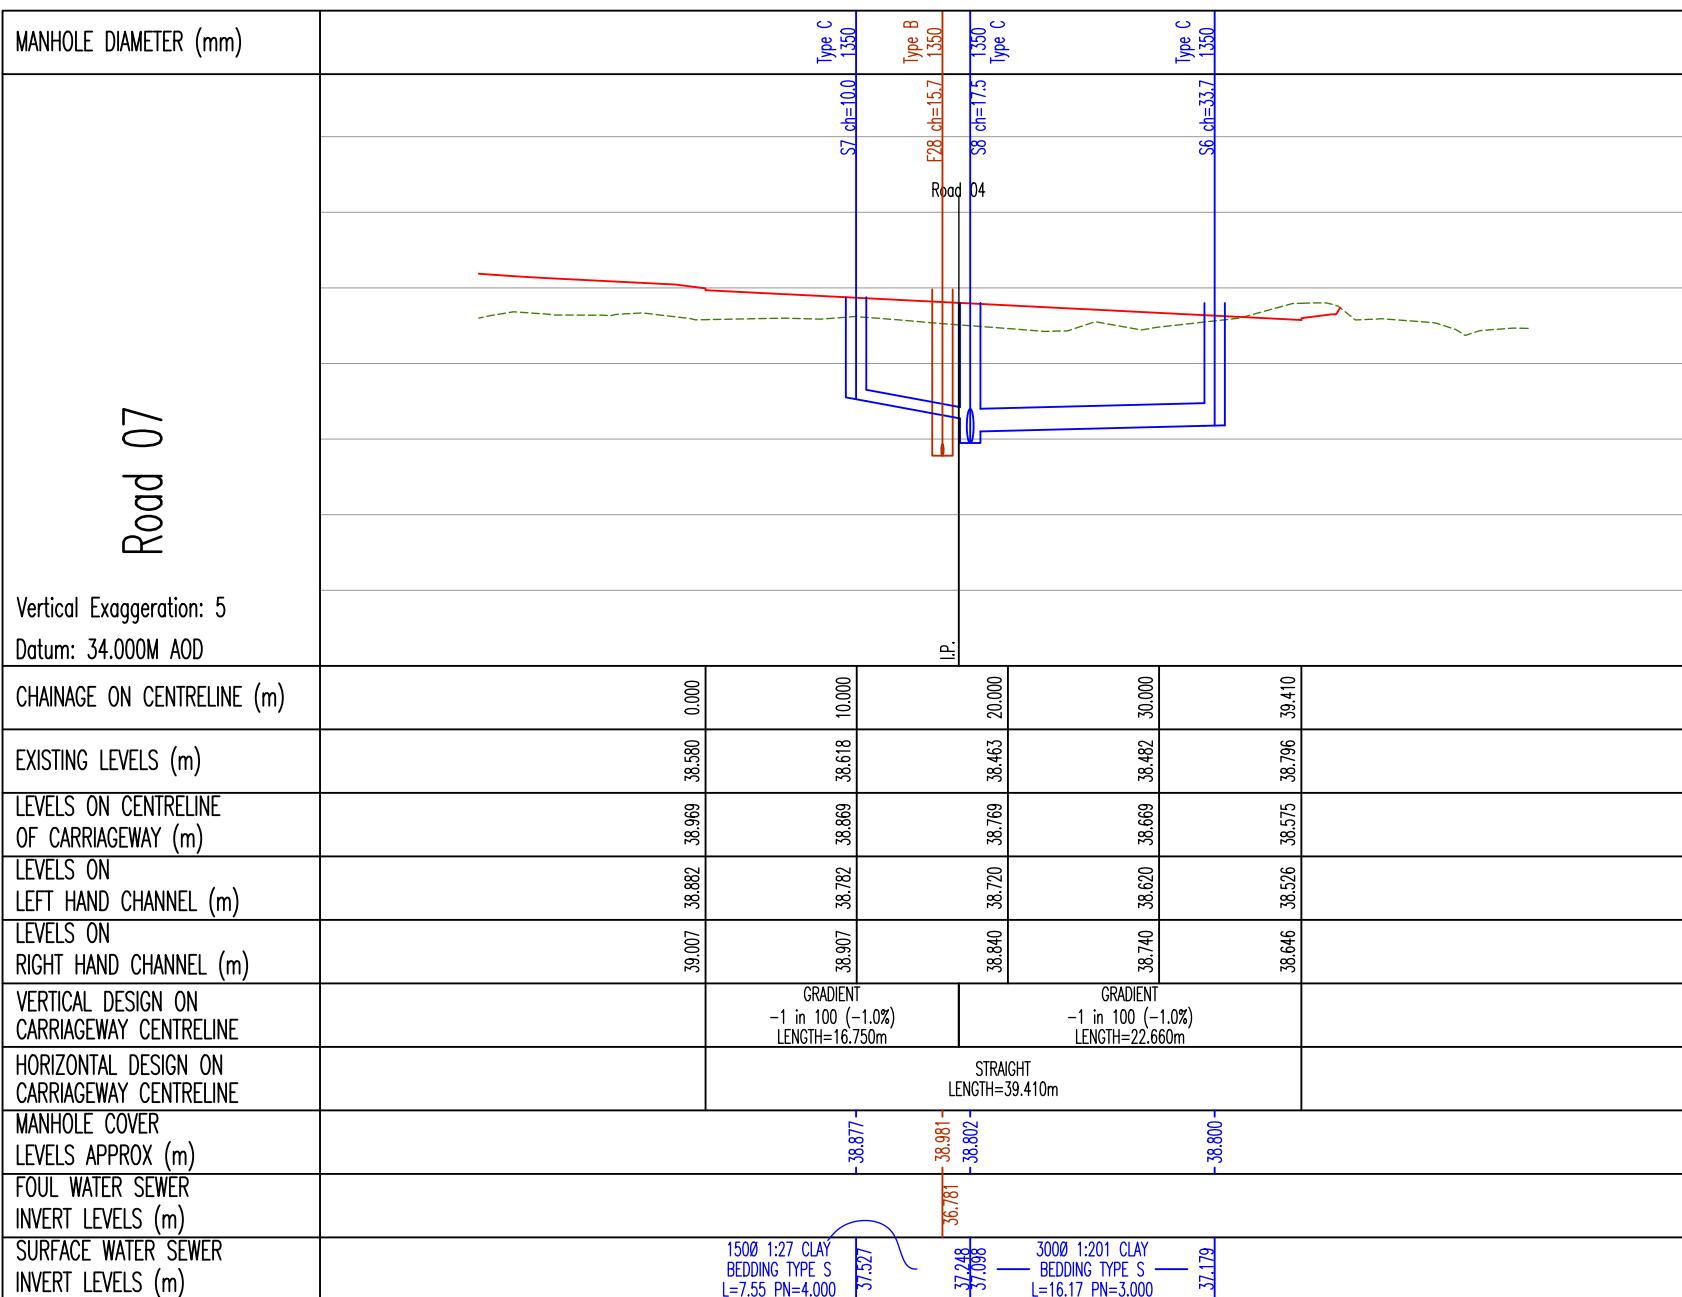
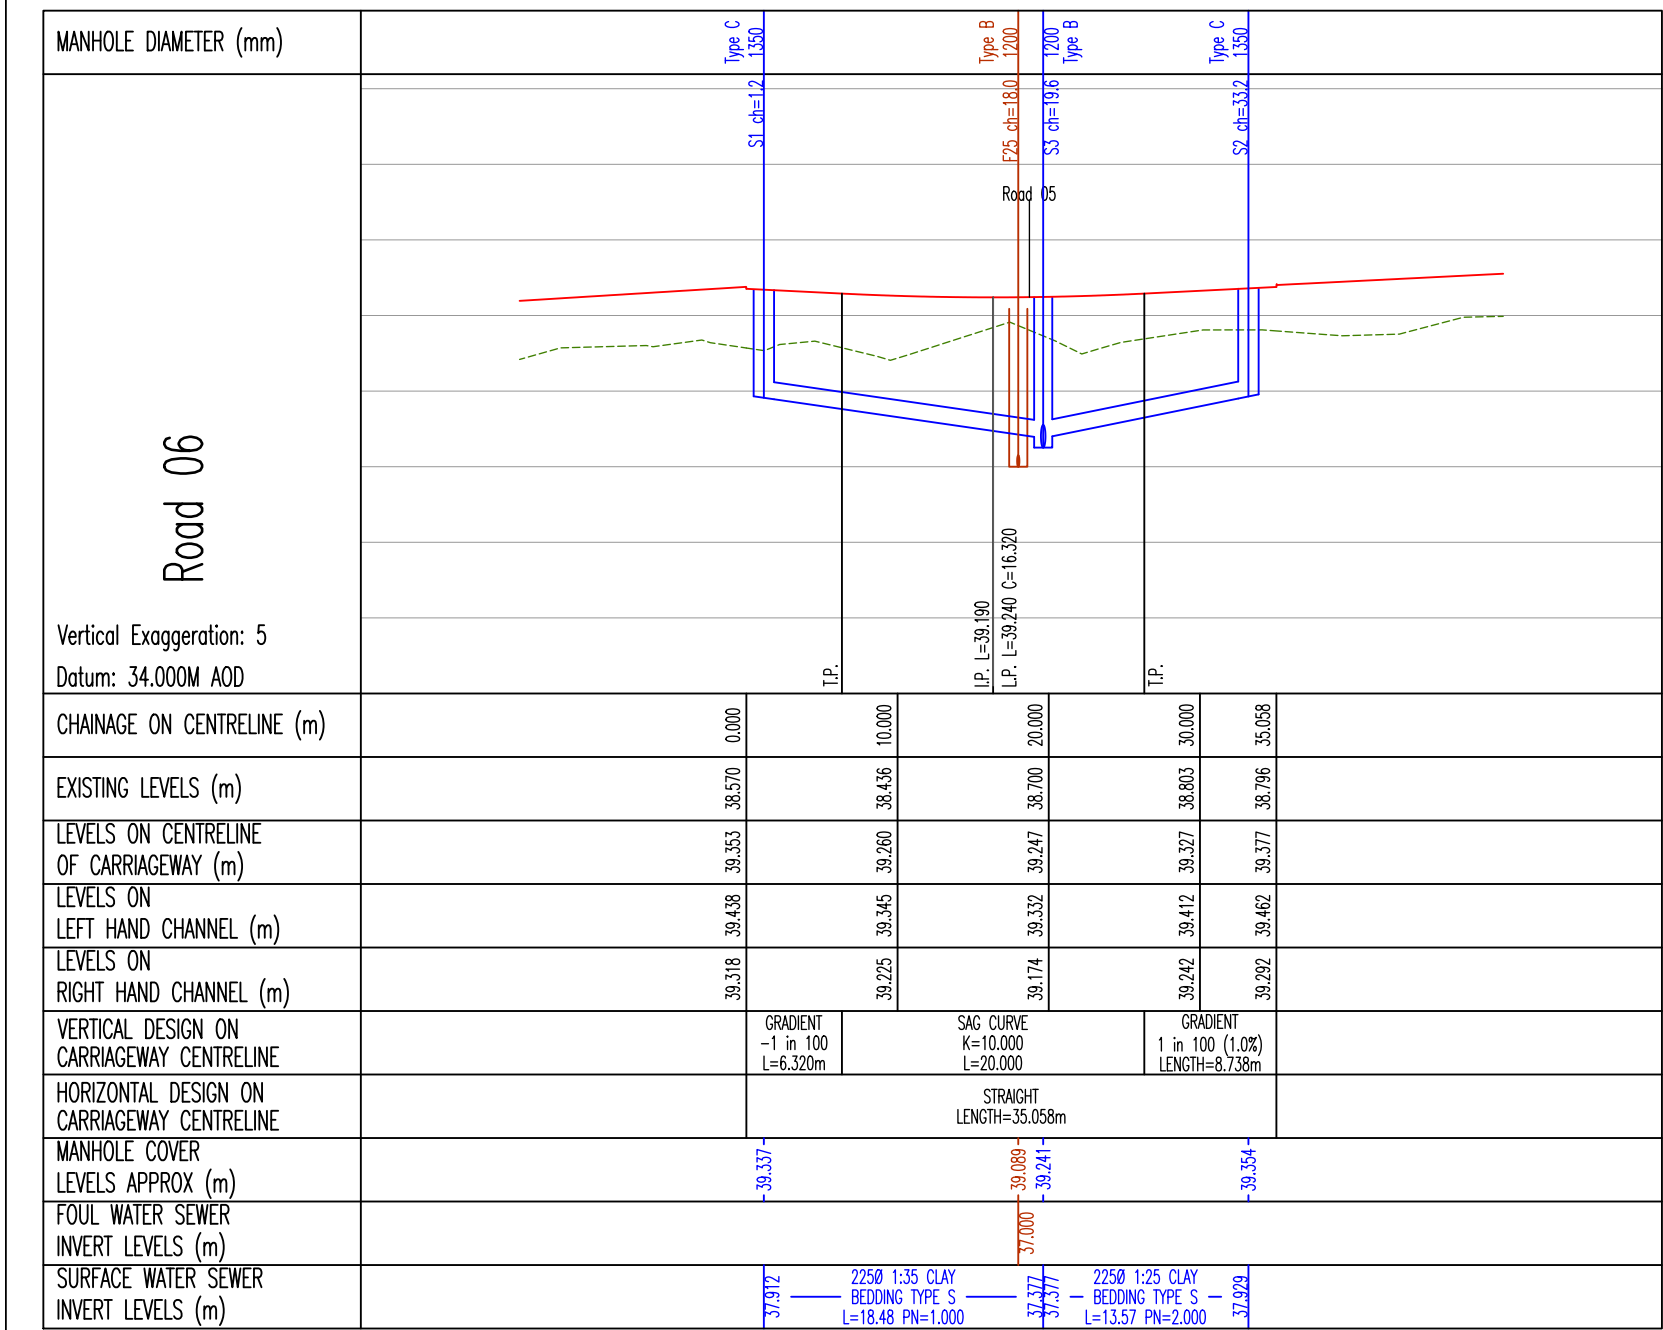
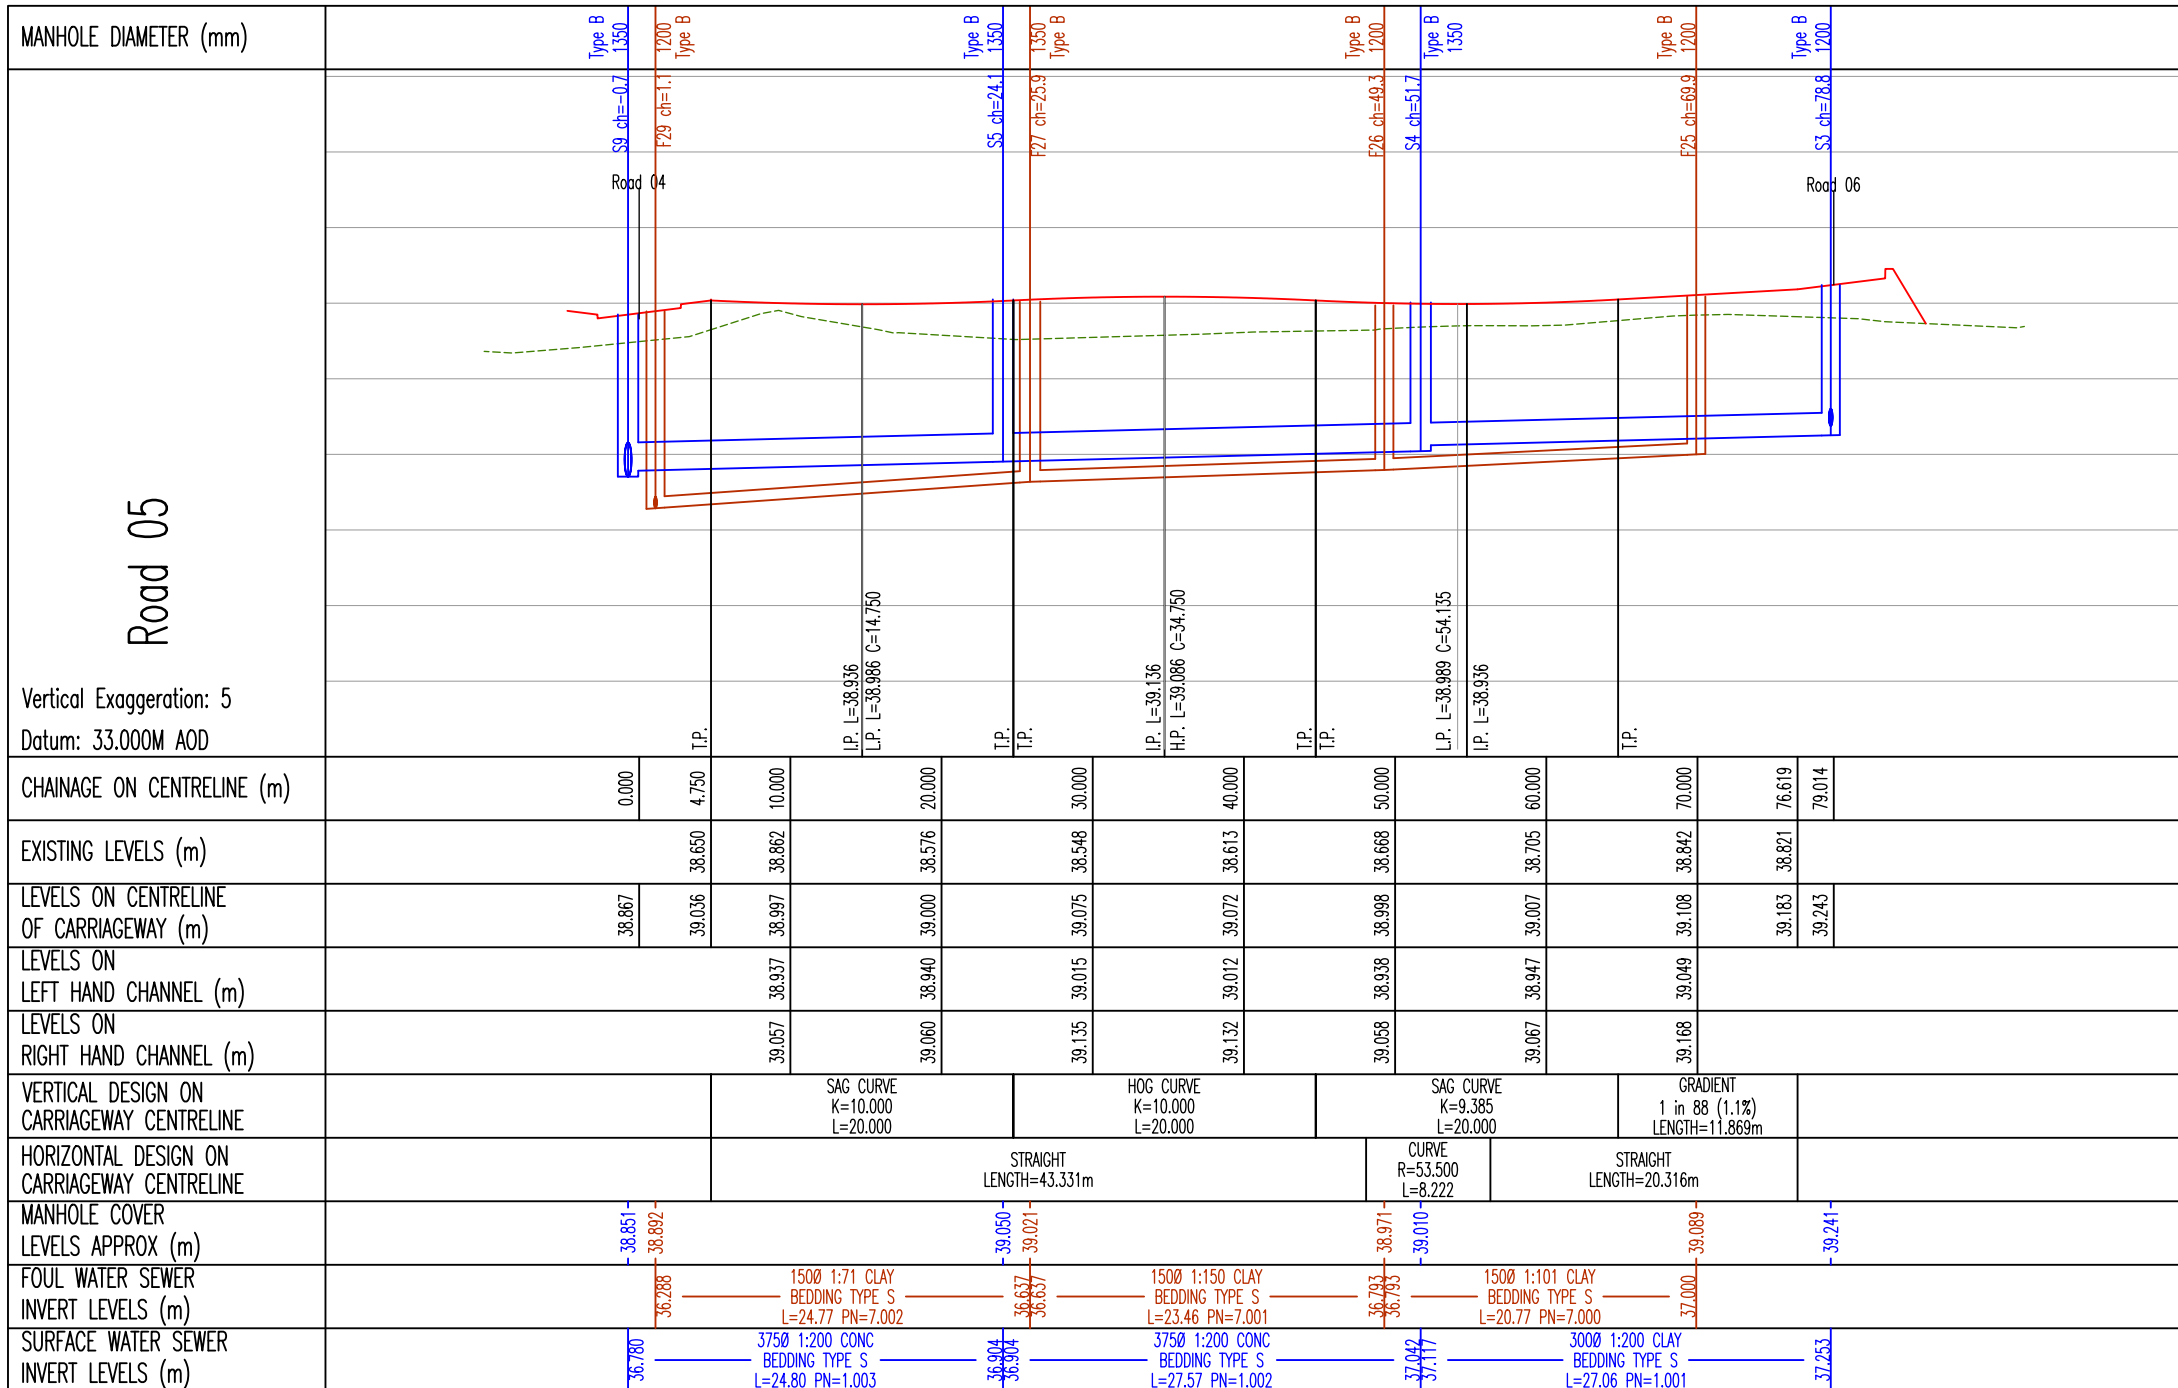
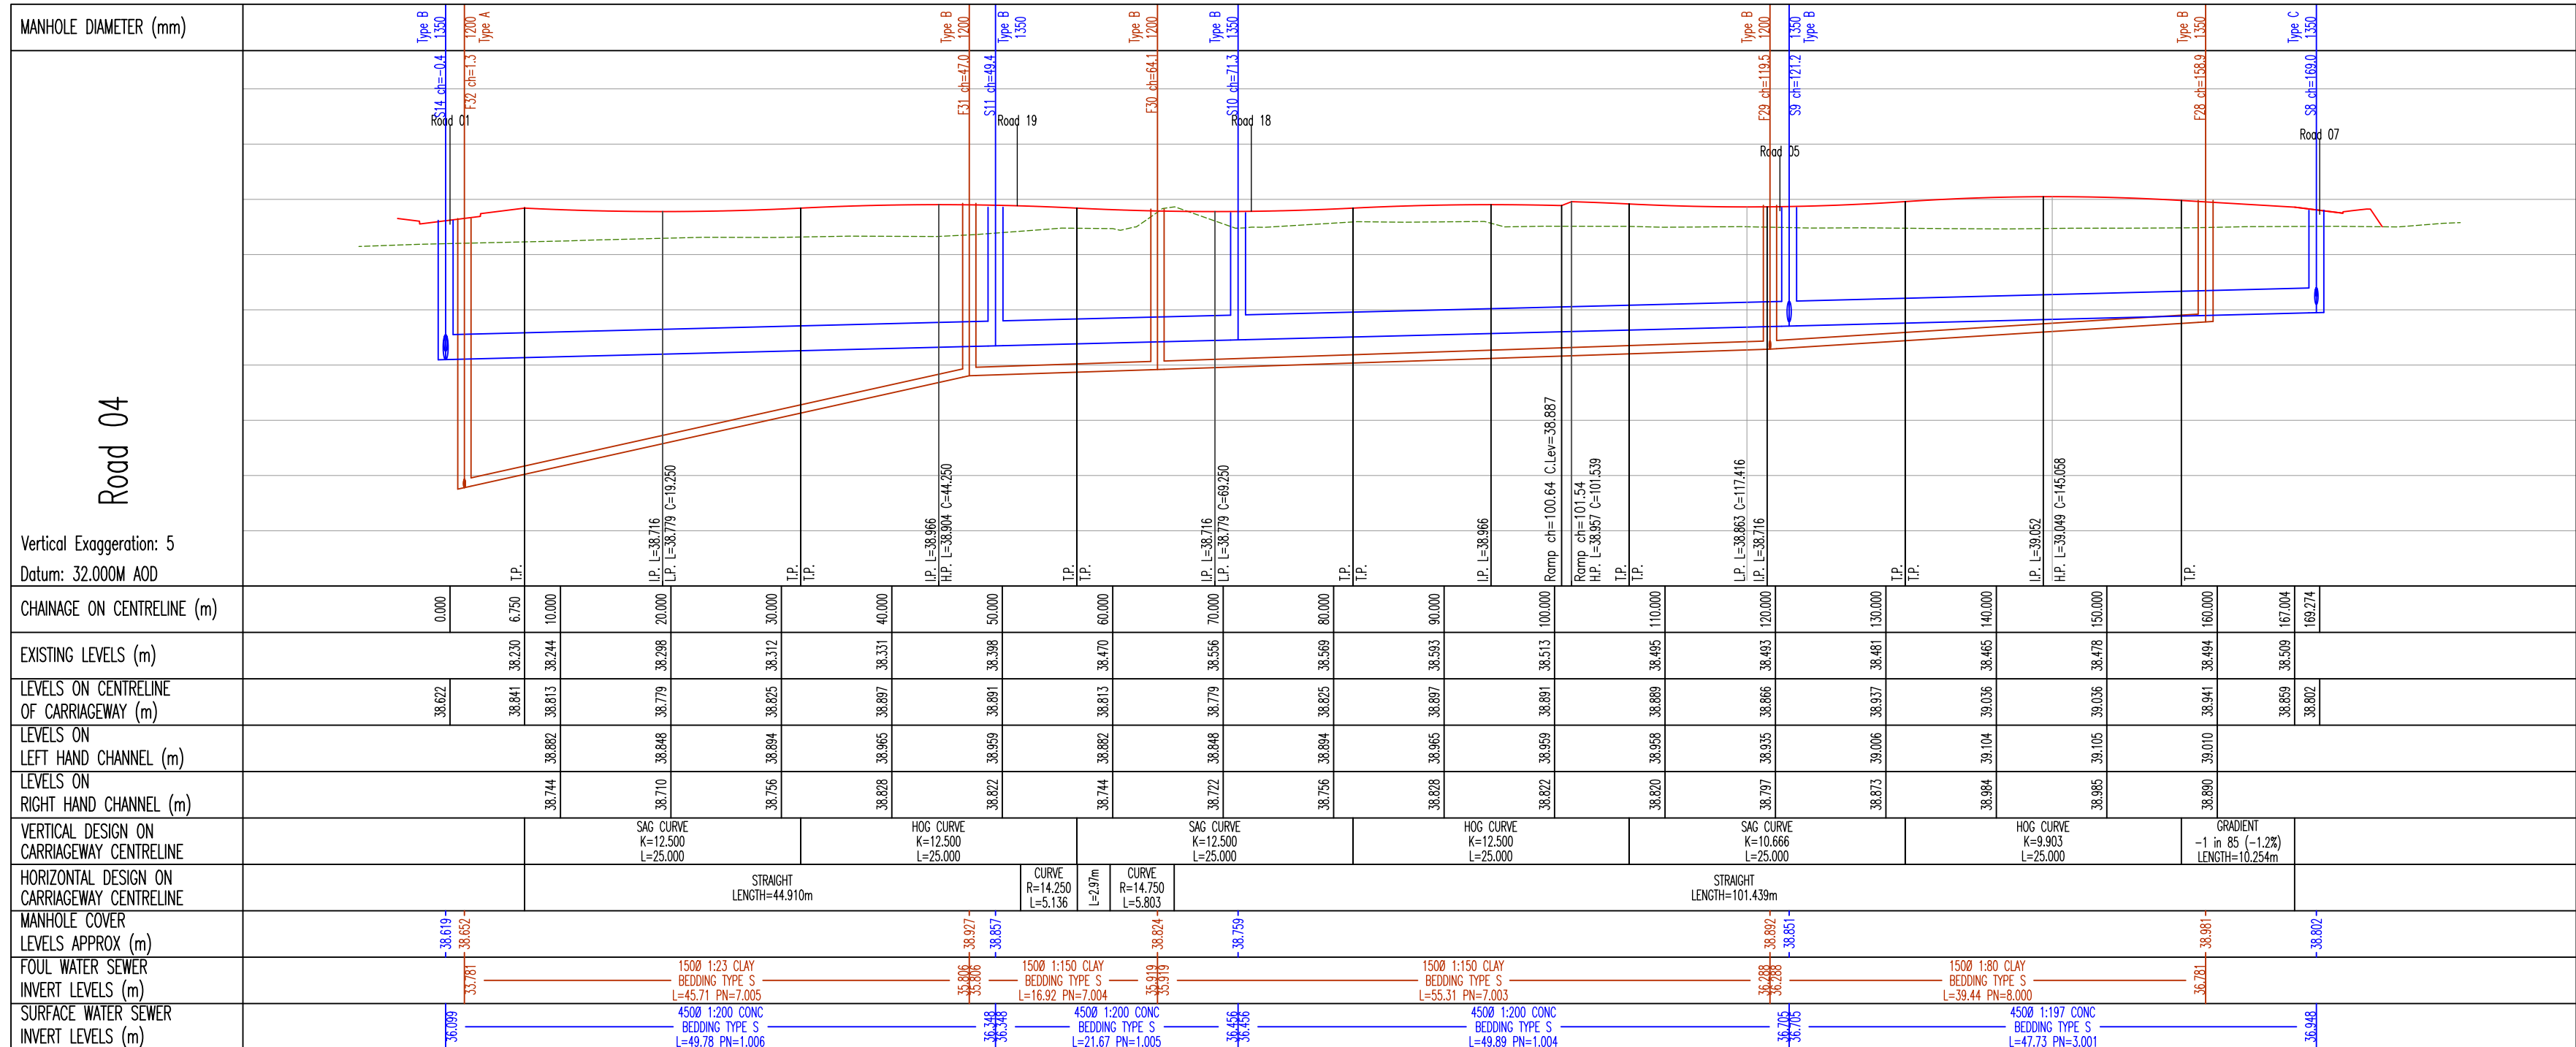
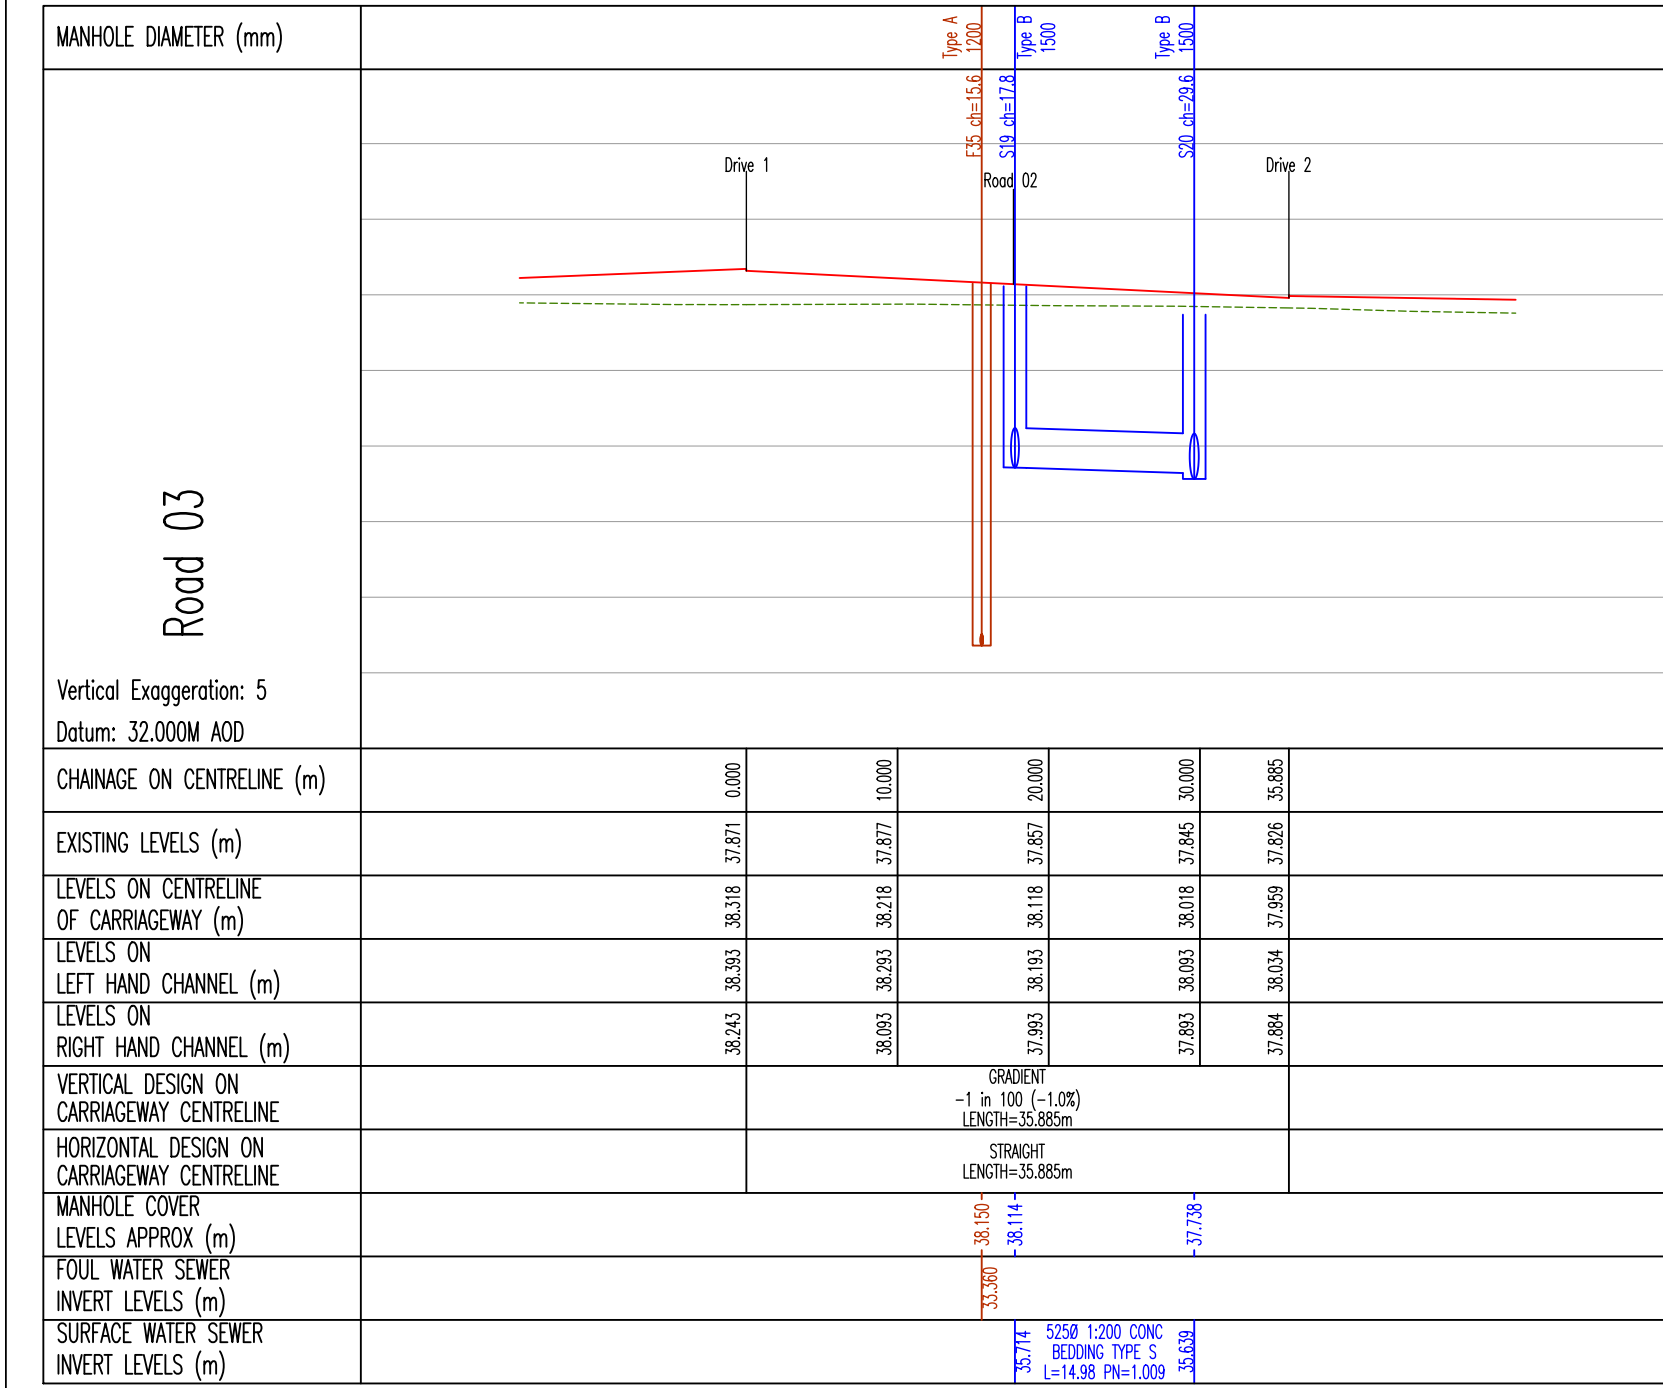


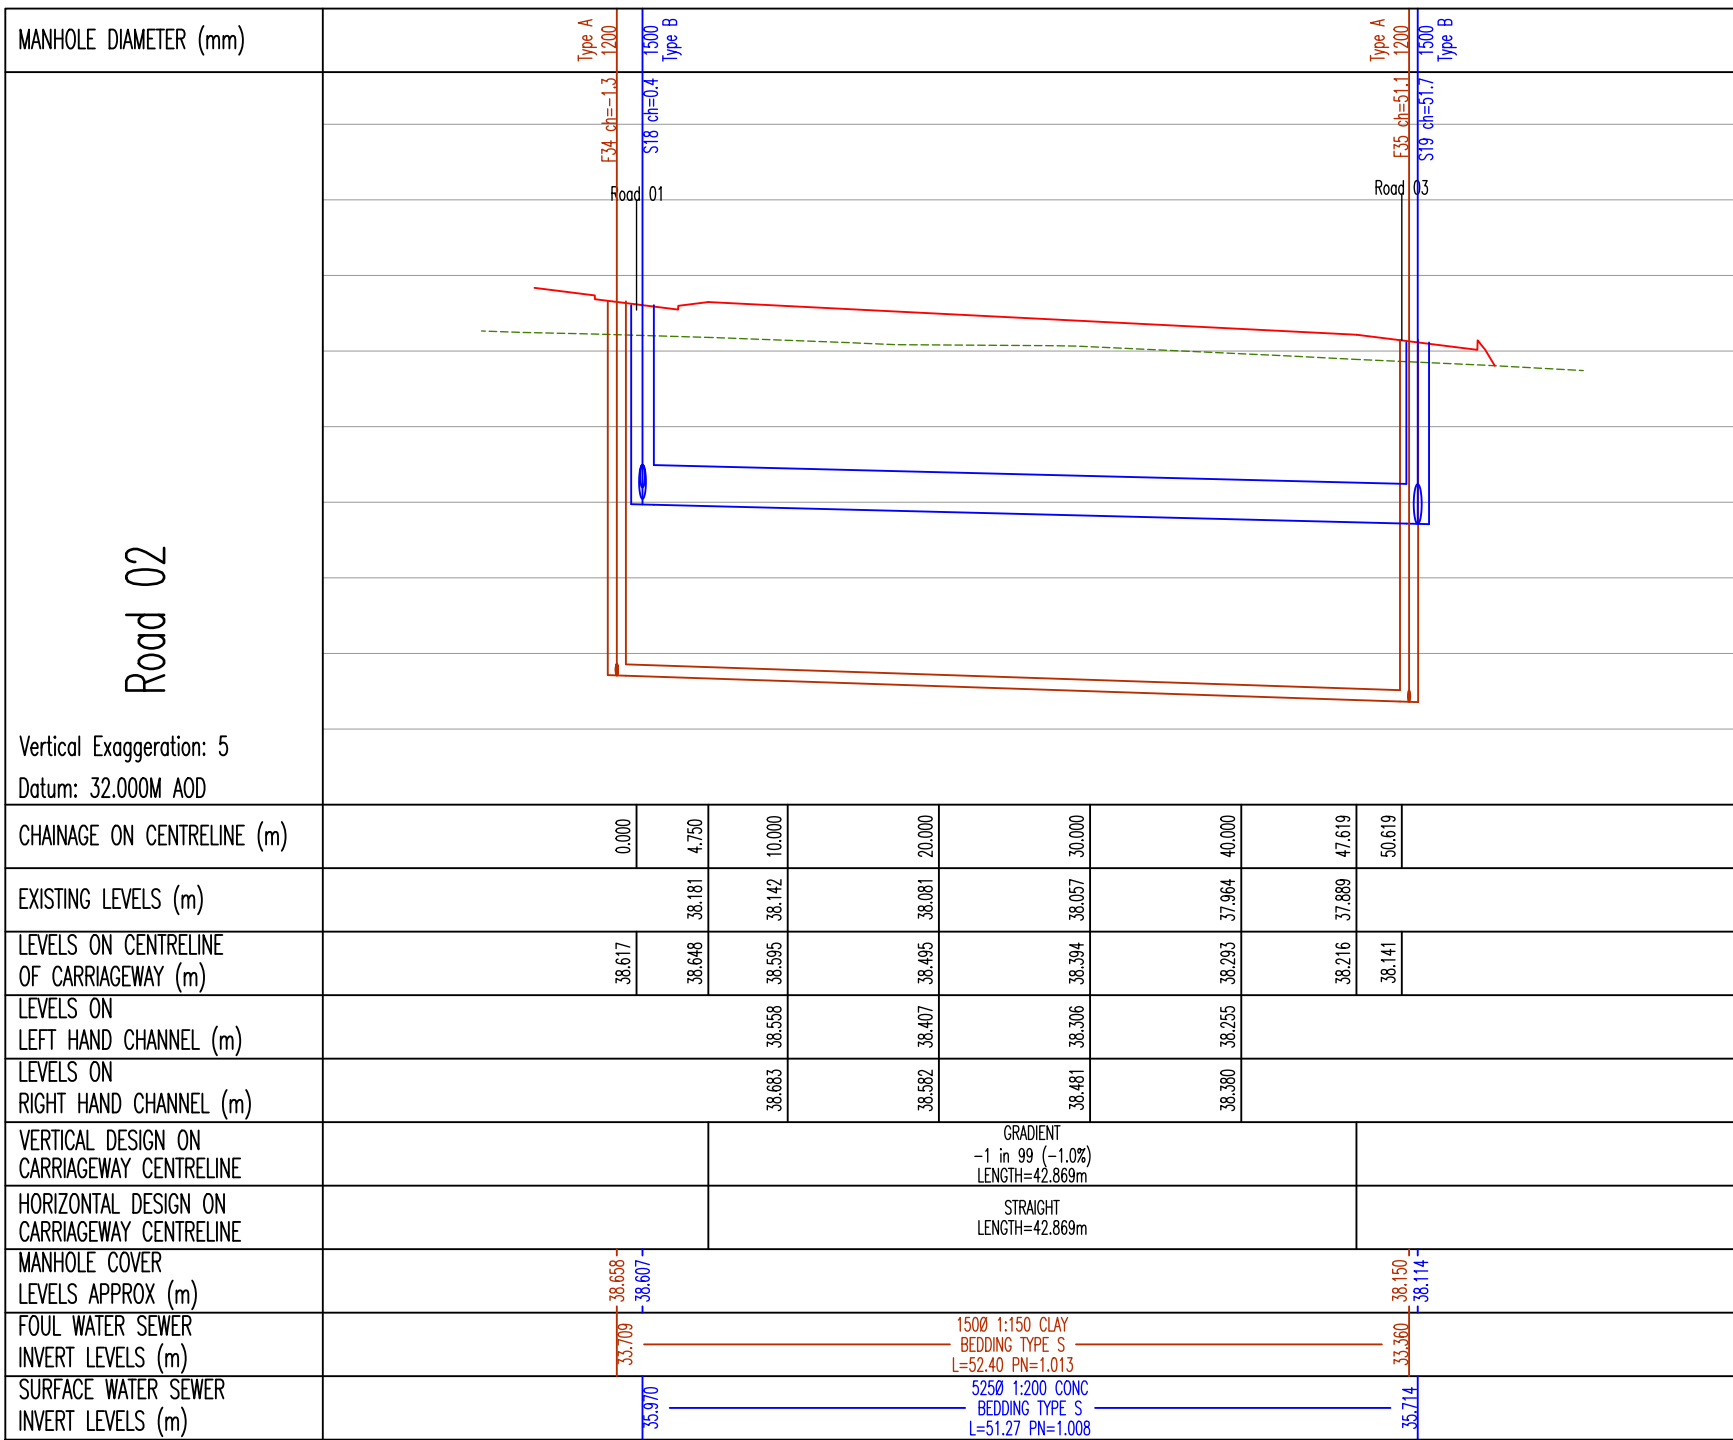

- NOTE
- All works for adoption under a Section 156 agreement shall be carried out to Minimum Council Specification and to the approval of the area highway inspector.
 - All works for adoption under a Section 156 agreement shall be carried out to the Water UK document 'Sewerage Sector Guidance Appendix C' and to the approval of the Water Authority.
 - Do Not Scale.
 - The drawing is to be read in conjunction with and checked against all other drawings, Engineering Details, specification and any structural, geotechnical or other specialist drawings.
 - Pipe sizes are shown in millimetres and levels shown in metres AOD.
 - City plans for foul and surface sewers shall comply with the relevant requirements of BS EN 252-1 and BS65 (surface pipes only). City plans to be Class C120.
 - Unreinforced concrete and reinforced concrete pipes shall comply with the relevant provisions of BS EN 1258 and BS 5911. Concrete pipes to be Class C120.
 - All pipes are to have Class 5 granular bedding unless otherwise shown.
 - Concrete protection to be provided to all inlets under roads where cover to the pipe is less than 1.2m.

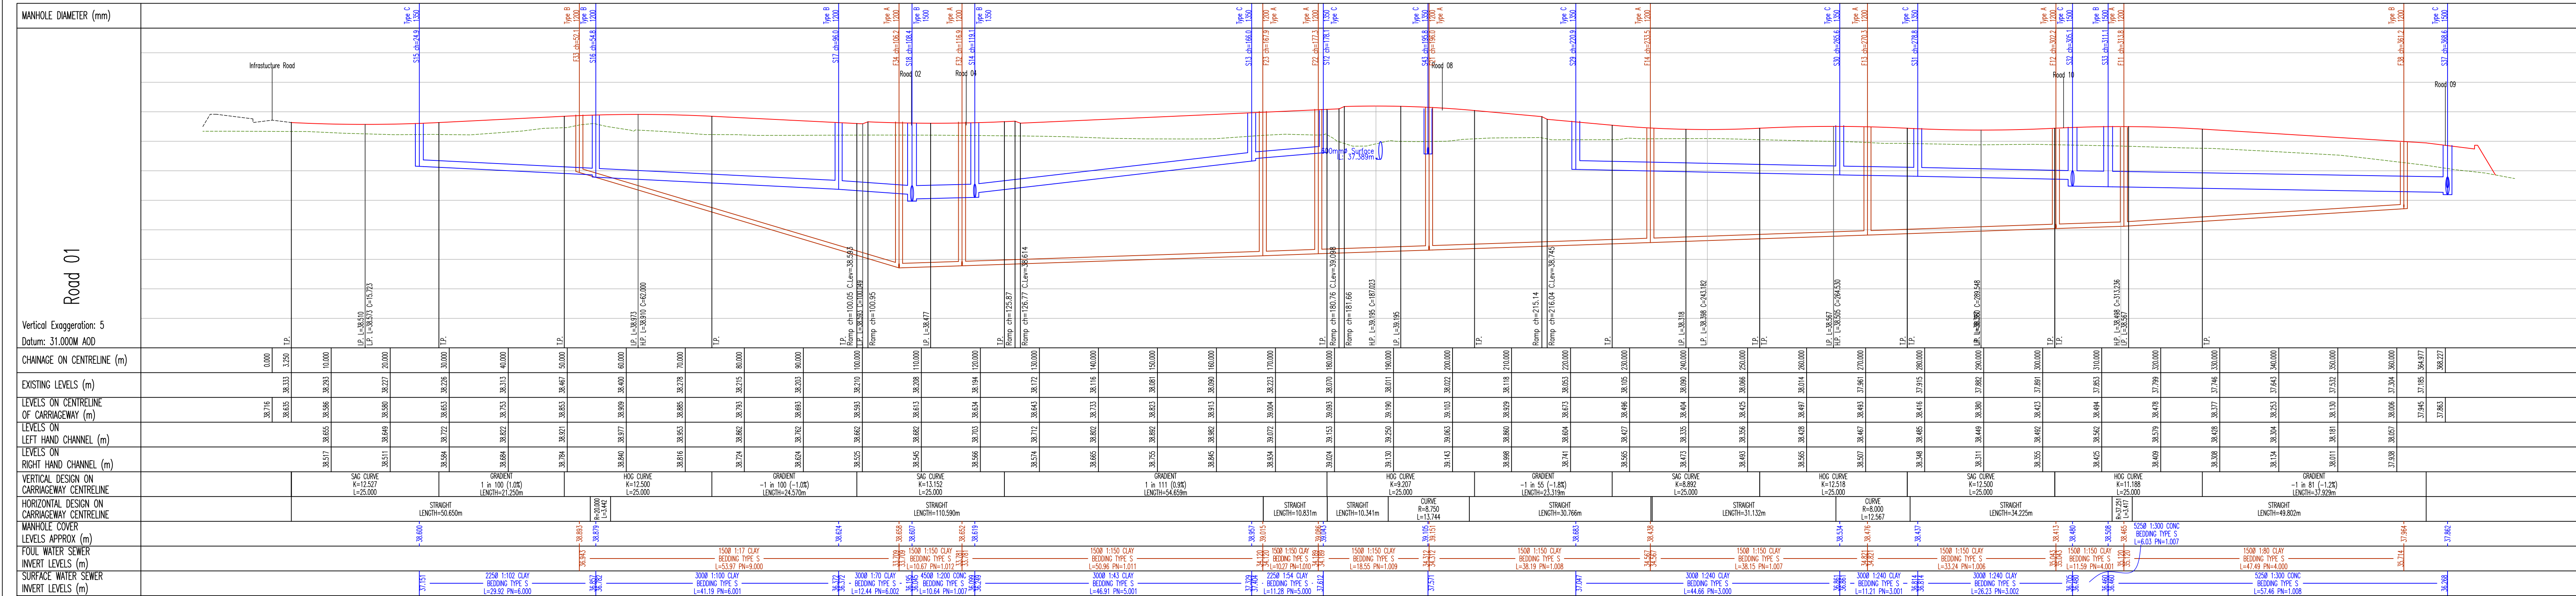