



Representative Layout Only

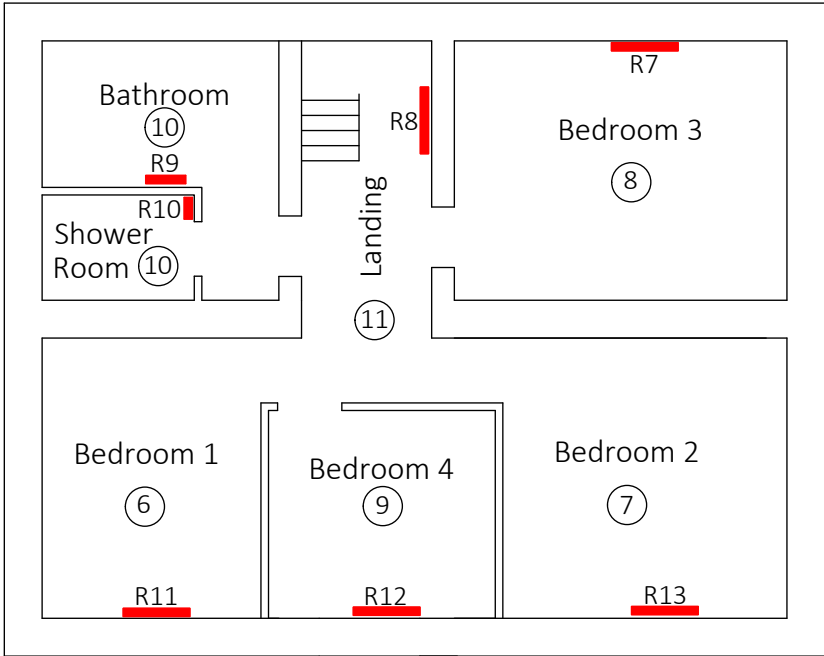

First Floor

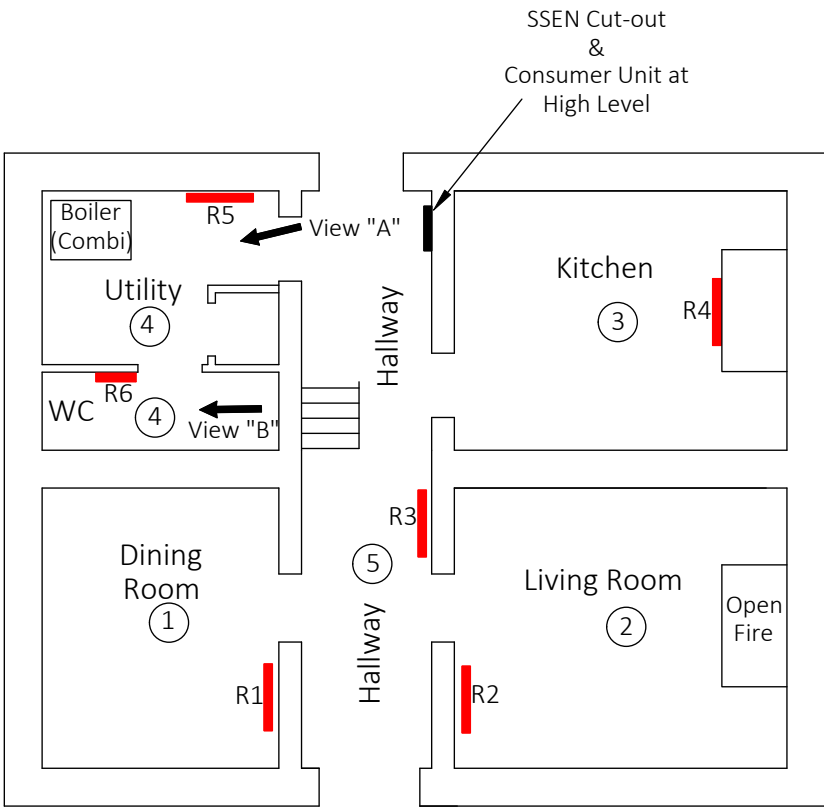

Ground Floor

Existing Radiator Schedule

Ref	Room	Target Temp. (°C)	Peak Heat Loss (kW)	Type	Output (kW) @70°C
1	Dining	22	1.4	P+	1.3
2	Sitting	22	1.4	P+	1.6
3	Kitchen	18	0.9	K1	1.1
4	Utility and WC	18	0.9	K1	1.1
5	Hallway	18	0.9	K1	1.0
6	Bedroom	18	0.8	K1	1.0
7	Bedroom	18	0.7	K1	1.0
8	Bedroom	18	0.9	K1	1.1
9	Bedroom	18	0.5	K1	0.6
10	Bathroom	21	1.2	K1	1.1
11	Landing	18	0.5	K1	0.9
Total			10.0		11.7



View "A". The Utility Room and Boiler



View "B". The Propsed Entry Point for the Heat Main

NOTE
The Contract is for Design and Build. This drawing is intended as an illustration of how the Perfomance Specification could be met. The Contractor may use a different design. In all cases liability for the design lies with the Conactor

NOTES:

1. This drawing is for guidance only. All information must be checked before use for design or planning.
2. Do not scale.

Existing

Revision	By	Date	Details



Redcotec LLP, Orchards,
Stockland, Honiton
Devon, EX14 9DS

Tel: 01297 761510
Email: info@redcotec.co.uk

Client		The National Trust	
Drawing Title		89 Church Lawn Floor and Radiator Plans - Existing	
Drawn By		Date	07/08/26
W Gilmour-White			
Checked By		Date	
Scale		Job Reference	
1:100 @ A3		RCT-731	
Drawing Ref/No			Rev
RCT_731_102A			